

# **OIL ANALYSIS REPORT**

### Sample Rating Trend



Machine Id

# FRICK TYSPBFP 6B (S/N TDSH183L1147H)

Refrigeration Compressor

**USPI ALT-68 SC (165 GAL)** 

#### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


		52013 Aug20	14 Jul2015 Dec2016	Jun2018 Jan2020 Jun2021 F	eb2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0006640	USP0005625	USP0001187
Sample Date		Client Info		27 Apr 2024	23 Jan 2024	15 Oct 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	0	0	0
Chromium	ppm	ASTM D5185m	>2	0	0	0
Nickel	ppm	ASTM D5185m		0	0	<1
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	0	0	0
Lead	ppm	ASTM D5185m	>2	0	0	<1
Copper	ppm	ASTM D5185m	>8	0	0	0
Tin	ppm	ASTM D5185m	>4	0	<1	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	0
Magnesium	ppm	ASTM D5185m		0	<1	0
Calcium	ppm	ASTM D5185m		0	0	0
Phosphorus	ppm	ASTM D5185m		0	0	0
Zinc	ppm	ASTM D5185m		0	0	<1
Sulfur	ppm	ASTM D5185m	50	<1	3	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1	2	1
Sodium	ppm	ASTM D5185m		1	<1	0
Potassium	ppm	ASTM D5185m	>20	0	0	<1
Water	%	ASTM D6304	>0.01	0.003	0.006	0.005
ppm Water	ppm	ASTM D6304	>100	32	60	53.2
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	494	950	540
Particles >6µm		ASTM D7647	>2500	75	241	148
Particles >14μm		ASTM D7647	>320	5	24	13
Particles >21µm		ASTM D7647	>80	2	8	3
Particles >38μm		ASTM D7647	>20	0	1	0
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	16/13/10	17/15/12	16/14/11
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.015	0.014	0.014





## **OIL ANALYSIS REPORT**




Ok - G	10ππαι - 4μ 6μ	m m					
8k +		ım .					
6k+	1				^		
4k							
2k		A			1		
	1 34	MA	A	M	1	~	1
Ok	W . N						








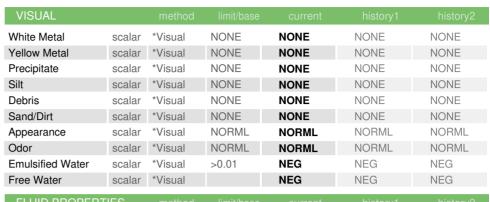

FLUID PROPER	THES	method	ilmit/base		nistory i	nistory2
Visc @ 40°C	cSt	ASTM D445	65.6	66.1	66.7	66.2

SAMPLE IMAGES	method			
			Nr.	



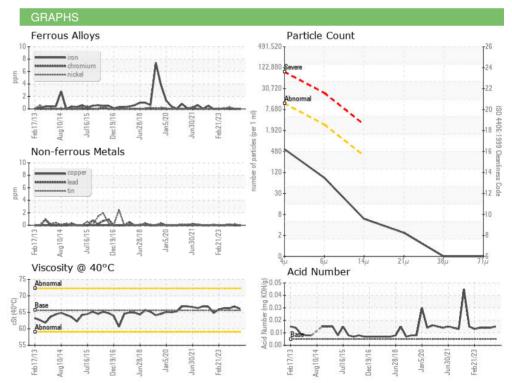





Certificate 12367

Report Id: TYSPBFP [WUSCAR] 06161536 (Generated: 05/04/2024 05:36:13) Rev: 1

Laboratory Sample No.

Lab Number : 06161536 Unique Number : 10996959

: USP0006640

Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 26 Apr 2024

**Tested** : 30 Apr 2024 Diagnosed : 30 Apr 2024 - Jonathan Hester

PINE BLUFF, AR US 71602

Contact: RICHARD RICKELS

**TYSON FP-PINE BLUFF-USP** 

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: