



# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**



Machine Id  
**MOTOR END 7630**  
 Component  
**Compressor**  
 Fluid  
**{not provided} (--- GAL)**

## DIAGNOSIS

**Recommendation**  
 Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 There is no indication of any contamination in the oil.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>RP0036541</b>	---	---
Sample Date	Client Info		<b>30 Apr 2024</b>	---	---
Machine Age	hrs	Client Info	<b>0</b>	---	---
Oil Age	hrs	Client Info	<b>0</b>	---	---
Oil Changed	Client Info		<b>N/A</b>	---	---
Sample Status			<b>NORMAL</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>6</b>	---	---
Chromium	ppm	ASTM D5185m >10	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Silver	ppm	ASTM D5185m	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >25	<b>0</b>	---	---
Lead	ppm	ASTM D5185m >25	<b>0</b>	---	---
Copper	ppm	ASTM D5185m >50	<b>0</b>	---	---
Tin	ppm	ASTM D5185m >15	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	---	---
Barium	ppm	ASTM D5185m	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Magnesium	ppm	ASTM D5185m	<b>0</b>	---	---
Calcium	ppm	ASTM D5185m	<b>0</b>	---	---
Phosphorus	ppm	ASTM D5185m	<b>3</b>	---	---
Zinc	ppm	ASTM D5185m	<b>0</b>	---	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>7</b>	---	---
Sodium	ppm	ASTM D5185m	<b>1</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>0</b>	---	---
Water	%	ASTM D6304 >0.1	<b>0.005</b>	---	---
ppm Water	ppm	ASTM D6304 >1000	<b>53</b>	---	---




## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.065</b>	---	---

## VISUAL

	method	limit/base	current	history1	history2
White Metal	scalar	*Visual NONE	<b>NONE</b>	---	---
Yellow Metal	scalar	*Visual NONE	<b>NONE</b>	---	---
Precipitate	scalar	*Visual NONE	<b>NONE</b>	---	---
Silt	scalar	*Visual NONE	<b>NONE</b>	---	---
Debris	scalar	*Visual NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar	*Visual NONE	<b>NONE</b>	---	---
Appearance	scalar	*Visual NORML	<b>NORML</b>	---	---
Odor	scalar	*Visual NORML	<b>NORML</b>	---	---
Emulsified Water	scalar	*Visual >0.1	<b>NEG</b>	---	---
Free Water	scalar	*Visual	<b>NEG</b>	---	---

# OIL ANALYSIS REPORT


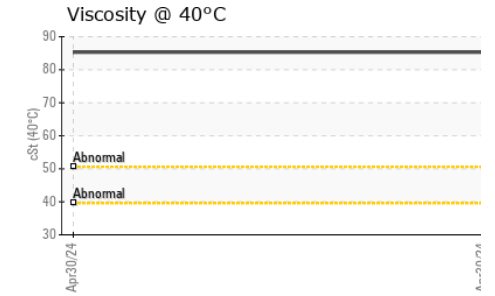
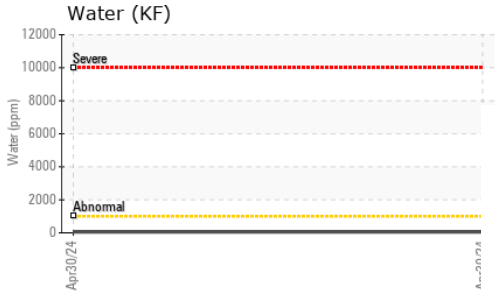
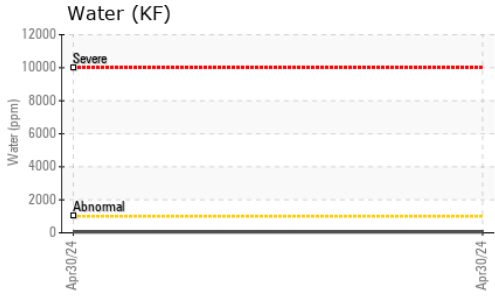


FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445		<b>85.3</b>	---	---

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

Color					no image	no image
Bottom					no image	no image

## GRAPHS

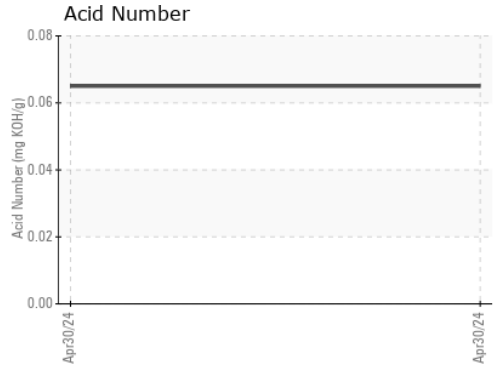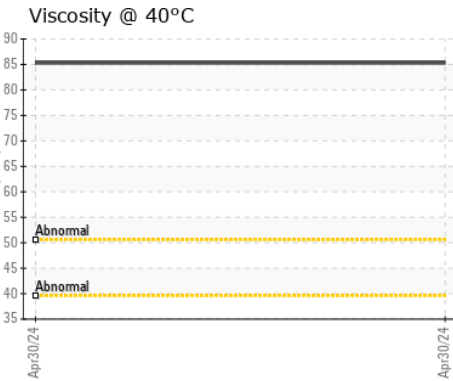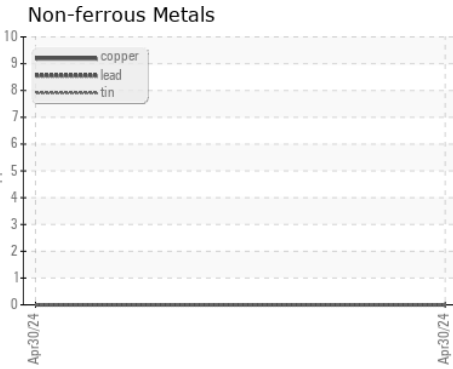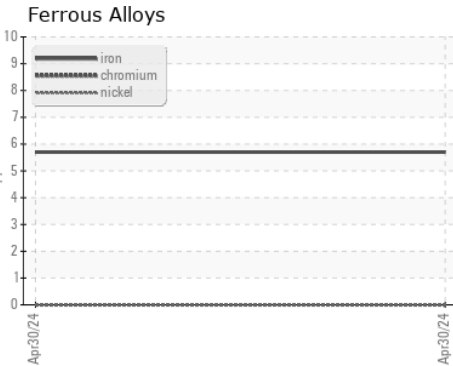

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0036541  
**Lab Number** : **06161593**  
**Unique Number** : 10997016  
**Test Package** : IND 2

**Received** : 26 Apr 2024  
**Tested** : 01 May 2024  
**Diagnosed** : 04 May 2024 - Don Baldrige

**ENERGY TRANSFER - BAYTOWN**  
 6623 FM 1942  
 BAYTOWN, TX  
 US 77521  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: