


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id

MOTOR END 7620

Component Compressor

{not provided} (--- GAL)

Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		<u>, </u>		Apr2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		RP0036539		
Sample Date		Client Info		30 Apr 2024		
Machine Age	hrs	Client Info		0 Apr 2024		
Oil Age	hrs	Client Info		0		
Oil Changed	1110	Client Info		Changed		
Sample Status				NORMAL		
·						
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	5		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	0		
Lead	ppm	ASTM D5185m	>25	0		
Copper	ppm	ASTM D5185m	>50	0		
Tin	ppm	ASTM D5185m	>15	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		4		
Zinc	ppm	ASTM D5185m		0		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon		ASTM D5185m	>25	3		
Sodium	ppm	ASTM D5185m	>25	<1		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D5103111		0.005		
ppm Water	ppm	ASTM D6304	>1000	57		
FLUID DEGRADA	• •	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	IIIIII/base	0.061		
VISUAL	ing Norting		limit/bass			history?
	00-1	method *\/iousl	limit/base	current NONE	history1	history2
White Metal	scalar	*Visual				
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.1	NEG	an: Sorvice Mar	 Dagor ENERAV
Free Water	scalar	*Visual		NEG	JII. QEIVICE IVIAI	nagerENEBAY



OIL ANALYSIS REPORT

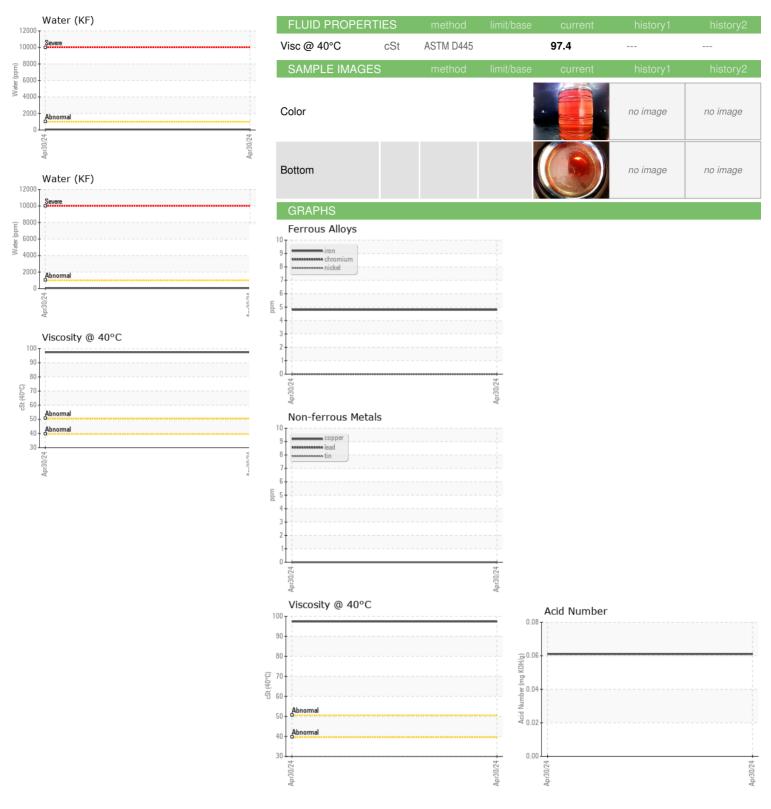



Certificate 12367

Laboratory

Sample No. : RP0036539 Lab Number : 06161594 Unique Number : 10997017

Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 26 Apr 2024 **Tested**

: 02 May 2024 Diagnosed : 04 May 2024 - Don Baldridge **ENERGY TRANSFER - BAYTOWN**

6623 FM 1942 BAYTOWN, TX US 77521

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: