


OIL ANALYSIS REPORT

AIRLUBE PLUS 10 ATLAS COPCO API630742 - ORION LP BORGER TX

Component Compressor





Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06161613		
Sample Date		Client Info		03 Apr 2024		
Machine Age	hrs	Client Info		9965		
Oil Age	hrs	Client Info		2169		
Oil Changed		Client Info		Not Changd		
Sample Status				NORMAL		
CONTAMINATION	V	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>5	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>15	3		
Lead	ppm	ASTM D5185m	>65	0		
Copper	ppm	ASTM D5185m	>65	2		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0.1	0		
Barium	ppm	ASTM D5185m	0.8	0		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m	0.9	<1		
Magnesium	ppm	ASTM D5185m	0	0		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	409	176		
Zinc	ppm	ASTM D5185m	0	12		
Sulfur	ppm	ASTM D5185m	1290	135		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	0		
Sodium	ppm	ASTM D5185m		2		
Potassium	ppm	ASTM D5185m	>20	0		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2


Acid Number (AN)

mg KOH/g ASTM D8045 0.537

1.30



OIL ANALYSIS REPORT

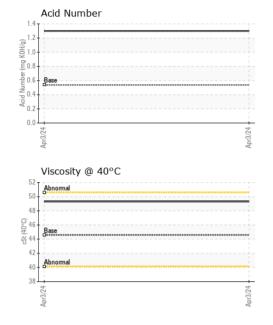


VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.1	NEG		
Free Water	scalar	*Visual		NEG		
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	44.56	49.3		


Color	no image	no image
Bottom	no image	no image

SAMPLE IMAGES



Non-ferro	us metais	
8 - cop	per	
6 - mmmm tin		
2		
0		4.
Apr3/24		Apr3/24









Certificate 12367

Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 **Sample No.** : UCH06161613 Lab Number : 06161613

Unique Number : 10997036

Received : 26 Apr 2024 **Tested** : 29 Apr 2024 Diagnosed

: 30 Apr 2024 - Angela Borella

AIR TECHNOLOGIES INC (LOU)

1302 N ENGLISH STATION RD LOUISVILLE, KY US 40223-2280

Contact: BRYAN BENJAMIN bryan.benjamin@aircompressors.com

T: (502)253-6361 F: (502)254-2523

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: UCAIRLOU [WUSCAR] 06161613 (Generated: 05/04/2024 02:31:49) Rev: 1

Contact/Location: BRYAN BENJAMIN - UCAIRLOU