




OIL ANALYSIS REPORT

Sample Rating Trend

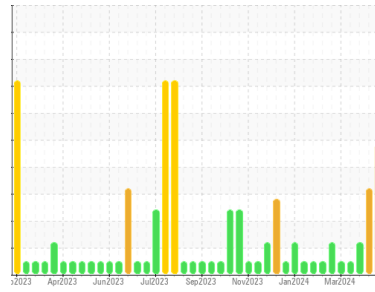

DEGRADATION



Machine Id
Grand Blanc CAT 5 GBLM05BE
 Component
Biogas Engine
 Fluid
CHEVRON HDAX 9500 GAS ENGINE OIL 40 (--- GAL)

DIAGNOSIS

▲ Recommendation

Oil and filter change at the time of sampling has been noted. We recommend an early resample to monitor this condition. (Customer Sample Comment: 950hr End of Cycle oil sample)

Wear

All component wear rates are normal.

▲ Contamination

Elemental level of silicon (Si) above normal.

▲ Fluid Condition

The BN level is low. The AN level is acceptable for this fluid.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0905702	WC0905670	WC0905696
Sample Date	Client Info		24 Apr 2024	18 Apr 2024	10 Apr 2024
Machine Age	hrs	Client Info	60188	60027	59838
Oil Age	hrs	Client Info	950	782	0
Oil Changed	Client Info		Changed	Not Changd	N/A
Sample Status			SEVERE	SEVERE	ABNORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Water	WC Method	>.11	NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >15	5	4	4
Chromium	ppm	ASTM D5185m >4	<1	<1	<1
Nickel	ppm	ASTM D5185m	0	0	1
Titanium	ppm	ASTM D5185m	<1	0	<1
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >6	3	2	2
Lead	ppm	ASTM D5185m >9	4	3	4
Copper	ppm	ASTM D5185m >6	2	3	2
Tin	ppm	ASTM D5185m >4	2	2	3
Vanadium	ppm	ASTM D5185m	0	0	<1
Cadmium	ppm	ASTM D5185m	0	0	<1

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	3	5	5
Barium	ppm	ASTM D5185m	0	1	0
Molybdenum	ppm	ASTM D5185m	3	3	4
Manganese	ppm	ASTM D5185m	<1	1	1
Magnesium	ppm	ASTM D5185m	11	15	11
Calcium	ppm	ASTM D5185m	2059	2041	1912
Phosphorus	ppm	ASTM D5185m	292	306	309
Zinc	ppm	ASTM D5185m	369	388	365
Sulfur	ppm	ASTM D5185m	3779	3894	3553

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >181	▲ 183	161	130
Sodium	ppm	ASTM D5185m >21	2	2	0
Potassium	ppm	ASTM D5185m >20	0	0	3

INFRA-RED






	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	0.1	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	6.5	6.3	6.3
Sulfation	Abs/.1mm	*ASTM D7415	27.0	25.9	24.7

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	18.7	17.6	16.7
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	2.40	2.53	▲ 2.11
Base Number (BN)	mg KOH/g	ASTM D2896 5.4	▲ 2.31	▲ 2.19	2.36











OIL ANALYSIS REPORT

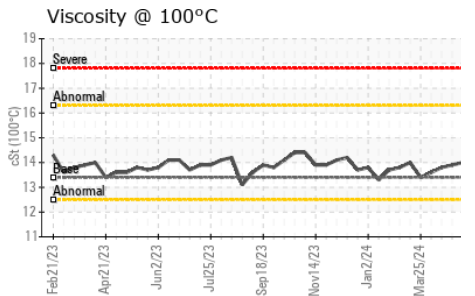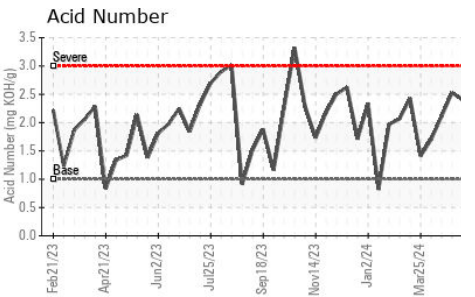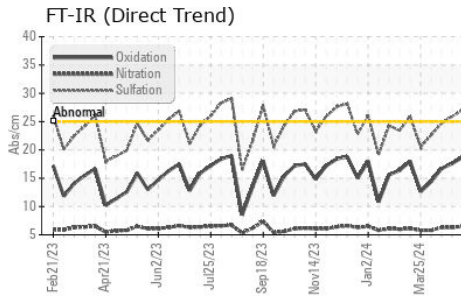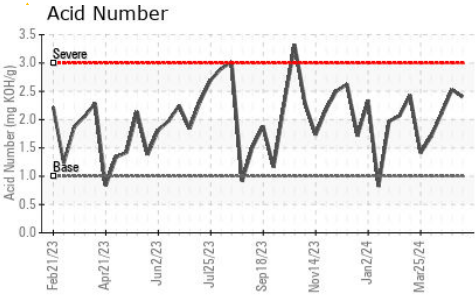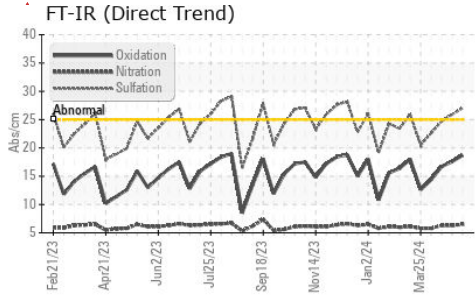

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	LIGHT	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.11	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.4	14.0	13.9

GRAPHS

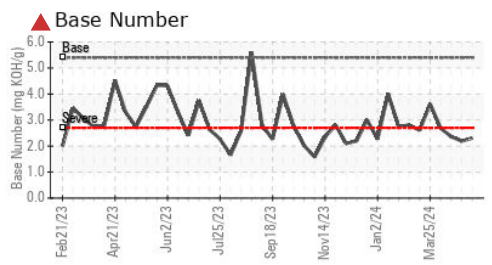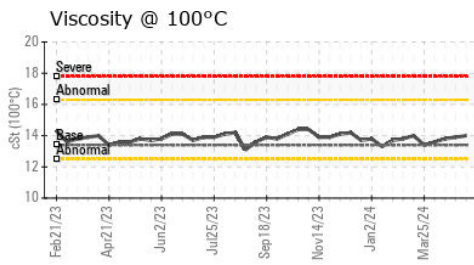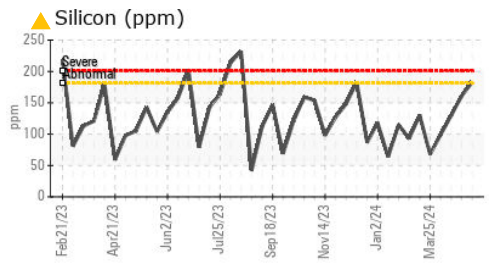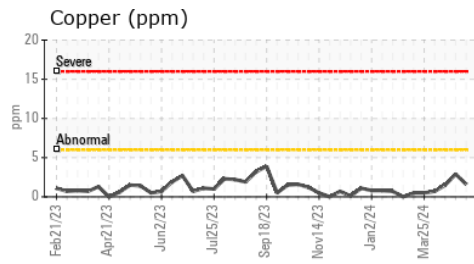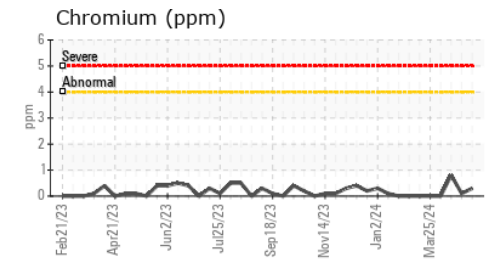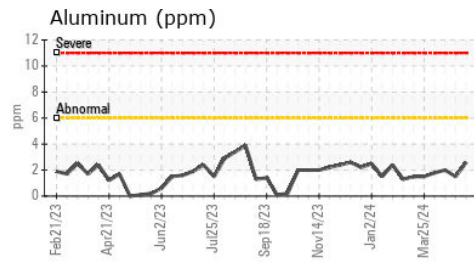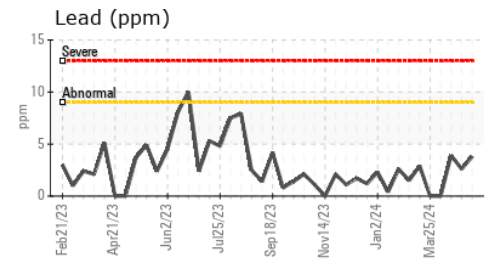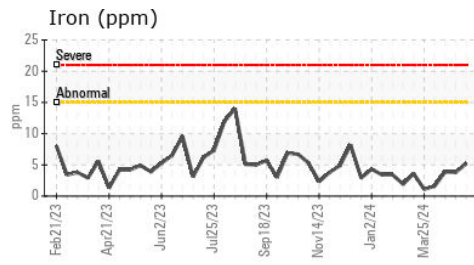

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0905702
Lab Number : 06161681
Unique Number : 10997104
Test Package : MOB 2
Received : 26 Apr 2024
Tested : 29 Apr 2024
Diagnosed : 29 Apr 2024 - Sean Felton

EDL NA Recips-Grand Blanc
 Grand Blanc Powerstation, 2361 West Grand Blanc Road
 Grand Blanc, MI
 US 48439
 Contact: Tony Saint Marie
 tony.saintmarie@edlenergy.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)