




OIL ANALYSIS REPORT

Sample Rating Trend

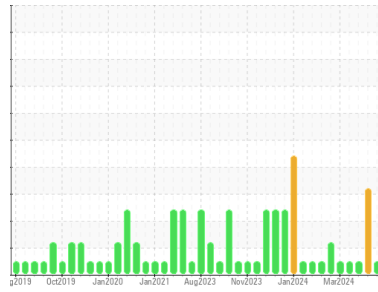

NORMAL



Area
EDLTAY
 Machine Id
TAYM03BE (S/N 1256582)
 Component
Biogas Engine
 Fluid
CHEVRON HDAX 9500 GAS ENGINE OIL 40 (180 GAL)



DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0901633	WC0901607	WC0901601
Sample Date	Client Info		25 Apr 2024	10 Apr 2024	03 Apr 2024
Machine Age	hrs	Client Info	55664	55664	55664
Oil Age	hrs	Client Info	144	545	377
Oil Changed	Client Info		Not Changed	Not Changed	Not Changed
Sample Status			NORMAL	SEVERE	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Water	WC Method		NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >14	2	2	0
Chromium	ppm	ASTM D5185m >3	<1	<1	0
Nickel	ppm	ASTM D5185m	0	<1	0
Titanium	ppm	ASTM D5185m	<1	<1	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >5	2	3	2
Lead	ppm	ASTM D5185m >6	0	2	0
Copper	ppm	ASTM D5185m >5	<1	<1	0
Tin	ppm	ASTM D5185m >6	<1	5	3
Vanadium	ppm	ASTM D5185m	0	<1	0
Cadmium	ppm	ASTM D5185m	0	<1	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<1	0
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	2	3	2
Manganese	ppm	ASTM D5185m	<1	<1	<1
Magnesium	ppm	ASTM D5185m	5	7	7
Calcium	ppm	ASTM D5185m	1913	2039	1864
Phosphorus	ppm	ASTM D5185m	260	289	257
Zinc	ppm	ASTM D5185m	313	356	326
Sulfur	ppm	ASTM D5185m	3284	4142	3380

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >180	6	13	9
Sodium	ppm	ASTM D5185m	3	4	5
Potassium	ppm	ASTM D5185m >20	2	7	4

INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844 >2	0	0	0
Nitration	Abs/cm	*ASTM D7624 >20	5.0	5.3	5.1
Sulfation	Abs/.1mm	*ASTM D7415 >30	20.1	23.3	22.5


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >15	9.1	10.9	10.2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	1.11	1.66	1.56
Base Number (BN)	mg KOH/g	ASTM D2896 5.4	2.91	▲ 2.14	2.47




OIL ANALYSIS REPORT


FT-IR (Direct Trend)

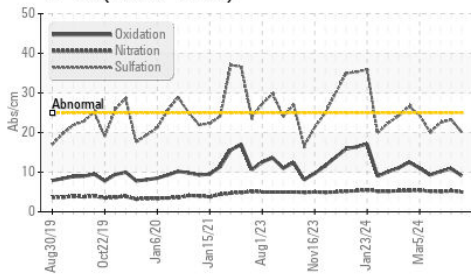


Acid Number

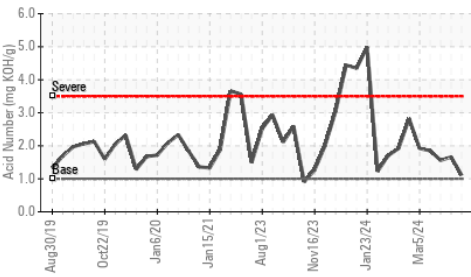

Base Number

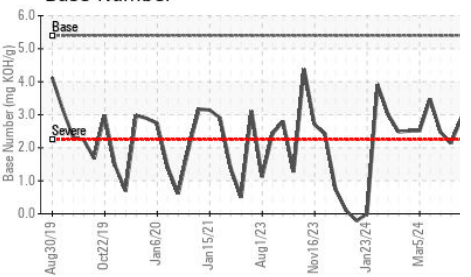

Viscosity @ 100°C

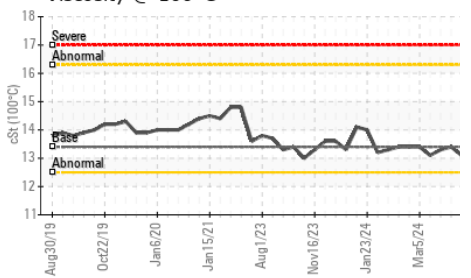


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	NEG	NEG	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.4	13.1	13.4

GRAPHS


Iron (ppm)

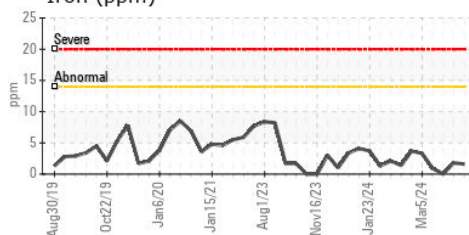


Lead (ppm)

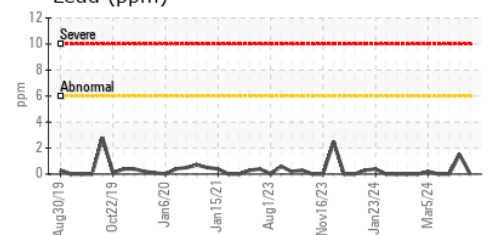


Aluminum (ppm)

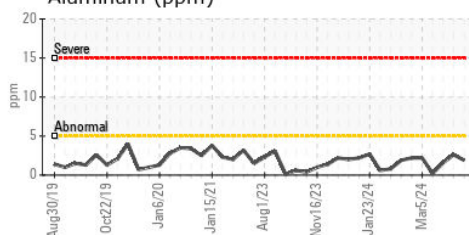


Chromium (ppm)

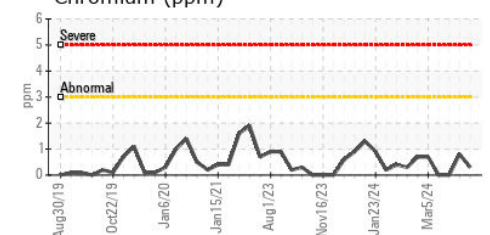


Copper (ppm)

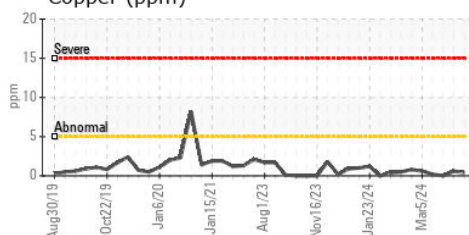


Silicon (ppm)

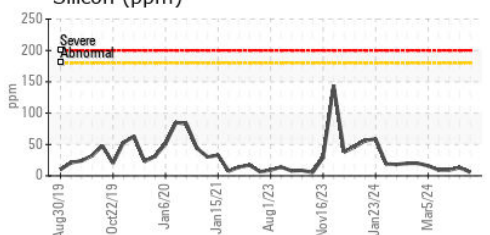

Viscosity @ 100°C

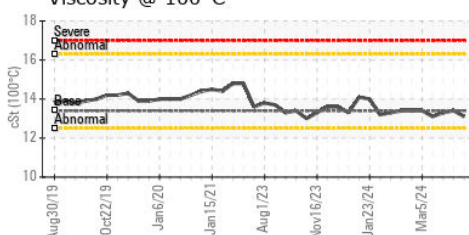

Base Number

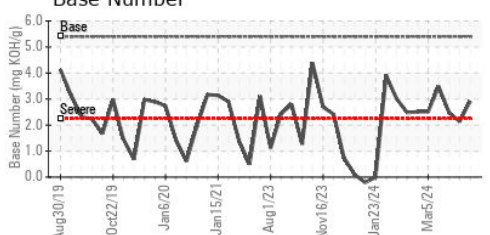

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : WC0901633
 Lab Number : 06161685
 Unique Number : 10997108
 Test Package : MOB 2
 Received : 26 Apr 2024
 Tested : 29 Apr 2024
 Diagnosed : 29 Apr 2024 - Sean Felton

EDL NA Recips-Taylor County
 TAYLOR COUNTY POWER STATION, COUNTY ROAD 33 & STEWART ROAD
 MAUK, GA
 US 31058
 Contact: STEVEN BABB
 steven.babb@edlenergy.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)