

OIL ANALYSIS REPORT

Area **ROTO XTEND [420727]** Machine Id **ATLAS COPCO ITJ295225 - GREEN & WHITE LINEN**

Component Compressor

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



Sample Rating Trend




NORMAL


SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06173961		
Sample Date		Client Info		25 Apr 2024		
Machine Age	hrs	Client Info		22790		
Oil Age	hrs	Client Info		6220		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
CONTAMINATIO	N	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>5	<1		
Nickel	ppm	ASTM D5185m		<1		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>15	<1		
Lead	ppm	ASTM D5185m	>65	<1		
Copper	ppm	ASTM D5185m	>65	<1		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		<1		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		<1		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		29		
Zinc	ppm	ASTM D5185m		62		
Sulfur	ppm	ASTM D5185m		0		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	1		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	2		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.14	0.35		



OIL ANALYSIS REPORT

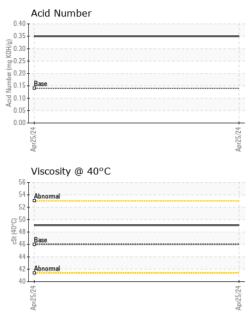

	VISUAL		method				history2	
	White Metal	scalar	*Visual	NONE	NONE			
	Yellow Metal	scalar	*Visual	NONE	NONE			
	Precipitate	scalar	*Visual	NONE	NONE			
	Silt	scalar	*Visual	NONE	NONE			
	Debris	scalar	*Visual	NONE	NONE			
4	Sand/Dirt	scalar	*Visual	NONE	NONE			
Apr25/24	Appearance	scalar	*Visual	NORML	NORML			
Ϋ́.	Odor	scalar	*Visual	NORML	NORML			
	Emulsified Water	scalar	*Visual	>0.1	NEG			
1	Free Water	scalar	*Visual		NEG			
	FLUID PROPERT	IES	method	limit/base	current	history1	history2	
	Visc @ 40°C	cSt	ASTM D445	46	49.1			
	SAMPLE IMAGES	6	method	limit/base	current	history1	history2	
Apr25/24 +	Color				A	no image	no image	
	Bottom					no image	no image	
	Non-ferrous Metal			Apr25/24				
	Viscosity @ 40°C			0401 94025/25/24 9402 Nulla 90.0 20	Acid Number			
	(50 65 53 45 45 45 45 45 45			a 0.20 M 0.10	Base			
	40 Abnormal			0.00				
	Apr25/24			Apr25/24	Apr25/24		Anr25/24	
Laboratory Sample No. Lab Number Unique Number Test Package	: 11020014	Recei Teste	ived : 09 ed : 10	ved : 09 May 2024 d : 10 May 2024 osed : 12 May 2024 - Don Baldridge			IC COMPRESSOR SYSTEMS 700 WASHINGTON AVE CARLSTADT, N US 07072 Contact: ELVIN DIA2 compressor.com;canastasio@wearcheckusa.cor T: (800)864-762	



Report Id: UCAIRCAR [WUSCAR] 06173961 (Generated: 05/12/2024 09:30:15) Rev: 1

Contact/Location: ELVIN DIAZ - UCAIRCAR

Page 2 of 2