




# OIL ANALYSIS REPORT

## Sample Rating Trend

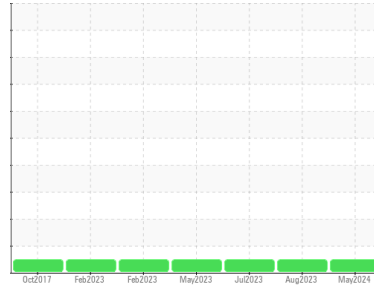

**NORMAL**



Area  
**FRAC**  
 Machine Id  
**GOULDS CHZT815P001**  
 Component  
**Pump**  
 Fluid  
**HYDRAULIC OIL FG ISO 68 (--- GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0881668</b>	WC0838603	WC0820222
Sample Date	Client Info			<b>01 May 2024</b>	02 Aug 2023	01 Jul 2023
Machine Age	mths	Client Info		<b>0</b>	0	0
Oil Age	mths	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method	>.1		<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>90	<b>&lt;1</b>	2	1
Chromium	ppm	ASTM D5185m	>5	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	>5	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>7	<b>&lt;1</b>	0	0
Lead	ppm	ASTM D5185m	>12	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m	>30	<b>&lt;1</b>	0	0
Tin	ppm	ASTM D5185m	>9	<b>&lt;1</b>	2	0
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0


ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	5	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	5	<b>0</b>	0	1
Molybdenum	ppm	ASTM D5185m	5	<b>&lt;1</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m	5	<b>&lt;1</b>	<1	<1
Calcium	ppm	ASTM D5185m	12	<b>0</b>	2	<1
Phosphorus	ppm	ASTM D5185m	400	<b>549</b>	625	623
Zinc	ppm	ASTM D5185m	12	<b>0</b>	0	<1
Sulfur	ppm	ASTM D5185m	650	<b>492</b>	651	554

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>60	<b>4</b>	1	2
Sodium	ppm	ASTM D5185m		<b>0</b>	0	0
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	0	<1

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.50	<b>0.43</b>	0.54	0.56




# OIL ANALYSIS REPORT

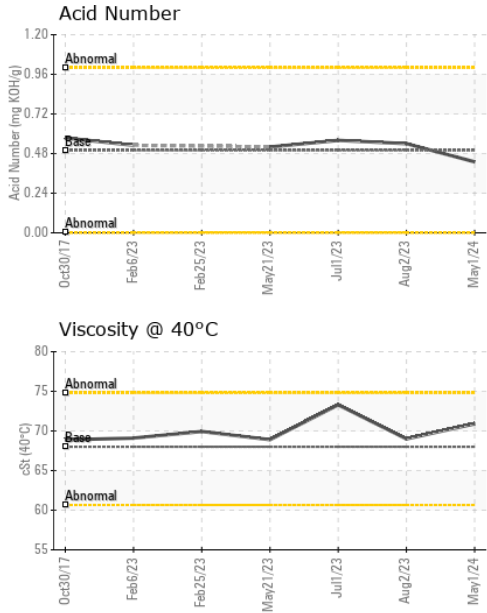





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 68	<b>70.9</b>	69.0	73.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

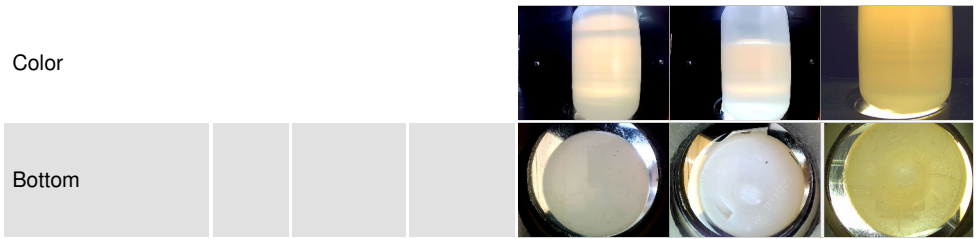

## GRAPHS

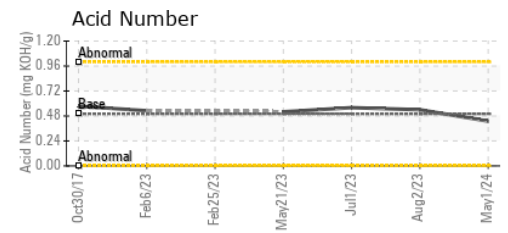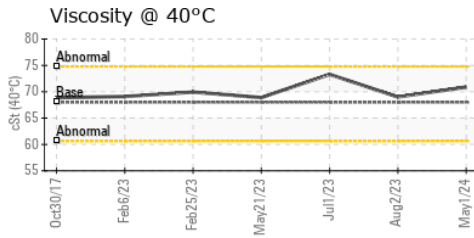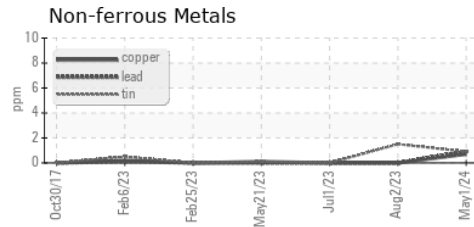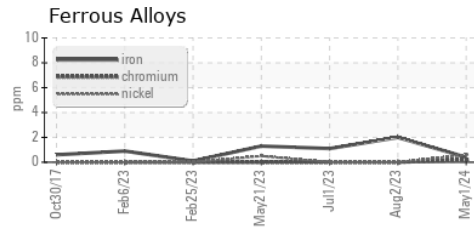

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0881668      **Received** : 09 May 2024  
**Lab Number** : **06173994**      **Tested** : 10 May 2024  
**Unique Number** : 11020047      **Diagnosed** : 12 May 2024 - Don Baldrige  
**Test Package** : IND 2

**TAKEDA**  
 305-505 BAXALTA PARKWAY  
 SOCIAL CIRCLE, GA  
 US 30025  
 Contact: BRANDON INMAN  
 BRANDON.INMAN@SHIRE.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)