



# OIL ANALYSIS REPORT

## Sample Rating Trend



**NORMAL**



Machine Id  
**UNI-SYN-68B**  
 Component  
**New (Unused) Oil**  
 Fluid  
**{not provided} (--- GAL)**

### DIAGNOSIS

#### Recommendation

This is a baseline read-out on the submitted sample.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0914338</b>	---	---
Sample Date	Client Info			<b>06 May 2024</b>	---	---
Machine Age	hrs	Client Info		<b>0</b>	---	---
Oil Age	hrs	Client Info		<b>0</b>	---	---
Oil Changed	Client Info			<b>N/A</b>	---	---
Sample Status				<b>NORMAL</b>	---	---

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method			<b>NEG</b>	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>5	<b>0</b>	---	---
Chromium	ppm	ASTM D5185m	>5	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m	>5	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m		<b>0</b>	---	---
Silver	ppm	ASTM D5185m	>5	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>5	<b>0</b>	---	---
Lead	ppm	ASTM D5185m	>5	<b>0</b>	---	---
Copper	ppm	ASTM D5185m	>5	<b>0</b>	---	---
Tin	ppm	ASTM D5185m	>5	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	---	---




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	---	---
Barium	ppm	ASTM D5185m		<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	---	---
Manganese	ppm	ASTM D5185m		<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m		<b>0</b>	---	---
Calcium	ppm	ASTM D5185m		<b>13</b>	---	---
Phosphorus	ppm	ASTM D5185m		<b>7</b>	---	---
Zinc	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Sulfur	ppm	ASTM D5185m		<b>141</b>	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>136</b>	---	---
Sodium	ppm	ASTM D5185m		<b>0</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.42</b>	---	---



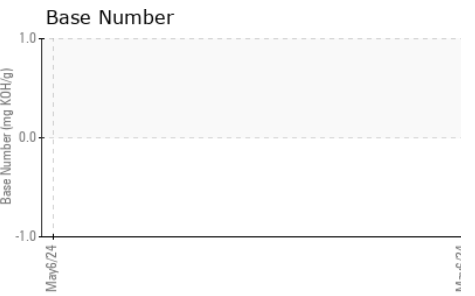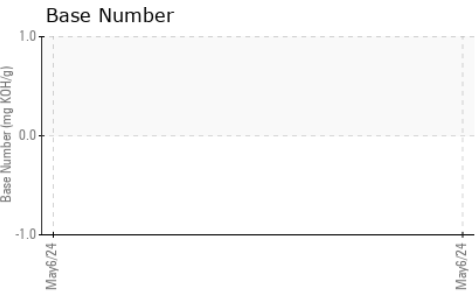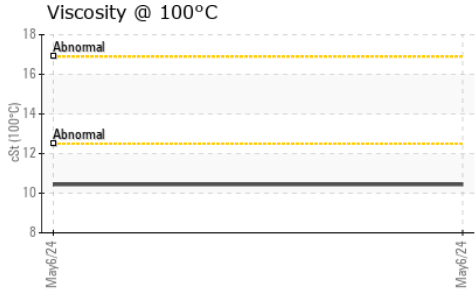

# OIL ANALYSIS REPORT






VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual		NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	65.66	---	---
Visc @ 100°C	cSt	ASTM D445	10.44	---	---
Viscosity Index (VI)	Scale	ASTM D2270	147	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

## GRAPHS

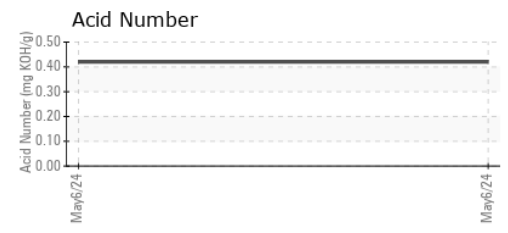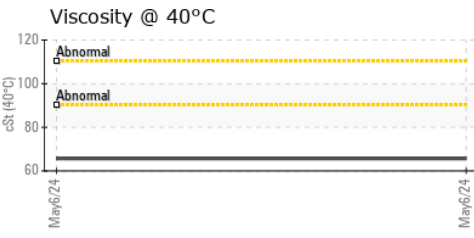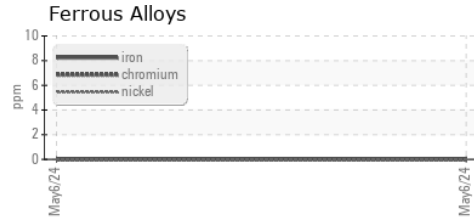

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0914338      **Received** : 09 May 2024  
**Lab Number** : 06174528      **Tested** : 14 May 2024  
**Unique Number** : 11020581      **Diagnosed** : 14 May 2024 - Doug Bogart  
**Test Package** : MOB 2 ( Additional Tests: FT-IR, KV100, PrtCount, TBN, VI )

**CUBE DISTRICT ENERGY**  
 1000 WINDWARD CONCOURSE SUITE 150  
 ALPHARETTA, GA  
 US 30005  
 Contact: ED LEWIS  
 ed.lewis@cubedistrictenergy.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)