




OIL ANALYSIS REPORT

Sample Rating Trend

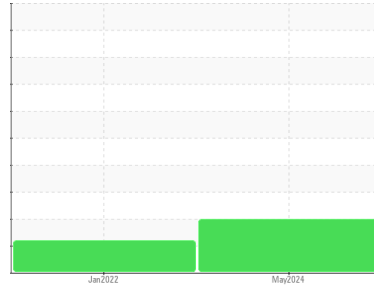

ISO



Machine Id
6065888 (S/N 1012)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA012468	KCP35074	---
Sample Date	Client Info			06 May 2024	27 Jan 2022	---
Machine Age	hrs	Client Info		0	22949	---
Oil Age	hrs	Client Info		0	2500	---
Oil Changed	Client Info			Changed	Changed	---
Sample Status				ABNORMAL	ABNORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	---
Chromium	ppm	ASTM D5185m	>10	0	0	---
Nickel	ppm	ASTM D5185m	>3	0	0	---
Titanium	ppm	ASTM D5185m	>3	0	0	---
Silver	ppm	ASTM D5185m	>2	0	0	---
Aluminum	ppm	ASTM D5185m	>10	0	2	---
Lead	ppm	ASTM D5185m	>10	0	<1	---
Copper	ppm	ASTM D5185m	>50	4	8	---
Tin	ppm	ASTM D5185m	>10	0	<1	---
Antimony	ppm	ASTM D5185m		---	4	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	<1	---
Barium	ppm	ASTM D5185m	90	29	0	---
Molybdenum	ppm	ASTM D5185m	0	0	0	---
Manganese	ppm	ASTM D5185m		<1	0	---
Magnesium	ppm	ASTM D5185m	100	41	4	---
Calcium	ppm	ASTM D5185m	0	<1	0	---
Phosphorus	ppm	ASTM D5185m	0	0	14	---
Zinc	ppm	ASTM D5185m	0	12	6	---
Sulfur	ppm	ASTM D5185m	23500	20735	17199	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	3	---
Sodium	ppm	ASTM D5185m		10	<1	---
Potassium	ppm	ASTM D5185m	>20	5	0	---
Water	%	ASTM D6304	>0.05	0.011	0.005	---
ppm Water	ppm	ASTM D6304	>500	117	53.0	---


FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		74752	23551	---
Particles >6µm		ASTM D7647	>1300	▲ 22166	▲ 8560	---
Particles >14µm		ASTM D7647	>80	▲ 1191	▲ 504	---
Particles >21µm		ASTM D7647	>20	▲ 210	▲ 61	---
Particles >38µm		ASTM D7647	>4	▲ 7	4	---
Particles >71µm		ASTM D7647	>3	0	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 23/22/17	▲ 20/16	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
-------------------	--	--------	------------	---------	----------	----------

Acid Number (AN) mg KOH/g ASTM D8045 1.0 **0.766** 0.37 ---

OIL ANALYSIS REPORT


▲ Particle Trend

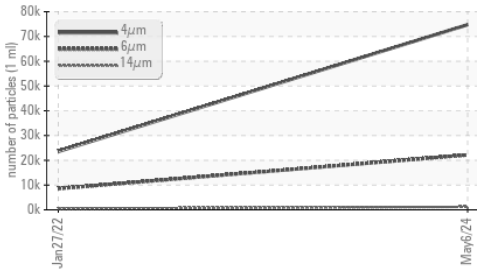

Water (KF)



Acid Number

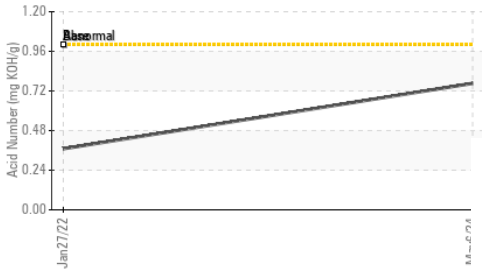

Water (KF)



Viscosity @ 40°C




VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	44.8	49.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color

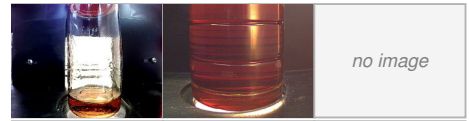

no image

Bottom




no image

GRAPHS


Ferrous Alloys




Non-ferrous Metals

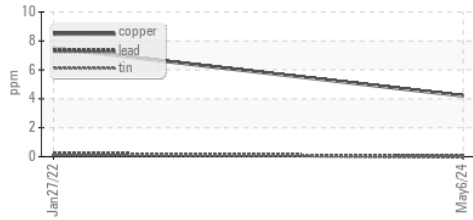


Viscosity @ 40°C

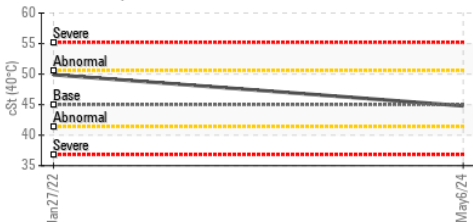

▲ Particle Count

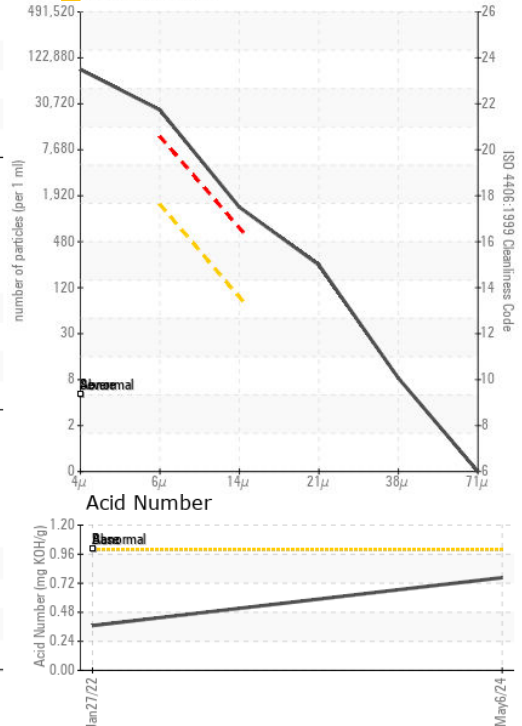

Acid Number

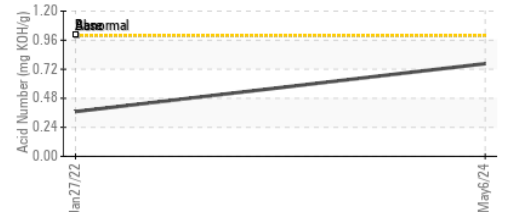

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : KCPA012468

Lab Number : 06174631

Unique Number : 11020684

Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Received : 09 May 2024

Tested : 13 May 2024

Diagnosed : 13 May 2024 - Don Baldrige

ID TECHNOLOGY

3140 S NORTH POINTE DR

FRESNO, CA

US 93725

Contact: JOSH NEWMAN

joshnewman@promachbuilt.com

T:

F: