




# OIL ANALYSIS REPORT

## Sample Rating Trend

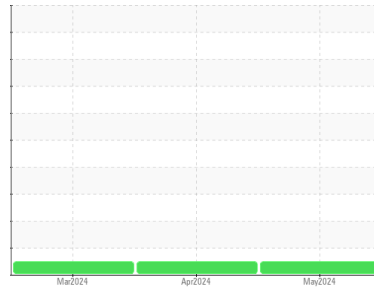

**NORMAL**



Area  
**QUANTUM**  
 Machine Id  
**4205**  
 Component  
**Biogas Engine**  
 Fluid  
**LO-ASH ENGINE OIL SAE 40 (115 GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

#### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>AO0000399</b>	AO0000396	AO0000395
Sample Date	Client Info			<b>07 May 2024</b>	05 Apr 2024	04 Mar 2024
Machine Age	hrs	Client Info		<b>39309</b>	38651	37652
Oil Age	hrs	Client Info		<b>6086</b>	38651	4429
Oil Changed	Client Info			<b>Filtered</b>	Filtered	Filtered
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>4.0		<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method	>0.1		<b>NEG</b>	NEG	NEG
Glycol	WC Method			<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>45	<b>&lt;1</b>	3	0
Chromium	ppm	ASTM D5185m	>2	<b>0</b>	<1	0
Nickel	ppm	ASTM D5185m	>2	<b>0</b>	<1	<1
Titanium	ppm	ASTM D5185m		<b>0</b>	<1	0
Silver	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>1</b>	2	2
Lead	ppm	ASTM D5185m	>5	<b>&lt;1</b>	1	<1
Copper	ppm	ASTM D5185m	>14	<b>0</b>	<1	0
Tin	ppm	ASTM D5185m	>13	<b>0</b>	<1	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	<1	0




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	37	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	12	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	200	<b>2</b>	4	<1
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m	5	<b>23</b>	16	9
Calcium	ppm	ASTM D5185m	1600	<b>1335</b>	1351	1253
Phosphorus	ppm	ASTM D5185m	300	<b>300</b>	301	282
Zinc	ppm	ASTM D5185m	400	<b>367</b>	379	354
Sulfur	ppm	ASTM D5185m	2600	<b>3308</b>	3008	2537

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>200	<b>1</b>	2	1
Sodium	ppm	ASTM D5185m		<b>1</b>	0	1
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	1	2

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		<b>0</b>	0	0
Nitration	Abs/cm	*ASTM D7624	>20	<b>4.9</b>	5.0	4.8
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>15.2</b>	15.3	15.2

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>8.7</b>	9.0	9.3
Base Number (BN)	mg KOH/g	ASTM D2896	3.0	<b>2.3</b>	2.8	2.2





# OIL ANALYSIS REPORT

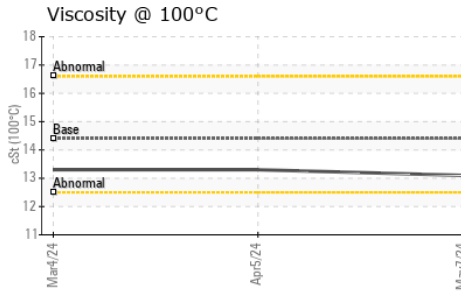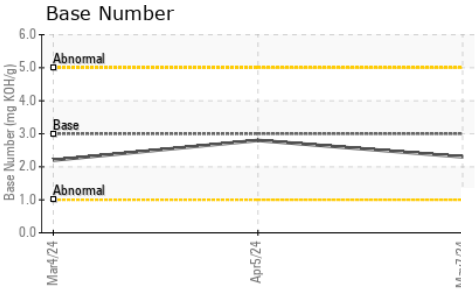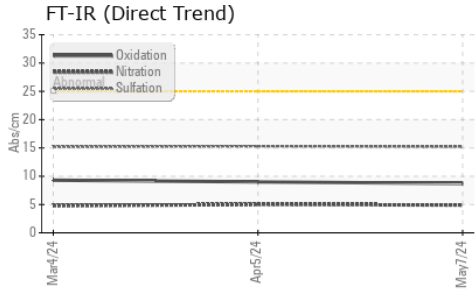

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445	14.4	<b>13.1</b>	13.3	13.3

### GRAPHS

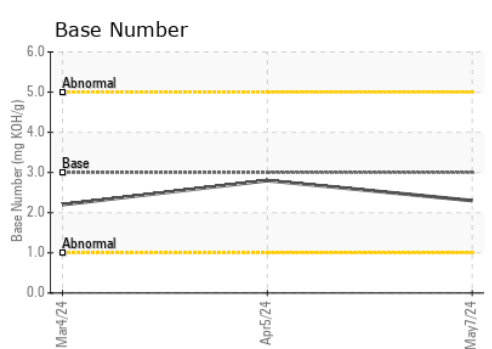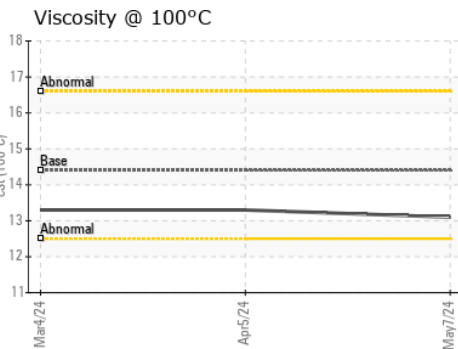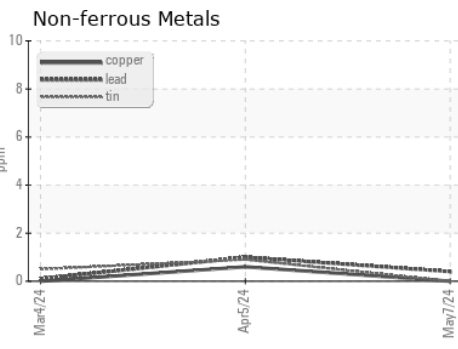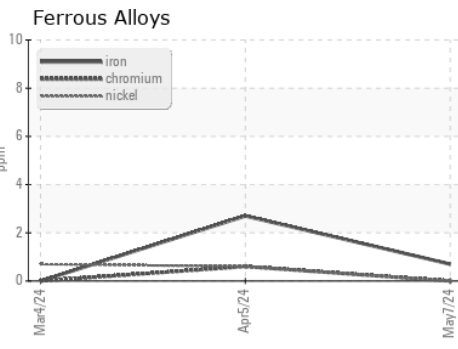

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : AO0000399 **Received** : 10 May 2024  
**Lab Number** : **06175169** **Tested** : 11 May 2024  
**Unique Number** : 11021222 **Diagnosed** : 13 May 2024 - Don Baldrige  
**Test Package** : FLEET

**MOMENTUM MIDSTREAM - LONGVIEW**  
 540 PR 2297  
 LONGVIEW, TX  
 US 75604  
 Contact: KEVIN MILLER  
 kevin.miller@momentummidstream.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)