




# OIL ANALYSIS REPORT

Sample Rating Trend

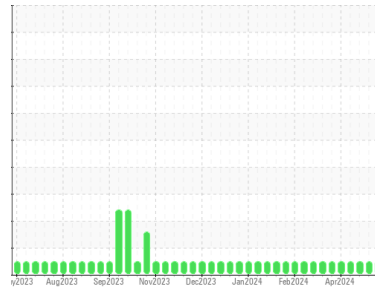

**NORMAL**



Area  
**WP 09**  
 Machine Id  
**WP09TF01 3EFF MVR**  
 Component  
**Reservoir Circulating System**  
 Fluid  
**MOBIL DTE 25 (93 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0859492</b>	WC0859501	WC0859502
Sample Date	Client Info			<b>06 May 2024</b>	29 Apr 2024	22 Apr 2024
Machine Age	days	Client Info		<b>0</b>	0	0
Oil Age	days	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method			<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m		<b>0</b>	0	0
Chromium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m		<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m		<b>2</b>	0	0
Lead	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Tin	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0





ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
Calcium	ppm	ASTM D5185m		<b>59</b>	53	45
Phosphorus	ppm	ASTM D5185m		<b>332</b>	292	280
Zinc	ppm	ASTM D5185m		<b>518</b>	451	509
Sulfur	ppm	ASTM D5185m		<b>852</b>	859	873

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Sodium	ppm	ASTM D5185m		<b>0</b>	1	<1
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	0	0

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	<b>754</b>	452	499
Particles >6µm		ASTM D7647	>1300	<b>137</b>	71	152
Particles >14µm		ASTM D7647	>160	<b>24</b>	10	11
Particles >21µm		ASTM D7647	>40	<b>6</b>	3	2
Particles >38µm		ASTM D7647	>10	<b>0</b>	0	0
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>19/17/14	<b>17/14/12</b>	16/13/10	16/14/11

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.45</b>	0.48	0.49


# OIL ANALYSIS REPORT

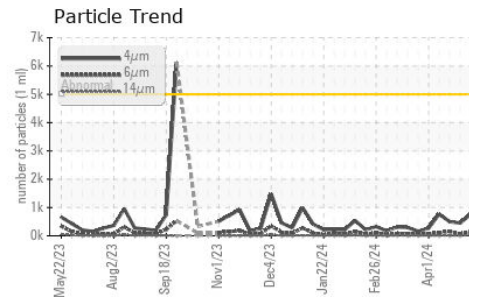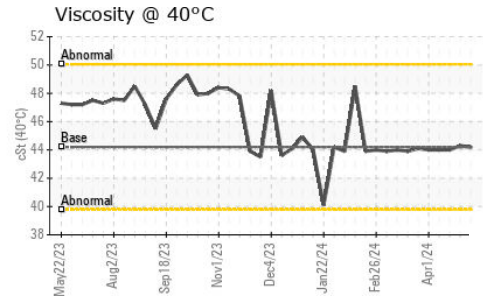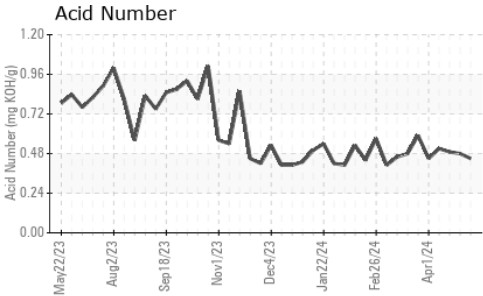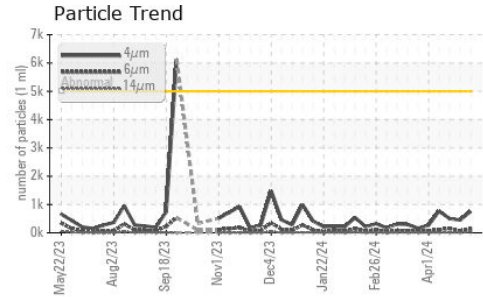






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	NEG	NEG	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	44.2	44.3	44.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

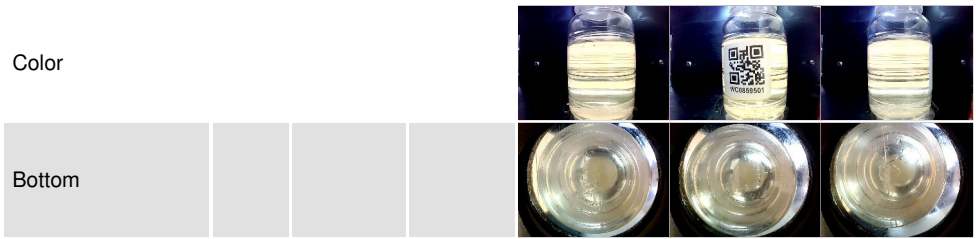

## GRAPHS

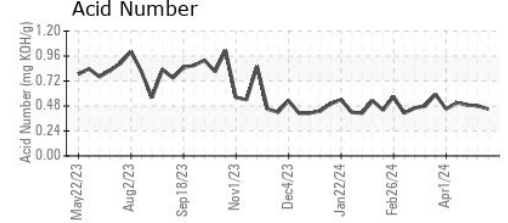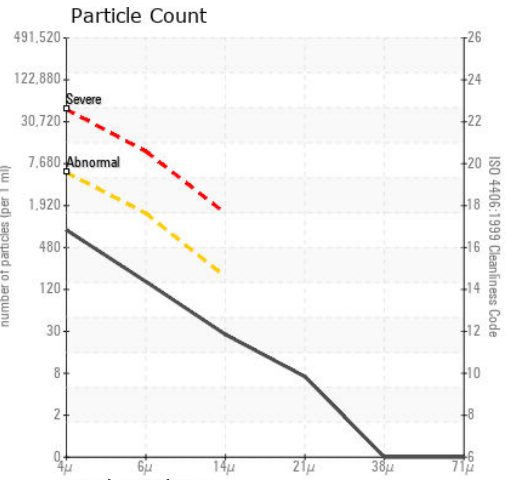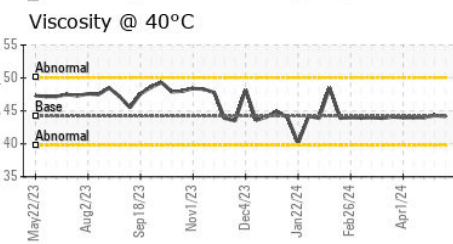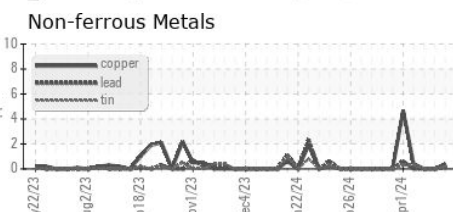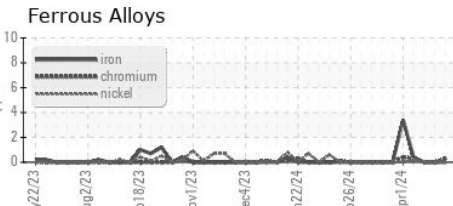

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0859492      **Received** : 10 May 2024  
**Lab Number** : 06175419      **Tested** : 13 May 2024  
**Unique Number** : 11021472      **Diagnosed** : 14 May 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: PrtCount )

**LEPRINO FOODS-ROSWELL**  
 5600 OMAHA RD  
 ROSWELL, NM  
 US 88203  
 Contact: VINCENT MCINTIRE  
 vmcintire@leprinofoods.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)