


# **OIL ANALYSIS REPORT**

Sample Rating Trend

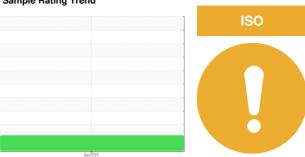

Machine Id

# **KAESER 7297596**

Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

#### Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of particulates present in the oil.


#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

				Apr2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA012519		
Sample Date		Client Info		19 Apr 2024		
Machine Age	hrs	Client Info		2640		
Oil Age	hrs	Client Info		3000		
Oil Changed		Client Info		Changed		
Sample Status				ATTENTION		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum		ASTM D5185m		4		
Lead	ppm	ASTM D5185m	>10	0		
	ppm			13		
Copper	ppm	ASTM D5185m		_		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	100	3		
Calcium	ppm	ASTM D5185m	0	<1		
Phosphorus	ppm	ASTM D5185m	0	388		
Zinc	ppm	ASTM D5185m	0	7		
Sulfur	ppm	ASTM D5185m	23500	8807		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	7		
Sodium	ppm	ASTM D5185m		3		
Potassium	ppm	ASTM D5185m	>20	4		
Water	%	ASTM D6304	>0.05	0.001		
ppm Water	ppm	ASTM D6304	>500	6		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		8901		
Particles >6µm		ASTM D7647	>1300	<b>1606</b>		
Particles >14µm		ASTM D7647	>80	94		
Particles >21µm		ASTM D7647	>20	22		
Particles >38µm		ASTM D7647	>4	1		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	20/18/14		
FLUID DEGRADA	LION -	method	limit/base		history1	history2
				current		
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.23		



## **OIL ANALYSIS REPORT**

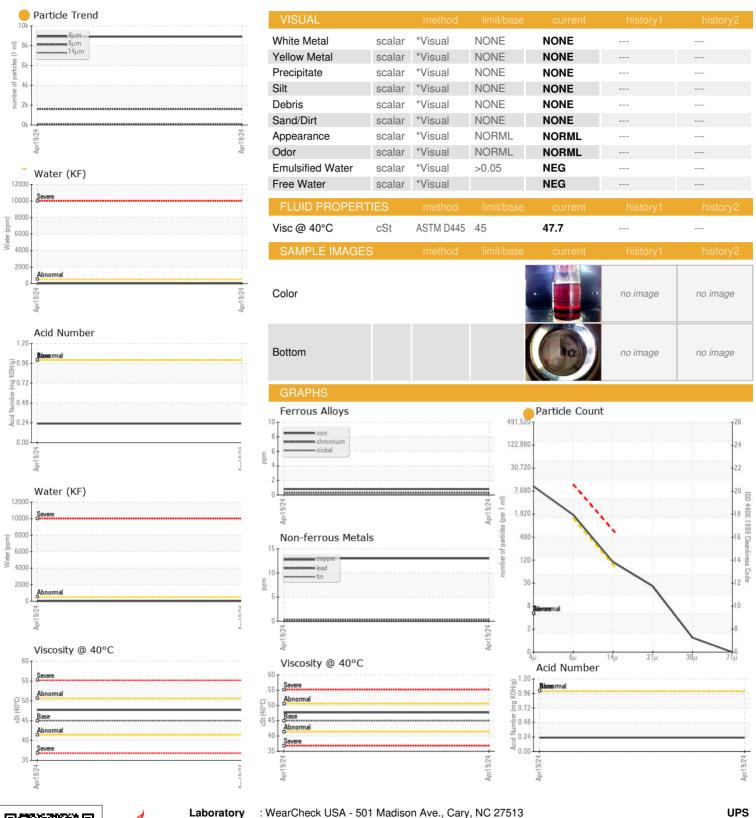



Certificate 12367

Laboratory Sample No.

: KCPA012519 Lab Number : 06175476 Unique Number : 11021529

Received **Tested** Diagnosed

: 10 May 2024 : 14 May 2024 : 14 May 2024 - Angela Borella Test Package : IND 2 ( Additional Tests: KF, PrtCount )

20801 KRAMERIA AVE RIVERSIDE, CA US 92518 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: UPSRIV [WUSCAR] 06175476 (Generated: 05/14/2024 13:55:56) Rev: 1

Contact/Location: Service Manager - UPSRIV

T:

F: