


OIL ANALYSIS REPORT

Sample Rating Trend

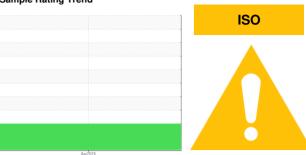

Machine Id

5507440 (S/N 1068)

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

				Apr2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA016364		
Sample Number		Client Info		18 Apr 2024		
Machine Age	hrs	Client Info		0 Apr 2024		
Oil Age	hrs	Client Info		0		
Oil Changed	1113	Client Info		Changed		
Sample Status		Ciletit IIIIO		ABNORMAL		
-				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	2		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	10		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	90	1		
Calcium	ppm	ASTM D5185m	2	<1		
Phosphorus	ppm	ASTM D5185m		<1		
Zinc	ppm	ASTM D5185m		32		
Sulfur	ppm	ASTM D5185m		20809		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	2		
Water	%	ASTM D6304	>0.05	0.010		
ppm Water	ppm	ASTM D6304	>500	102		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		4879		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14µm		ASTM D7647	>80	<u></u> 510		
Particles >21µm		ASTM D7647	>20	<u>^</u> 213		
Particles >38µm		ASTM D7647	>4	7		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/18/16		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
A -! -! NI I (ANI)	1/011/	4 OT1 4 D00 45	0.4	0.505		


Acid Number (AN)

mg KOH/g ASTM D8045 0.4

0.525



OIL ANALYSIS REPORT

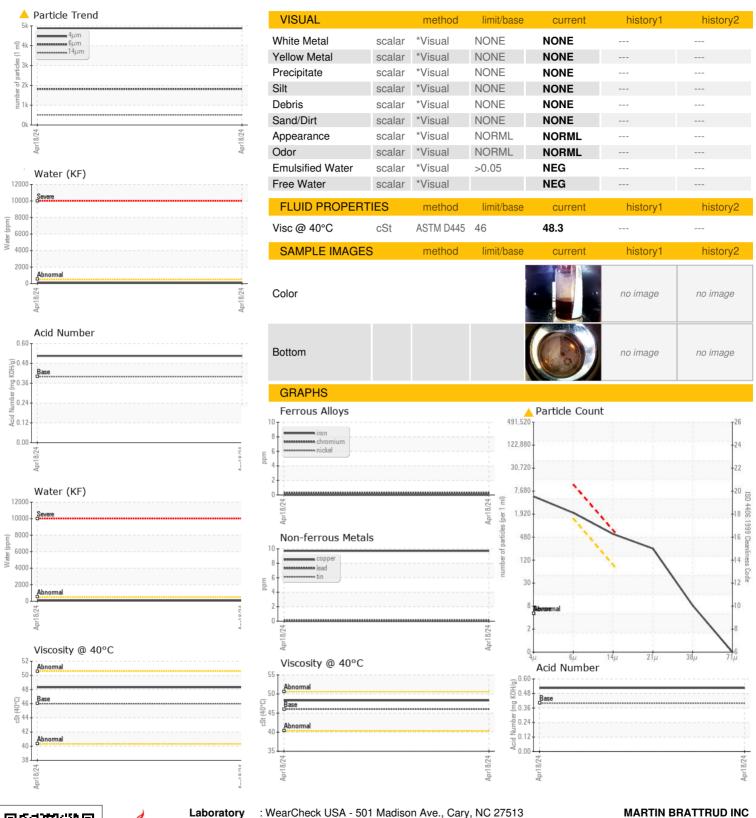





Certificate 12367

Laboratory Sample No.

: KCPA016364 Lab Number : 06175487 Unique Number : 11021540

Received : 10 May 2024 **Tested** : 14 May 2024 Diagnosed : 14 May 2024 - Angela Borella

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369. st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. **MARTIN BRATTRUD INC**

1224 W 132ND ST GARDENA, CA US 90247

Contact: Service Manager

T:

F: