

# **OIL ANALYSIS REPORT**

Sample Rating Trend



**NORMAL** 



Machine Id

# 6498941 (S/N 1014)

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

#### Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

#### Contamination

The amount and size of particulates present in the system are acceptable.


#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

		Dec202	) Apr2023	Nov2023 Ap	r2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA013305	KCPA007313	KCPA001400
Sample Date		Client Info		30 Apr 2024	10 Nov 2023	11 Apr 2023
Machine Age	hrs	Client Info		36676	33778	30531
Oil Age	hrs	Client Info		6145	0	0
Oil Changed		Client Info		Changed	N/A	N/A
Sample Status				NORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	<1	<1	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>10	2	0	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	6	8	13
Tin	ppm	ASTM D5185m	>10	<1	0	0
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m	90	7	16	9
Calcium	ppm	ASTM D5185m	2	<1	2	<1
Phosphorus	ppm	ASTM D5185m		0	<1	2
Zinc	ppm	ASTM D5185m		8	4	2
Sulfur	ppm	ASTM D5185m		17759	14976	17537
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	0
Sodium	ppm	ASTM D5185m		3	6	0
Potassium	ppm	ASTM D5185m	>20	2	<1	<1
Water	%	ASTM D6304	>0.05	0.005	0.010	0.010
ppm Water	ppm	ASTM D6304	>500	53	104	107.7
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1742		4881
Particles >6µm		ASTM D7647	>1300	443		1821
Particles >14µm		ASTM D7647	>80	47		<u>^</u> 235
Particles >21µm		ASTM D7647	>20	19		<b>△</b> 76
Particles >38μm		ASTM D7647	>4	1		2
Particles >71µm		ASTM D7647	>3	0		0
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/13		▲ 19/18/15
FLUID DEGRADA	TION	method	limit/base	current	history1	history2



## **OIL ANALYSIS REPORT**

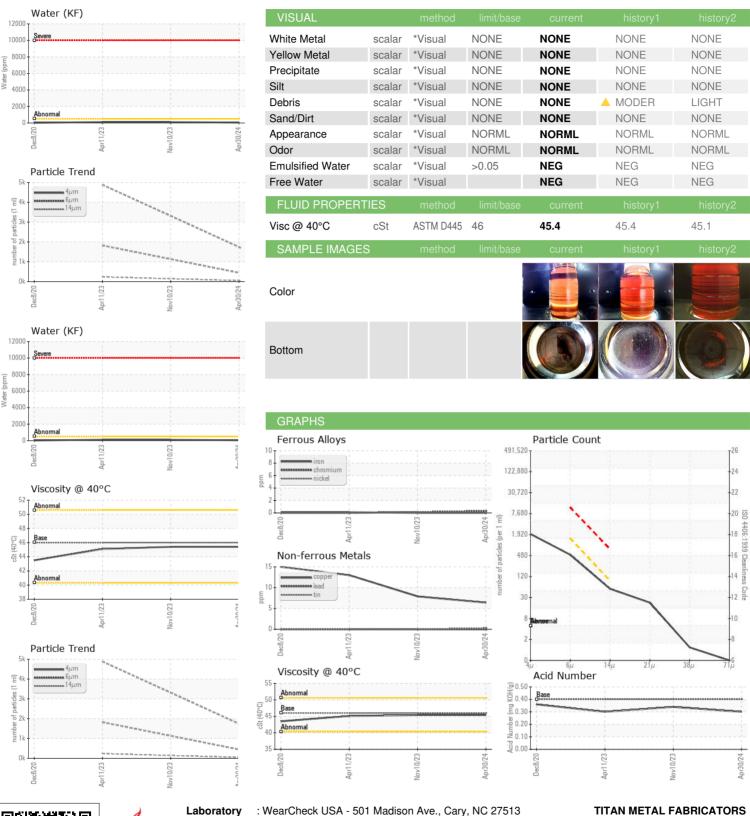





Certificate 12367

Laboratory Sample No. Lab Number

Unique Number : 11021543

: KCPA013305 : 06175490

Received **Tested** Diagnosed

: 10 May 2024 : 14 May 2024

: 14 May 2024 - Angela Borella

Test Package : IND 2 ( Additional Tests: KF, PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

352 BALBOA CIRCLE CAMARILLO, CA US 93012

Contact: Service Manager

T:

F: