




# OIL ANALYSIS REPORT

Sample Rating Trend

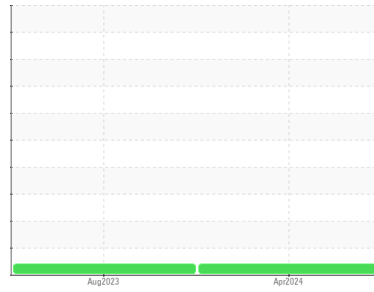

VIS DEBRIS



Machine Id

**8118689 (S/N 1235)**

Component

**Compressor**

Fluid

**KAESER SIGMA (OEM) M-460 (--- QTS)**

## DIAGNOSIS

### Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

### Wear

All component wear rates are normal.

### Contamination

Moderate concentration of visible dirt/debris present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA012514</b>	KCPA004943	---
Sample Date	Client Info		<b>26 Apr 2024</b>	08 Aug 2023	---
Machine Age	hrs	Client Info	<b>6855</b>	4604	---
Oil Age	hrs	Client Info	<b>0</b>	0	---
Oil Changed	Client Info		<b>Changed</b>	N/A	---
Sample Status			<b>ABNORMAL</b>	ABNORMAL	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	---
Chromium	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	---
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m >3	<b>&lt;1</b>	<1	---
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m >10	<b>2</b>	0	---
Lead	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	---
Copper	ppm	ASTM D5185m >50	<b>16</b>	11	---
Tin	ppm	ASTM D5185m >10	<b>&lt;1</b>	<1	---
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	<1	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	---
Barium	ppm	ASTM D5185m 90	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	---
Magnesium	ppm	ASTM D5185m 100	<b>&lt;1</b>	3	---
Calcium	ppm	ASTM D5185m 0	<b>&lt;1</b>	0	---
Phosphorus	ppm	ASTM D5185m 0	<b>&lt;1</b>	3	---
Zinc	ppm	ASTM D5185m 0	<b>&lt;1</b>	<1	---
Sulfur	ppm	ASTM D5185m 23500	<b>19863</b>	22373	---




## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>2</b>	<1	---
Sodium	ppm	ASTM D5185m	<b>0</b>	2	---
Potassium	ppm	ASTM D5185m >20	<b>1</b>	2	---
Water	%	ASTM D6304 >0.05	<b>0.027</b>	0.009	---
ppm Water	ppm	ASTM D6304 >500	<b>276</b>	90.6	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	<b>0.51</b>	0.46	---

# OIL ANALYSIS REPORT

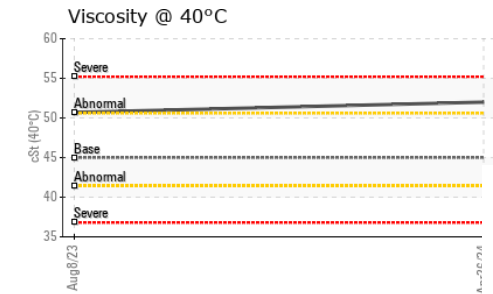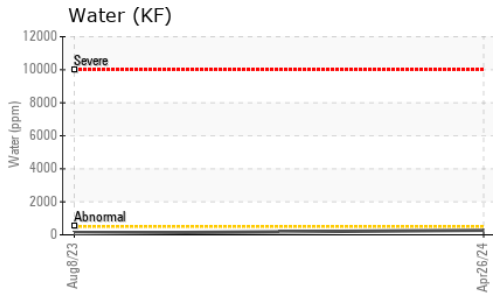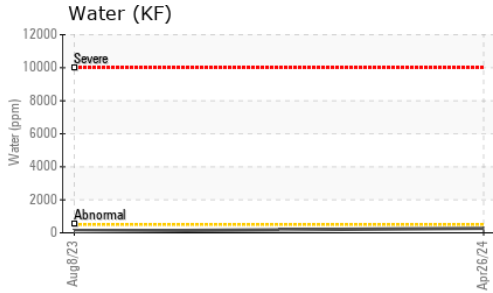





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	<b>NONE</b>	LIGHT	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Debris	scalar	*Visual	NONE	▲ <b>MODER</b>	▲ <b>HEAVY</b>	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Emulsified Water	scalar	*Visual	>0.05	<b>NEG</b>	NEG	---
Free Water	scalar	*Visual		<b>NEG</b>	NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	45	<b>52.0</b>	50.7	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color					no image
Bottom					no image

## GRAPHS

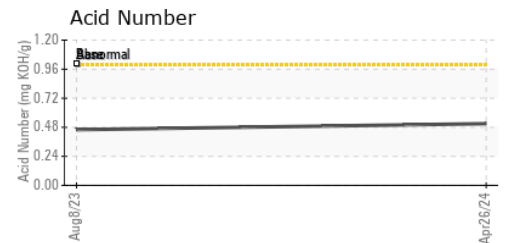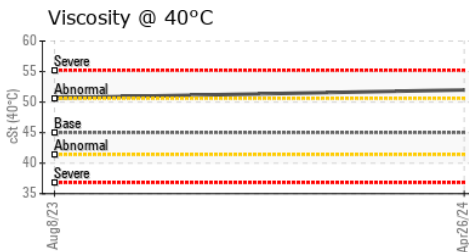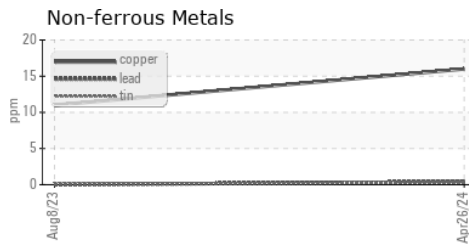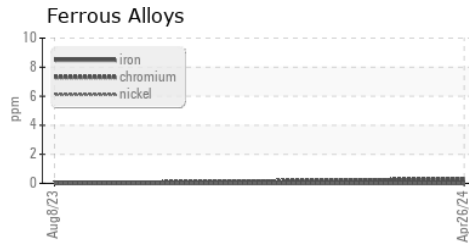

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA012514 **Received** : 10 May 2024  
**Lab Number** : 06175496 **Tested** : 14 May 2024  
**Unique Number** : 11021549 **Diagnosed** : 14 May 2024 - Angela Borella  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**MONTEBELLO CONTAINER**  
 14333 MACAW ST  
 LA MIRADA, CA  
 US 90638  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: