


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



TYSJOS 4 HHT (S/N 62910)

Refrigeration Compressor

USPI 1009-68 SC (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


		r2014 Jul20	5 Oct2016 Feb2018	Jul2019 Oct2020 Mar2022 A	hpr2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0011329	USP0005630	USP243228
Sample Date		Client Info		09 May 2024	10 Jan 2024	15 Dec 2023
Machine Age	hrs	Client Info		0	7617	7339
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	ATTENTION	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	0	0	0
Chromium	ppm	ASTM D5185m	>2	<1	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	0	0	0
Lead	ppm	ASTM D5185m	>2	0	0	0
Copper	ppm	ASTM D5185m	>8	<1	0	<1
Tin	ppm	ASTM D5185m	>4	<1	<1	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m		<1	0	<1
Calcium	ppm	ASTM D5185m		<1	1	1
Phosphorus	ppm	ASTM D5185m		<1	0	<1
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m	50	0	7	4
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	1	<1	<1
Sodium	ppm	ASTM D5185m		<1	<1	1
Potassium	ppm	ASTM D5185m	>20	<1	0	<1
Water	%	ASTM D6304	>0.01	0.003	0.009	0.005
ppm Water	ppm	ASTM D6304	>100	35	91	56
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		4004	16831	50905
Particles >6µm		ASTM D7647	>2500	546	4987	<u>▲</u> 12336
Particles >14µm		ASTM D7647	>320	12	192	315
Particles >21µm		ASTM D7647	>80	2	27	37
Particles >38μm		ASTM D7647	>20	0	1	1
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/18/15	19/16/11	21/19/15	<u>△</u> 23/21/15
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.014	0.014	0.014





OIL ANALYSIS REPORT



********	im im μm				1	I
					N	M
1		. /	1		1	ĬΛ
-			A	·	1	W 1








VISUAL		method				history2
White Metal	scalar	*Visual	NONE	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
		ام مالم مما	11 11 /1		la i a t a un urd	histom (O

FLUID PROPE	N I I E O	method			riistory i	nistory∠
Visc @ 40°C	cSt	ASTM D445	67	71.1	72.0	72.5

SAMPLE IMAGES	method		
Color			



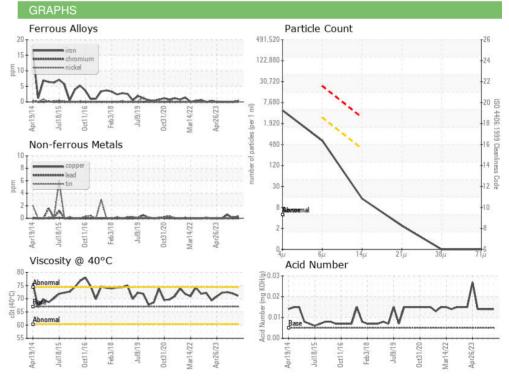





Certificate 12367

Laboratory Sample No. Unique Number : 11021589

Lab Number : 06175536

Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : USP0011329 Received

: 10 May 2024 **Tested** : 13 May 2024 Diagnosed : 13 May 2024 - Doug Bogart

TYSON - PROCESS/SLAUGHTER - MAIN PLANT 28424 38TH AVE N

JOSLIN, IL US 61257

Contact: RICK DUVALL

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (402)423-6661