

OIL ANALYSIS REPORT

NORMAL

Machine Id

MYCOM TYSHUTD 3C (S/N 3211676)

Refrigeration Compressor

USPI 1009-68 SC (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


	x011 Jun2012 Oct2013 Jun2015 Jun2017 Max2020 Sex1221 Fex7023								
SAMPLE INFORM		method	limit/base	current	history1	history?			
	ATION		IIIIII/Dase			history2			
Sample Number		Client Info		USP0011349	USP0007115 12 Feb 2024	USP0003381			
Sample Date	bro	Client Info		02 May 2024		01 Nov 2023			
Machine Age Oil Age	hrs hrs	Client Info Client Info		0	0	0			
Oil Changed	1115	Client Info		U N/A	0 N/A	0 N/A			
Sample Status		Chefit IIIIO		NORMAL	NORMAL	ABNORMAL			
WEAR METALS		method	limit/base	current	history1	history2			
			>8		0	0			
Iron Chromium	ppm	ASTM D5185m ASTM D5185m		0	0	<1			
Nickel	ppm	ASTM D5185m	>2	0	0	2			
Titanium	ppm	ASTM D5185m		0	0	2			
Silver	ppm	ASTM D5185m	>2	-	0	0			
Aluminum	ppm		>2	0	0	0			
Lead	ppm	ASTM D5185m	>3 >2	0	0	0			
	ppm	ASTM D5185m		0	0	<1			
Copper Tin	ppm	ASTM D5185m	>0 >4	0	<1	< 1			
Vanadium	ppm	ASTM D5185m	>4	0	0	<1			
Cadmium	ppm	ASTM D5185m		0	0	< 1			
	ppm		Land to the second	-	-	-			
ADDITIVES		method	limit/base	current	history1	history2			
Boron	ppm	ASTM D5185m		0	0	0			
Barium	ppm	ASTM D5185m		<1	0	0			
Molybdenum	ppm	ASTM D5185m		0	0	0			
Manganese	ppm	ASTM D5185m		0	0	0			
Magnesium	ppm	ASTM D5185m		0	0	<1			
Calcium	ppm	ASTM D5185m		0	0	1			
Phosphorus	ppm	ASTM D5185m		0	0	0			
Zinc	ppm	ASTM D5185m		0	0	0			
Sulfur	ppm	ASTM D5185m	50	0	0	0			
CONTAMINANTS		method	limit/base	current	history1	history2			
Silicon	ppm	ASTM D5185m	>15	<1	1	1			
Sodium	ppm	ASTM D5185m		1	0	0			
Potassium	ppm	ASTM D5185m	>20	<1	0	<1			
Water	%	ASTM D6304	>0.01	0.004	0.002	0.003			
ppm Water	ppm	ASTM D6304	>100	42	25	32.3			
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2			
Particles >4µm		ASTM D7647	>10000	375	2745	▲ 23862			
Particles >6µm		ASTM D7647	>2500	63	855	▲ 5462			
Particles >14µm		ASTM D7647	>320	5	30	93			
Particles >21µm		ASTM D7647	>80	1	2	12			
Particles >38µm		ASTM D7647	>20	1	0	0			
Particles >71µm		ASTM D7647	>4	0	0	0			
Oil Cleanliness		ISO 4406 (c)	>20/18/15	16/13/10	19/17/12	2 2/20/14			
FLUID DEGRADA		method	limit/base	current	history1	history2			
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.014	0.014	0.028			


Contact/Location: SCOTT OWEN - TYSHUTKS Page 1 of 2




OIL ANALYSIS REPORT












Certificate 12367

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	67	67.0	67.2	66.3
SAMPLE IMAGES		method	limit/base	current	history1	history2
Color						NH3. Co Prove States Control of Control of Control Control of Control of Control Control of Control of Control Control of Control of Control of Control Control of Control of Control of Control of Control Control of Control of Contr
Bottom						10

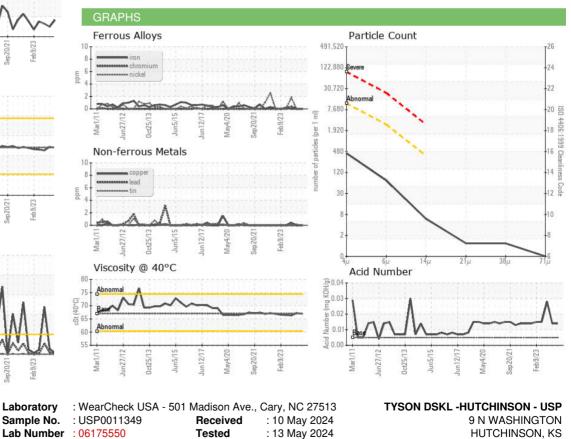

: 13 May 2024 - Doug Bogart

Diagnosed



Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) Report Id: TYSHUTKS [WUSCAR] 06175550 (Generated: 05/13/2024 12:21:41) Rev: 1

Unique Number : 11021603

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Test Package : IND 2

Contact/Location: SCOTT OWEN - TYSHUTKS

US

T:

F:

Contact: SCOTT OWEN