




OIL ANALYSIS REPORT

Sample Rating Trend

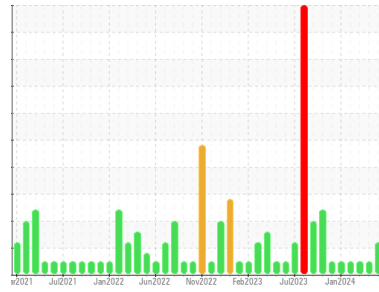

ISO



Area

MELT SHOP - HYDRAULIC

Machine Id

MELT SHOP LADLE WALL LADLE PREHEATER HYDRAULIC UNIT (S/N 15-3000-0741-0020)

Component

Tank Hydraulic System

Fluid

FIRE-RESISTANT FLUID ISO 46 (20 GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The pH level of this fluid is within the acceptable limits at 9.0. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

| method | limit/base | current | history1 | history2 |
|---------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info | RP0039062 | RP0042711 | RP0042614 |
| Sample Date | Client Info | 09 May 2024 | 28 Mar 2024 | 05 Mar 2024 |
| Machine Age | hrs | Client Info | 0 | 0 |
| Oil Age | hrs | Client Info | 0 | 0 |
| Oil Changed | Client Info | N/A | N/A | N/A |
| Sample Status | | ATTENTION | NORMAL | NORMAL |

WEAR METALS

| method | limit/base | current | history1 | history2 | |
|----------|------------|-----------------|--------------|----------|----|
| Iron | ppm | ASTM D5185m >20 | 0 | 4 | 7 |
| Chromium | ppm | ASTM D5185m >20 | 0 | 1 | 1 |
| Nickel | ppm | ASTM D5185m >20 | 0 | 1 | <1 |
| Titanium | ppm | ASTM D5185m | 0 | <1 | 0 |
| Silver | ppm | ASTM D5185m | 0 | 0 | 0 |
| Aluminum | ppm | ASTM D5185m >20 | 0 | 12 | 11 |
| Lead | ppm | ASTM D5185m >20 | 0 | 0 | 0 |
| Copper | ppm | ASTM D5185m >20 | <1 | 1 | <1 |
| Tin | ppm | ASTM D5185m >20 | 0 | 1 | 1 |
| Vanadium | ppm | ASTM D5185m | 0 | 1 | 1 |
| Cadmium | ppm | ASTM D5185m | 0 | <1 | <1 |

ADDITIVES

| method | limit/base | current | history1 | history2 | |
|------------|------------|-----------------|--------------|----------|----|
| Boron | ppm | ASTM D5185m 5 | 0 | 2 | 1 |
| Barium | ppm | ASTM D5185m 5 | 0 | 0 | <1 |
| Molybdenum | ppm | ASTM D5185m 5 | 0 | 0 | 0 |
| Manganese | ppm | ASTM D5185m | 0 | <1 | 0 |
| Magnesium | ppm | ASTM D5185m 5 | <1 | 1 | <1 |
| Calcium | ppm | ASTM D5185m 50 | 0 | 6 | 11 |
| Phosphorus | ppm | ASTM D5185m 175 | <1 | 7 | 4 |
| Zinc | ppm | ASTM D5185m 62 | 14 | 2 | 4 |

CONTAMINANTS


| method | limit/base | current | history1 | history2 | |
|-----------|------------|-------------------|---------------|----------|--------|
| Silicon | ppm | ASTM D5185m >15 | <1 | 3 | 3 |
| Sodium | ppm | ASTM D5185m | 0 | 42 | 36 |
| Potassium | ppm | ASTM D5185m >20 | <1 | 6 | 8 |
| Water | % | ASTM D6304 >55 | 40.0 | 39.5 | 39.4 |
| ppm Water | ppm | ASTM D6304 >55000 | 400000 | 395000 | 394000 |

FLUID CLEANLINESS


| method | limit/base | current | history1 | history2 |
|-----------------|------------------------|-----------------|----------|----------|
| Particles >4µm | ASTM D7647 >5000 | 1757 | 574 | 948 |
| Particles >6µm | ASTM D7647 >1300 | 957 | 313 | 517 |
| Particles >14µm | ASTM D7647 >160 | 163 | 53 | 88 |
| Particles >21µm | ASTM D7647 >40 | 55 | 18 | 30 |
| Particles >38µm | ASTM D7647 >10 | 8 | 3 | 5 |
| Particles >71µm | ASTM D7647 >3 | 1 | 0 | 0 |
| Oil Cleanliness | ISO 4406 (c) >19/17/14 | 18/17/15 | 16/15/13 | 17/16/14 |

OIL ANALYSIS REPORT


Particle Trend

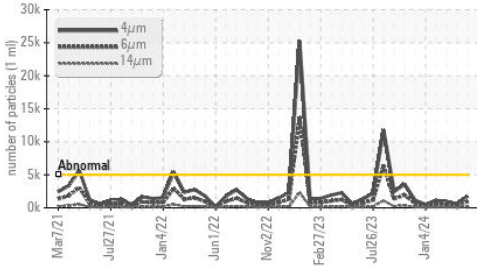


Water (KF)

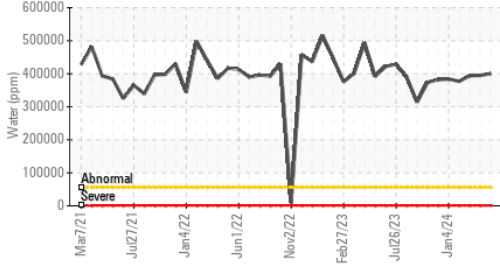


Reserve Alkalinity

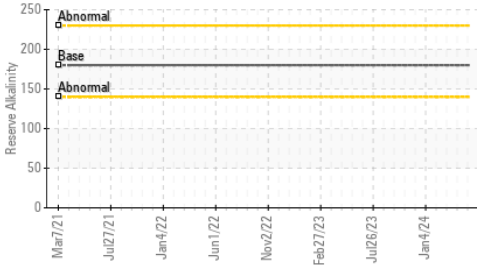

Viscosity @ 40°C

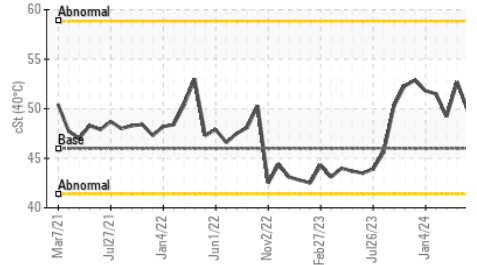

Reserve Alkalinity

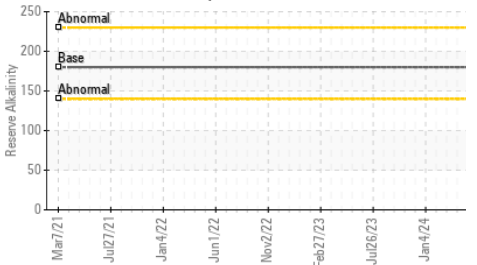


| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >55 | 0.2% | 0.2% |
| Free Water | scalar | *Visual | | NEG | NEG |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|------------|------------|---------|----------|----------|
| pH | Scale 0-14 | ASTM D1287 | 9.00 | 9.00 | 10.0 |
| Visc @ 40°C | cSt | ASTM D445 | 46 | 49.9 | 52.7 |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|


Color

Bottom

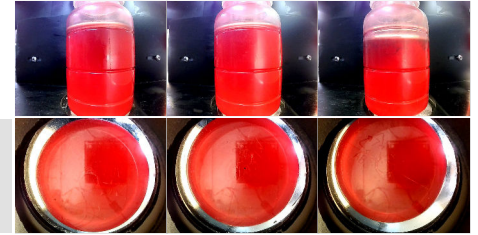


GRAPHS


Ferrous Alloys

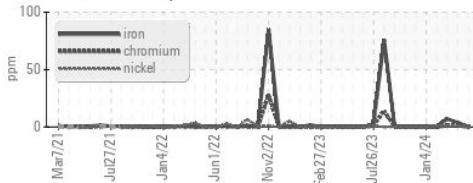


Non-ferrous Metals

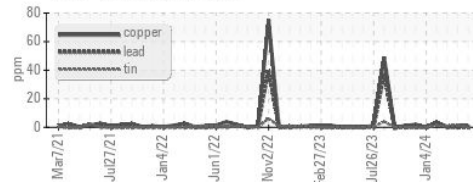


Viscosity @ 40°C

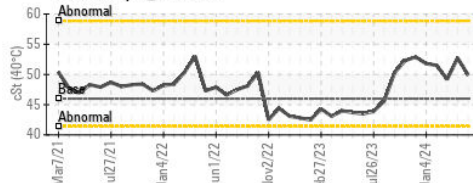

Particle Count

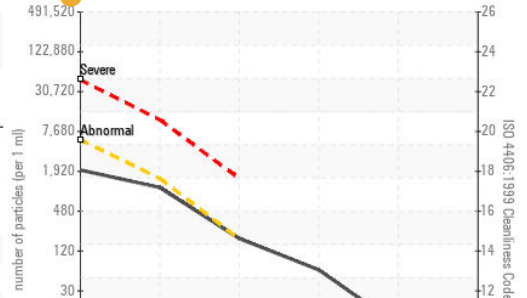

Acid Number

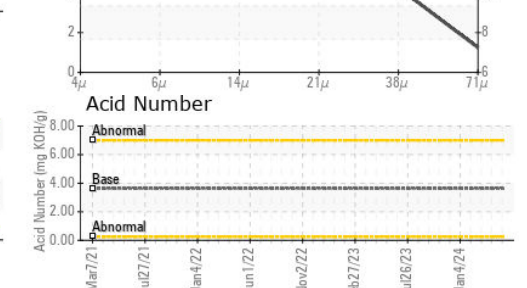

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP0039062 **Received** : 10 May 2024
Lab Number : 06175577 **Tested** : 16 May 2024
Unique Number : 11021630 **Diagnosed** : 16 May 2024 - Jonathan Hester
Test Package : IND 2 (Additional Tests: pH, ReserveAlk)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

OUTOKUMPU STAINLESS USA
 HWY 43 N
 CALVERT, AL 36513
 Contact: MARIO JOHNSON
 Mario.johnson@outokumpu.com
 T: (251)321-4105
 F: x: