

OIL ANALYSIS REPORT

Area CS-46 [SR33395186] QUINCY CAI794535 - CAMBLIN STEEL

Component Compressor

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

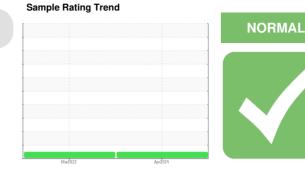


SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06175601	UCH05514330	
Sample Date		Client Info		23 Apr 2024	30 Mar 2022	
Machine Age	hrs	Client Info		73190	55690	
Oil Age	hrs	Client Info		0	3950	
Oil Changed		Client Info		Changed	Not Changd	
Sample Status				NORMAL	NORMAL	
CONTAMINATION	۷	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG	NEG	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m		0	0	
Titanium	ppm	ASTM D5185m		0	0	
Silver	ppm	ASTM D5185m		0	0	
Aluminum	ppm	ASTM D5185m	>25	0	0	
Lead	ppm	ASTM D5185m	>25	0	0	
Copper	ppm	ASTM D5185m	>50	0	0	
Tin	ppm	ASTM D5185m	>15	0	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	1.5	0	0	
Barium	ppm	ASTM D5185m	0	<1	0	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m	0.3	0	0	
Magnesium	ppm	ASTM D5185m	0	<1	0	
Calcium	ppm	ASTM D5185m	0	0	0	
Phosphorus	ppm	ASTM D5185m	406	140	193	
Zinc	ppm	ASTM D5185m	0	8	0	
Sulfur	ppm	ASTM D5185m	1283	576	907	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	
Sodium	ppm	ASTM D5185m		<1	0	
Potassium	ppm	ASTM D5185m	>20	0	<1	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.463	0.30	0.061	



OIL ANALYSIS REPORT

VISUAL

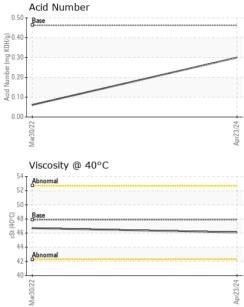

	White Metal	scalar	*Visual	NONE	NONE	NONE	
	Yellow Metal	scalar	*Visual	NONE	NONE	NONE	
- the second	Precipitate	scalar	*Visual	NONE	NONE	NONE	
	Silt	scalar	*Visual	NONE	NONE	NONE	
	Debris	scalar	*Visual	NONE	NONE	NONE	
	Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	
Apr23/24	Appearance	scalar	*Visual	NORML	NORML	NORML	
Apr2	Odor	scalar	*Visual	NORML	NORML	NORML	
	Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	
	Free Water	scalar	*Visual		NEG	NEG	
	FLUID PROPERT	IES	method	limit/base	current	history1	history2
	Visc @ 40°C	cSt	ASTM D445	47.9	46.1	46.7	
	SAMPLE IMAGES	S	method	limit/base	current	history1	history2
Apr23/24	Color						no image
	Bottom						no image
	Non-ferrous Metal	S		Api23/24 Api23/24			
				Apr2			
	Viscosity @ 40°C				Acid Number		
	Abnormal			(B) 0.50 HO 0.40 E 0.30 mag 0.20 V 0.10 V 0.10	Base		
	C 50 Base			Ē 0.30			
	(3 50 Base 83 45			e 0.20).		
	Abnormal			2 0.10			
	40			0.00			
	Mar30/22			Apr23/24	Mar30/22		
	_				Marô		
Laboratory	: WearCheck USA - 50	CISCO	CISCO AIR SYSTEM 214 27TH S SACRAMENTO, C US 9581 uct: BARRY FRKOVIC yfrkovich@ciscoair.co T: (916)444-252 F:				

Contact/Location: BARRY FRKOVICH - UCCISSAC