




# OIL ANALYSIS REPORT

## Sample Rating Trend

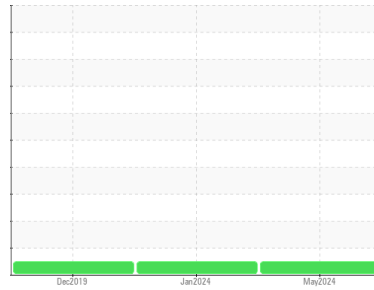

**NORMAL**



Machine Id  
**AIRCOMP-009 (S/N UN111318)**  
 Component  
**Air Compressor**  
 Fluid  
**COMPRESSOR OIL ISO 46 (--- QTS)**

### DIAGNOSIS

#### Recommendation

We suspect abnormal contamination may be due to sampling method. We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

Moderate concentration of visible dirt/debris present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0898963</b>	WC0877108	WC0396137
Sample Date	Client Info			<b>11 May 2024</b>	17 Jan 2024	16 Dec 2019
Machine Age	hrs	Client Info		<b>0</b>	0	44356
Oil Age	hrs	Client Info		<b>0</b>	0	2010
Oil Changed		Client Info		<b>N/A</b>	Changed	Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.6	<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>&lt;1</b>	<1	<1
Chromium	ppm	ASTM D5185m	>4	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>4	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Lead	ppm	ASTM D5185m	>20	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m	>40	<b>&lt;1</b>	1	<1
Tin	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m		<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0


ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	5	<b>0</b>	0	2
Barium	ppm	ASTM D5185m	5	<b>2</b>	<1	0
Molybdenum	ppm	ASTM D5185m	5	<b>0</b>	0	<1
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m	5	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m	5	<b>0</b>	2	0
Phosphorus	ppm	ASTM D5185m	150	<b>0</b>	0	0
Zinc	ppm	ASTM D5185m	5	<b>8</b>	0	0
Sulfur	ppm	ASTM D5185m	5000	<b>95</b>	114	98

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	5
Sodium	ppm	ASTM D5185m		<b>8</b>	7	2
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	3

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.51	<b>0.089</b>	0.217	0.057



# OIL ANALYSIS REPORT


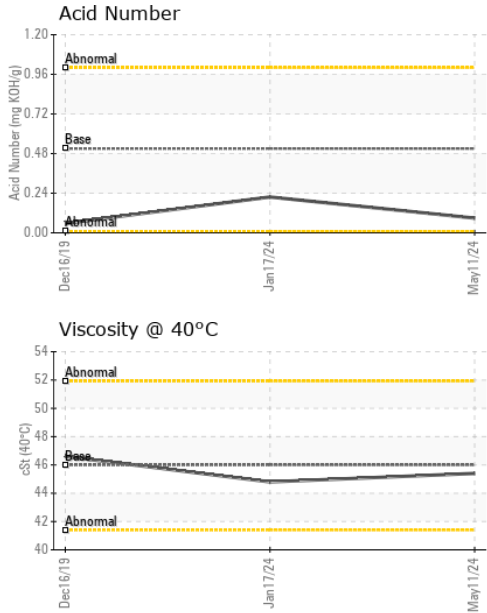


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	<b>MODER</b>	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.6	<b>NEG</b>	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	46	<b>45.4</b>	44.8	46.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

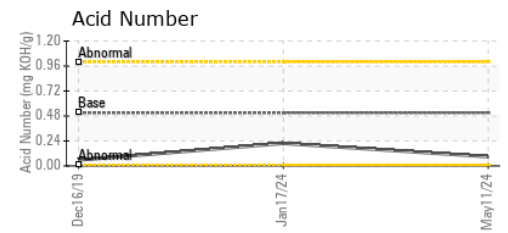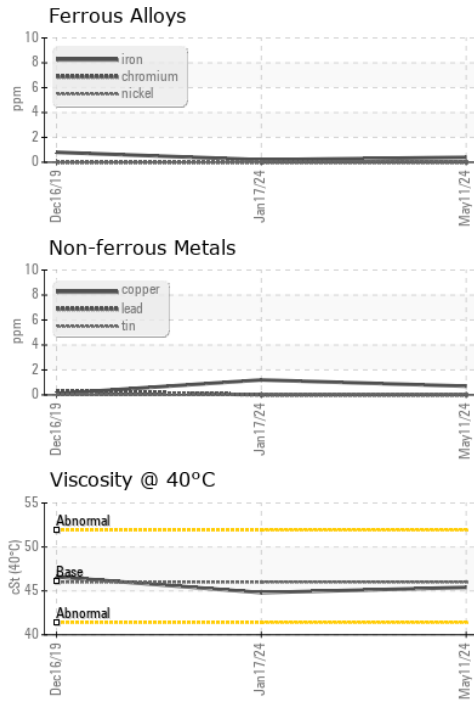

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0898963      **Received** : 10 May 2024  
**Lab Number** : **06175631**      **Tested** : 13 May 2024  
**Unique Number** : 11021684      **Diagnosed** : 13 May 2024 - Doug Bogart  
**Test Package** : IND 2

**PRINSCO - JESUP**  
 850 HAWKEYE RD  
 JESUP, IA  
 US 50648

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact: Spencer Reedy  
 spencer.reedy@prinsco.com  
 T:  
 F: