




# OIL ANALYSIS REPORT

Sample Rating Trend

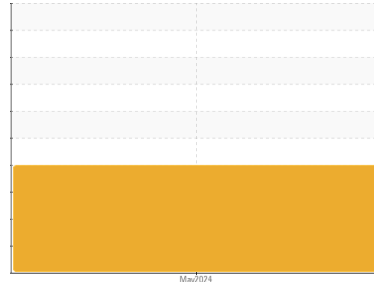

WATER



Machine Id  
**BRIDGEPORT 16700**

Component  
**Blower**  
Fluid  
{not provided} (--- GAL)

## DIAGNOSIS

### ▲ Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

### ▲ Wear

Copper and iron ppm levels are abnormal.

### ▲ Contamination

There is a moderate amount of visible silt present in the sample. There is a moderate concentration of water present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC06176027</b>	---	---
Sample Date	Client Info		<b>09 May 2024</b>	---	---
Machine Age	hrs	Client Info	<b>0</b>	---	---
Oil Age	hrs	Client Info	<b>0</b>	---	---
Oil Changed	Client Info		<b>N/A</b>	---	---
Sample Status			<b>ABNORMAL</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	▲ <b>47</b>	---	---
Chromium	ppm	ASTM D5185m >20	<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185m >20	<b>1</b>	---	---
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Silver	ppm	ASTM D5185m	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >20	<b>3</b>	---	---
Lead	ppm	ASTM D5185m >20	<b>&lt;1</b>	---	---
Copper	ppm	ASTM D5185m >20	▲ <b>53</b>	---	---
Tin	ppm	ASTM D5185m >20	<b>6</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>&lt;1</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>16</b>	---	---
Barium	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Molybdenum	ppm	ASTM D5185m	<b>30</b>	---	---
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Magnesium	ppm	ASTM D5185m	<b>87</b>	---	---
Calcium	ppm	ASTM D5185m	<b>228</b>	---	---
Phosphorus	ppm	ASTM D5185m	<b>304</b>	---	---
Zinc	ppm	ASTM D5185m	<b>189</b>	---	---
Sulfur	ppm	ASTM D5185m	<b>4276</b>	---	---

## CONTAMINANTS






	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>9</b>	---	---
Sodium	ppm	ASTM D5185m	<b>13</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>4</b>	---	---
Water	%	ASTM D6304	▲ <b>0.540</b>	---	---
ppm Water	ppm	ASTM D6304	▲ <b>5400</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.94</b>	---	---



# OIL ANALYSIS REPORT

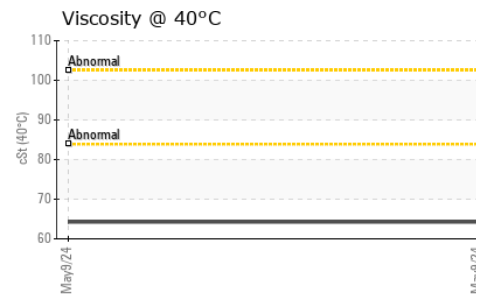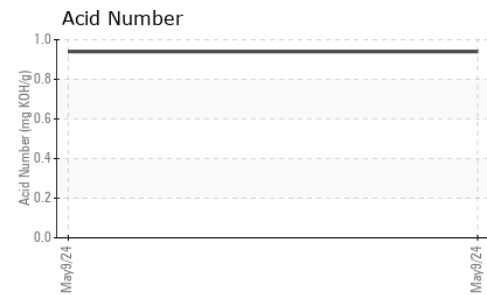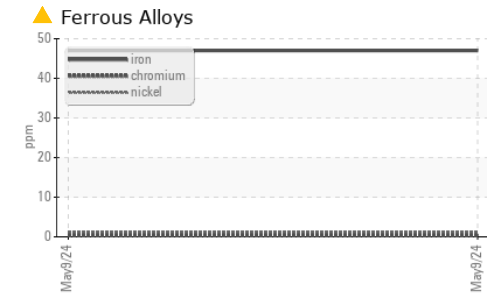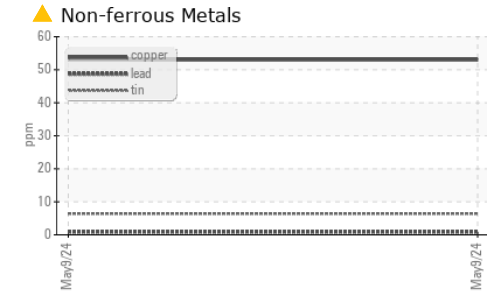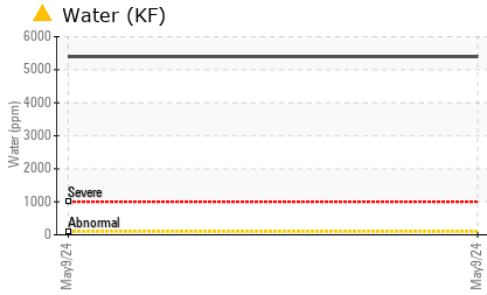







VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	▲ MODER	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	▲ 0.2%	---	---
Free Water	scalar	*Visual	NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	64.25	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image	no image
Bottom				no image	no image	no image

## GRAPHS

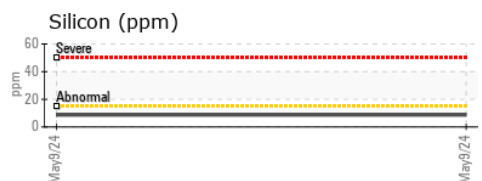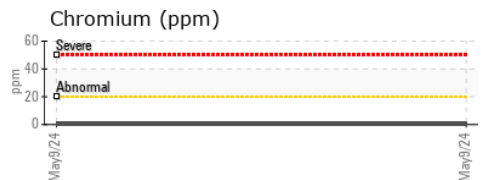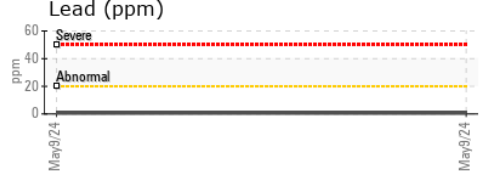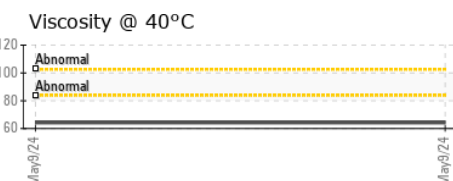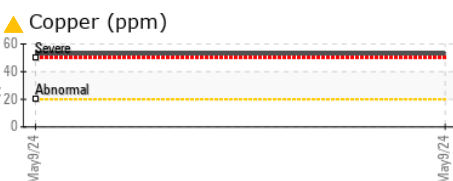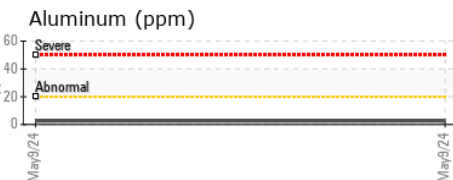

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC06176027      **Received** : 10 May 2024  
**Lab Number** : 06176027      **Tested** : 10 May 2024  
**Unique Number** : 11022080      **Diagnosed** : 10 May 2024 - Doug Bogart  
**Test Package** : MOB 2 ( Additional Tests: KF )

**MOMAR Incorporated**  
 P.O. Box 19567  
 Atlanta, GA  
 US 30325  
 Contact: JOHN STEED  
 john.steed@momar.com  
 T: (404)355-4580  
 F: (678)894-4204

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)