


# **OIL ANALYSIS REPORT**

Sample Rating Trend



**NORMAL** 

Machine Id

# KAESER SK 19 2092681 (S/N 1581)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Jan2018	Apr2020 May2021	I May2022 May2023	Apr2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA016472	KCPA001675	KCP45564
Sample Date		Client Info		29 Apr 2024	09 May 2023	09 May 2022
Machine Age	hrs	Client Info		13784	9760	5474
Oil Age	hrs	Client Info		3000	0	5474
Oil Changed		Client Info		Changed	N/A	Changed
Sample Status				NORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	3	1	2
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	<1
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	<1
Aluminum	ppm	ASTM D5185m	>10	0	0	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	7	3	4
Tin	ppm	ASTM D5185m	>10	<1	0	<1
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES	1-1-	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	<1
Barium	ppm	ASTM D5185m	90	<1	22	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m	100	11	44	37
Calcium	ppm	ASTM D5185m	0	0	1	0
Phosphorus	ppm	ASTM D5185m	0	0	25	8
Zinc	ppm	ASTM D5185m	0	100	24	28
Sulfur	ppm	ASTM D5185m	23500	22618	21503	16544
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	<1
Sodium	ppm	ASTM D5185m	720	8	6	4
Potassium	ppm	ASTM D5185m	>20	0	<1	0
Water	%	ASTM D6304		0.019	0.025	0.015
ppm Water	ppm	ASTM D6304	>500	199	255.4	159.0
FLUID CLEANLIN		method	limit/base	current		
	ESS		— IIIIII/Dase		history1	history2
Particles >4µm		ASTM D7647	. 1000	2103	36214	20031
Particles >6µm		ASTM D7647		238	10940	△ 6521 △ 612
Particles >14µm		ASTM D7647	>80	12	<u>^</u> 562	▲ 618
Particles >21µm		ASTM D7647		5	98	<u>122</u>
Particles >38µm		ASTM D7647	>4	1	7	4
Particles >71µm		ASTM D7647		0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/15/11	<u>22/21/16</u>	<u>22/20/16</u>
FLUID DEGRADA	TION	method			history1	history2



## **OIL ANALYSIS REPORT**

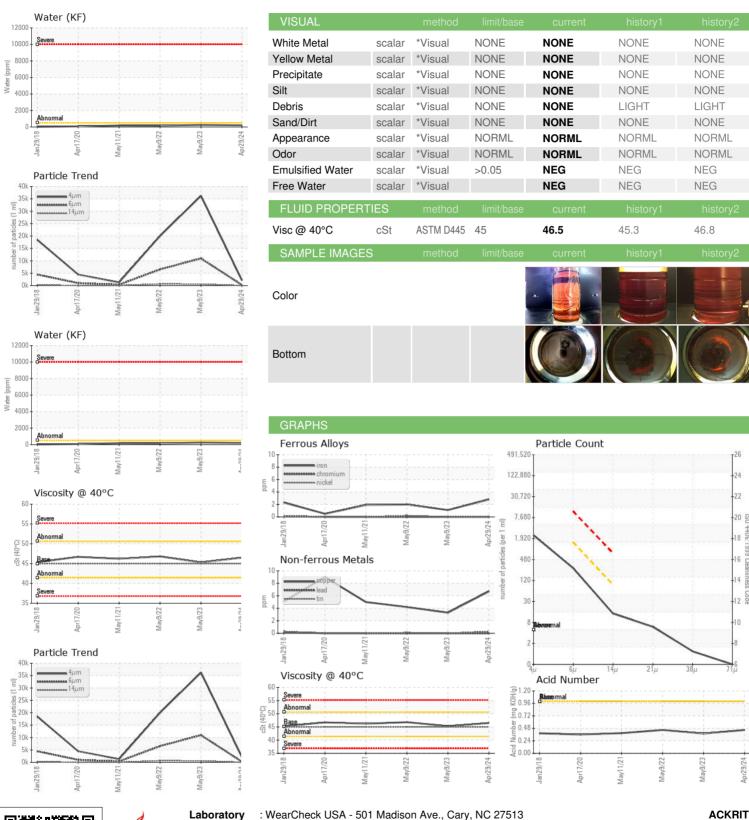





Certificate 12367

Laboratory Sample No. Lab Number

: 06176094 Unique Number : 11022147

: KCPA016472

Received **Tested** Diagnosed

: 10 May 2024 : 14 May 2024

: 14 May 2024 - Don Baldridge

Test Package : IND 2 ( Additional Tests: KF, PrtCount ) To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: FRED SEAL - ACKSTA

ST ANN, MO

US 63074

T:

F:

3028 N LINDBERGH BLVD

FRED.SEAL@ACKRIT.COM

Contact: FRED SEAL