




OIL ANALYSIS REPORT

Sample Rating Trend

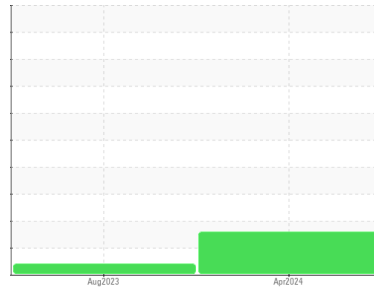

ISO



Machine Id
KAESER SFC110S 6702208 (S/N 1012)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) FG-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA012378	KCPA004147	---
Sample Date	Client Info			26 Apr 2024	20 Aug 2023	---
Machine Age	hrs	Client Info		20074	18092	---
Oil Age	hrs	Client Info		0	18010	---
Oil Changed	Client Info			Changed	N/A	---
Sample Status				ABNORMAL	ABNORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	3	---
Chromium	ppm	ASTM D5185m	>10	0	0	---
Nickel	ppm	ASTM D5185m	>3	0	0	---
Titanium	ppm	ASTM D5185m	>3	0	<1	---
Silver	ppm	ASTM D5185m	>2	0	0	---
Aluminum	ppm	ASTM D5185m	>10	4	7	---
Lead	ppm	ASTM D5185m	>10	0	0	---
Copper	ppm	ASTM D5185m	>50	4	8	---
Tin	ppm	ASTM D5185m	>10	<1	0	---
Vanadium	ppm	ASTM D5185m		0	<1	---
Cadmium	ppm	ASTM D5185m		0	0	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	---
Barium	ppm	ASTM D5185m		<1	0	---
Molybdenum	ppm	ASTM D5185m		0	0	---
Manganese	ppm	ASTM D5185m		0	0	---
Magnesium	ppm	ASTM D5185m		2	<1	---
Calcium	ppm	ASTM D5185m		<1	0	---
Phosphorus	ppm	ASTM D5185m	500	52	211	---
Zinc	ppm	ASTM D5185m		26	62	---
Sulfur	ppm	ASTM D5185m		3407	6431	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	1	---
Sodium	ppm	ASTM D5185m		1	<1	---
Potassium	ppm	ASTM D5185m	>20	<1	0	---
Water	%	ASTM D6304	>0.05	0.00	0.008	---
ppm Water	ppm	ASTM D6304	>500	0	86.3	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		17953	---	---
Particles >6µm		ASTM D7647	>1300	▲ 2771	---	---
Particles >14µm		ASTM D7647	>80	▲ 137	---	---
Particles >21µm		ASTM D7647	>20	▲ 38	---	---
Particles >38µm		ASTM D7647	>4	1	---	---
Particles >71µm		ASTM D7647	>3	0	---	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 21/19/14	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.5	0.32	0.78	---


OIL ANALYSIS REPORT

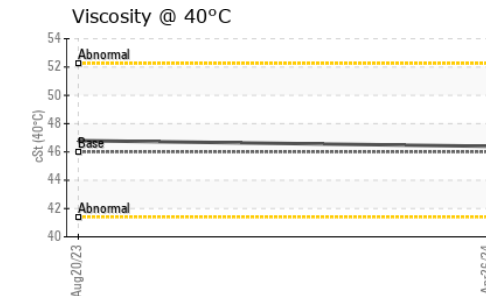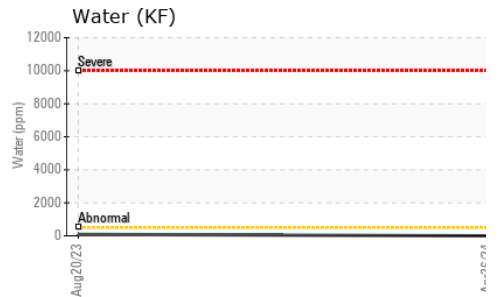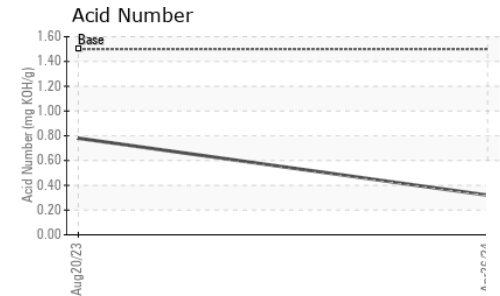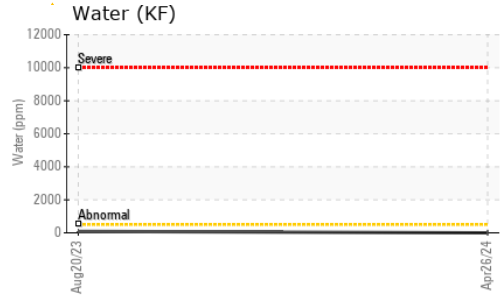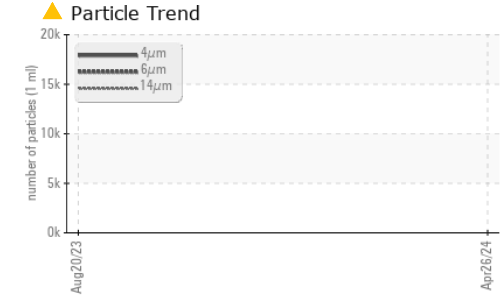






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	46.4	46.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

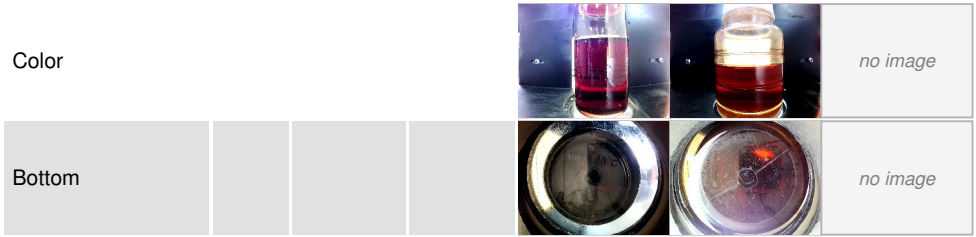

GRAPHS

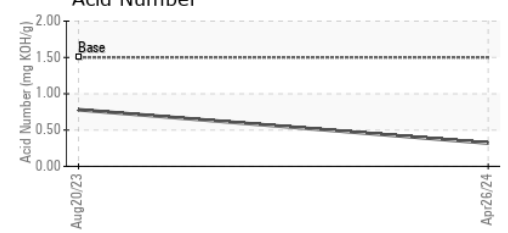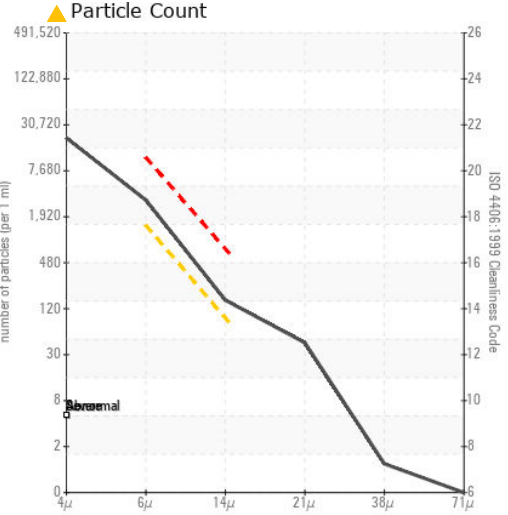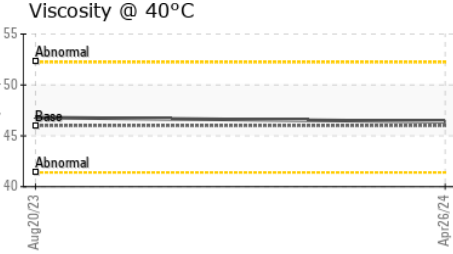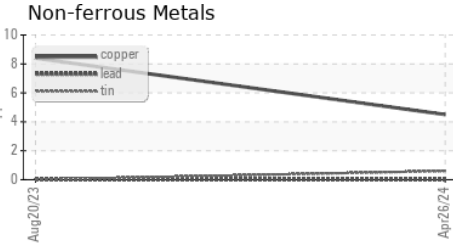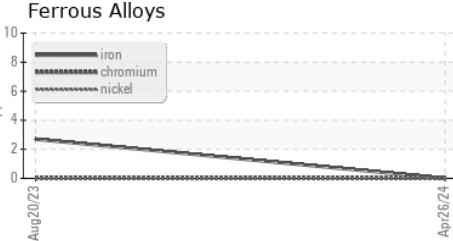

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA012378
Lab Number : 06176099
Unique Number : 11022152
Test Package : IND 2 (Additional Tests: KF, PrtCount)
Received : 10 May 2024
Tested : 14 May 2024
Diagnosed : 14 May 2024 - Don Baldrige

MONTE VISTA FARM
 5043 N MONTEPELIER RD
 DENAIR, CA
 US 95316
 Contact: J BEAVEN
 JBEAVEN@MONTEVISTAFARMING.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)