




# OIL ANALYSIS REPORT

Sample Rating Trend

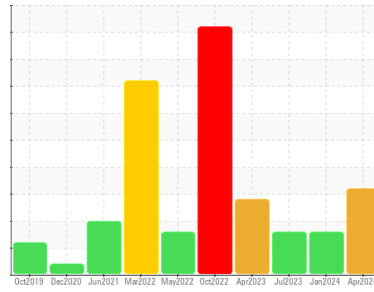

DIRT



Machine Id  
**KAESER BSD 50 6859199 (S/N 2097)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- QTS)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil. Silicon noted.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KC128426</b>	KC122659	KC120607
Sample Date	Client Info			<b>22 Apr 2024</b>	30 Jan 2024	31 Jul 2023
Machine Age	hrs	Client Info		<b>30401</b>	27752	24742
Oil Age	hrs	Client Info		<b>5659</b>	0	0
Oil Changed	Client Info			<b>Not Chngd</b>	N/A	N/A
Sample Status				<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	<1
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	<1	3
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>4</b>	7	7
Tin	ppm	ASTM D5185m	>10	<b>&lt;1</b>	<1	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>1</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m	90	<b>2</b>	7	<1
Calcium	ppm	ASTM D5185m	2	<b>0</b>	6	0
Phosphorus	ppm	ASTM D5185m		<b>11</b>	18	198
Zinc	ppm	ASTM D5185m		<b>13</b>	0	7


CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>▲ 27</b>	22	<b>▲ 61</b>
Sodium	ppm	ASTM D5185m		<b>2</b>	6	<1
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	3	2
Water	%	ASTM D6304	>0.05	<b>0.006</b>	0.012	0.003
ppm Water	ppm	ASTM D6304	>500	<b>66</b>	120	38.1

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>25357</b>	33870	1871
Particles >6µm		ASTM D7647	>1300	<b>▲ 6088</b>	<b>▲ 10062</b>	606
Particles >14µm		ASTM D7647	>80	<b>▲ 374</b>	<b>▲ 365</b>	58
Particles >21µm		ASTM D7647	>20	<b>▲ 90</b>	<b>▲ 47</b>	19
Particles >38µm		ASTM D7647	>4	<b>2</b>	3	1
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>▲ 22/20/16</b>	<b>▲ 22/21/16</b>	18/16/13


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.37</b>	0.33	0.26

# OIL ANALYSIS REPORT


### Particle Trend

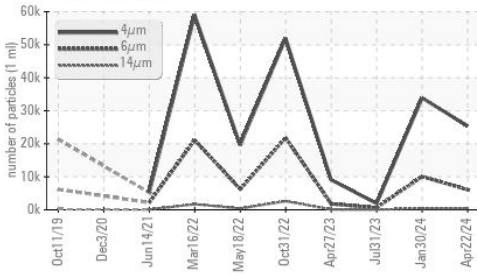


### Silicon (ppm)

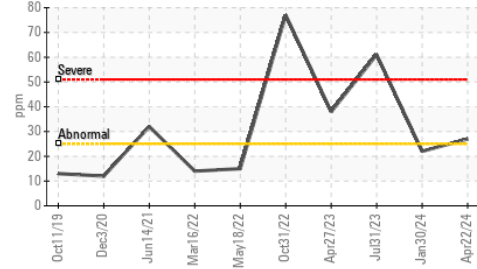


### Water (KF)

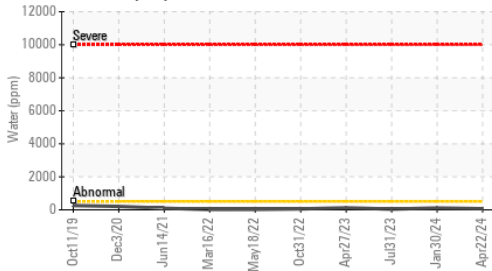

### Acid Number

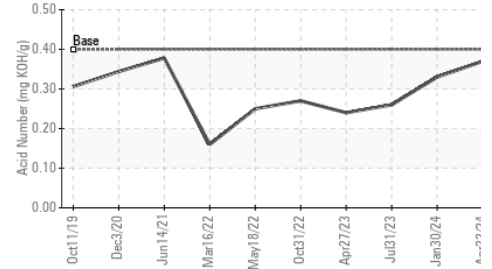


### Water (KF)

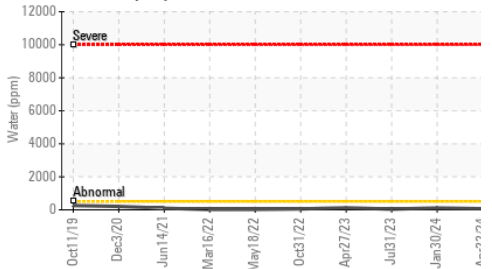

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	46.9	44.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

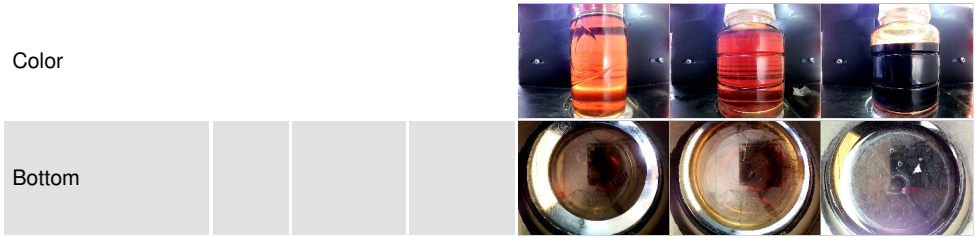


### GRAPHS


#### Ferrous Alloys

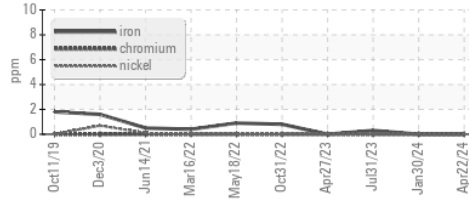


#### Non-ferrous Metals

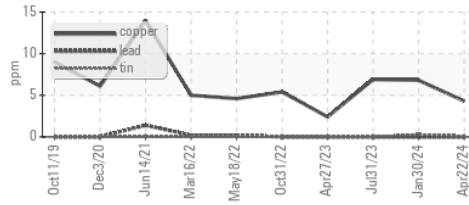


#### Viscosity @ 40°C

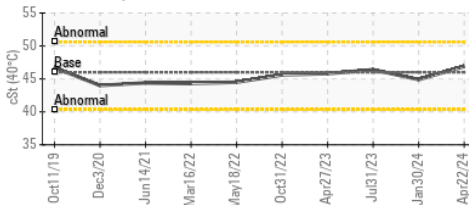

#### Particle Count

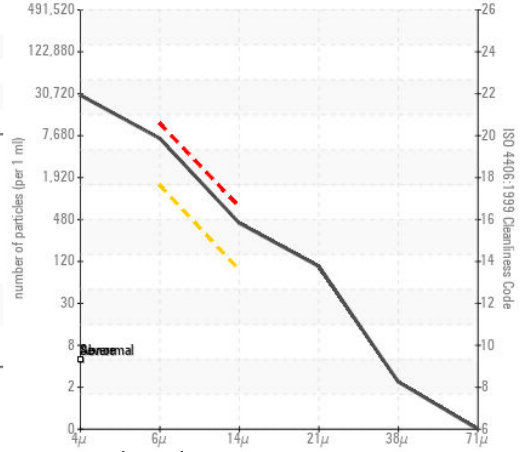

#### Acid Number

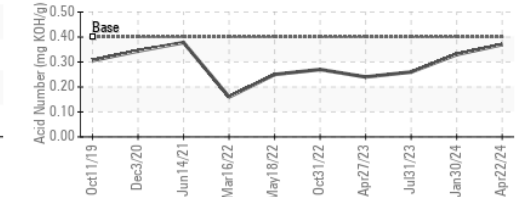

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC128426  
**Lab Number** : 06176116  
**Unique Number** : 11022169  
**Test Package** : IND 2

**Received** : 10 May 2024  
**Tested** : 14 May 2024  
**Diagnosed** : 14 May 2024 - Doug Bogart

**TREMOR GROUP**  
 1030 AIRPORT RD  
 LAKELAND, FL  
 US 33802  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: