



OIL ANALYSIS REPORT

Sample Rating Trend



WATER



Machine Id
KAESER AIRTOWER 5C 7529263 (S/N 1173)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- QTS)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. We were unable to perform a particle count due to a high concentration of particles present in this sample. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

▲ Contamination

High concentration of visible dirt/debris present in the oil. There is a light concentration of water present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

| | method | limit/base | current | history1 | history2 |
|---------------|-------------|-------------|--------------------|----------|----------|
| Sample Number | Client Info | | KCPA017090 | --- | --- |
| Sample Date | Client Info | | 23 Apr 2024 | --- | --- |
| Machine Age | hrs | Client Info | 964 | --- | --- |
| Oil Age | hrs | Client Info | 213 | --- | --- |
| Oil Changed | Client Info | | Changed | --- | --- |
| Sample Status | | | ABNORMAL | --- | --- |

WEAR METALS

| | method | limit/base | current | history1 | history2 |
|----------|--------|-----------------|--------------|----------|----------|
| Iron | ppm | ASTM D5185m >50 | 0 | --- | --- |
| Chromium | ppm | ASTM D5185m >10 | 0 | --- | --- |
| Nickel | ppm | ASTM D5185m >3 | 0 | --- | --- |
| Titanium | ppm | ASTM D5185m >3 | 0 | --- | --- |
| Silver | ppm | ASTM D5185m >2 | 0 | --- | --- |
| Aluminum | ppm | ASTM D5185m >10 | 0 | --- | --- |
| Lead | ppm | ASTM D5185m >10 | 0 | --- | --- |
| Copper | ppm | ASTM D5185m >50 | <1 | --- | --- |
| Tin | ppm | ASTM D5185m >10 | <1 | --- | --- |
| Vanadium | ppm | ASTM D5185m | 0 | --- | --- |
| Cadmium | ppm | ASTM D5185m | 0 | --- | --- |

ADDITIVES

| | method | limit/base | current | history1 | history2 |
|------------|--------|-------------------|--------------|----------|----------|
| Boron | ppm | ASTM D5185m 0 | 0 | --- | --- |
| Barium | ppm | ASTM D5185m 90 | 2 | --- | --- |
| Molybdenum | ppm | ASTM D5185m 0 | 0 | --- | --- |
| Manganese | ppm | ASTM D5185m | <1 | --- | --- |
| Magnesium | ppm | ASTM D5185m 100 | 49 | --- | --- |
| Calcium | ppm | ASTM D5185m 0 | 0 | --- | --- |
| Phosphorus | ppm | ASTM D5185m 0 | <1 | --- | --- |
| Zinc | ppm | ASTM D5185m 0 | 22 | --- | --- |
| Sulfur | ppm | ASTM D5185m 23500 | 23175 | --- | --- |




CONTAMINANTS

| | method | limit/base | current | history1 | history2 |
|-----------|--------|------------------|----------------|----------|----------|
| Silicon | ppm | ASTM D5185m >25 | <1 | --- | --- |
| Sodium | ppm | ASTM D5185m | 15 | --- | --- |
| Potassium | ppm | ASTM D5185m >20 | 2 | --- | --- |
| Water | % | ASTM D6304 >0.05 | ▲ 0.183 | --- | --- |
| ppm Water | ppm | ASTM D6304 >500 | ▲ 1830 | --- | --- |

FLUID DEGRADATION

| | method | limit/base | current | history1 | history2 |
|------------------|----------|----------------|-------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 1.0 | 0.37 | --- | --- |

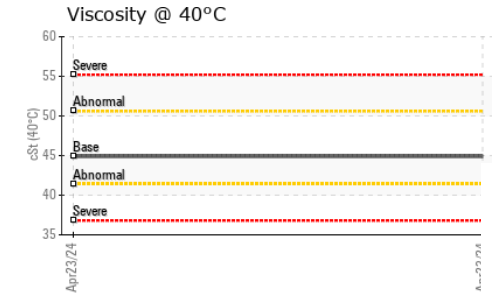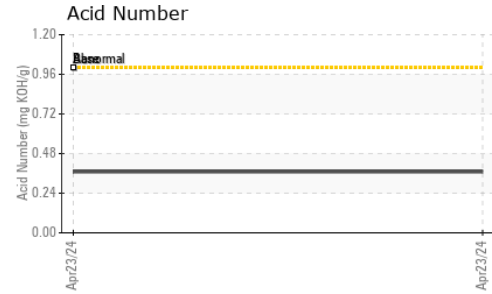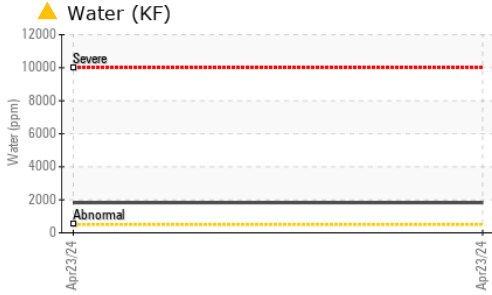

OIL ANALYSIS REPORT







| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | --- |
| Yellow Metal | scalar | *Visual | NONE | NONE | --- |
| Precipitate | scalar | *Visual | NONE | NONE | --- |
| Silt | scalar | *Visual | NONE | NONE | --- |
| Debris | scalar | *Visual | NONE | ▲ HEAVY | --- |
| Sand/Dirt | scalar | *Visual | NONE | NONE | --- |
| Appearance | scalar | *Visual | NORML | NORML | --- |
| Odor | scalar | *Visual | NORML | NORML | --- |
| Emulsified Water | scalar | *Visual | >0.05 | 0.2% | --- |
| Free Water | scalar | *Visual | | NEG | --- |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 | 45 | 44.9 | --- |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

| | | | | | |
|--------|--|--|---|----------|----------|
| Color | | |  | no image | no image |
| Bottom | | |  | no image | no image |

GRAPHS

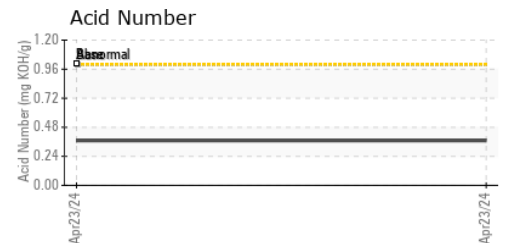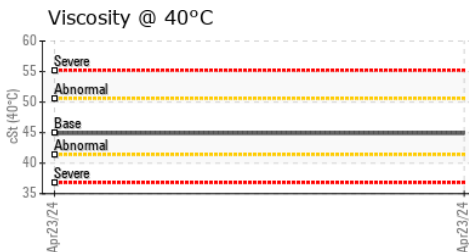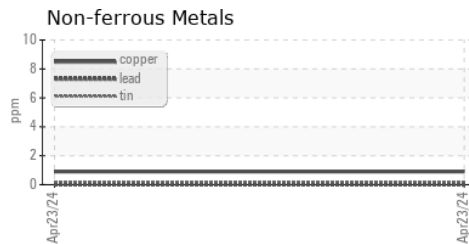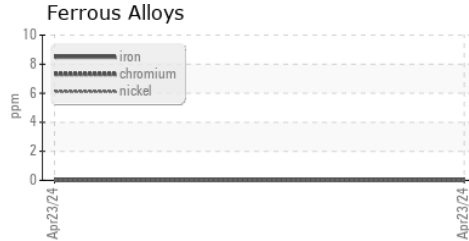

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : KCPA017090

Lab Number : 06176134

Unique Number : 11022187

Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Received : 10 May 2024

Tested : 14 May 2024

Diagnosed : 14 May 2024 - Doug Bogart

UPS SERVICE LOGISTICS

7137 SOUTH LAKE PKWY, SUITE B

MORROW, GA

US 30260

Contact: SERVICE MANAGER

kwaisgray@ups.com

T:

F: