## 

# **OIL ANALYSIS REPORT**

Sample Rating Trend

NORMAL

#### Area HUNTING Machine Id 202203160038

Air Compressor Fluid SULLAIR SULLUBE (4 GAL)

#### DIAGNOSIS

#### Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


#### Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		SFA0000294		
Sample Date		Client Info		29 Apr 2024		
Machine Age	hrs	Client Info		15946		
Oil Age	hrs	Client Info		2395		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>4	0		
Nickel	ppm	ASTM D5185m	>4	0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>20	0		
Copper	ppm	ASTM D5185m	>40	2		
Tin	ppm	ASTM D5185m	>5	_ <1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	745	628		
Molybdenum	ppm	ASTM D5185m	0.0	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	0.0	3		
Calcium	ppm	ASTM D5185m	1	3		
Phosphorus	ppm	ASTM D5185m	3	<1		
Zinc	ppm	ASTM D5185m	0.1	34		
Sulfur	ppm	ASTM D5185m	240	333		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2		
Sodium	ppm	ASTM D5185m		47		
Potassium	ppm	ASTM D5185m	>20	4		
Water	%	ASTM D6304	>0.6	0.516		
ppm Water	ppm	ASTM D6304	>6000	5167		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	6008		
Particles >6µm		ASTM D7647	>2500	1387		
Particles >14µm		ASTM D7647	>320	107		
Particles >21µm		ASTM D7647	>80	32		
Particles >38µm		ASTM D7647	>20	0		
Particles >71µm		ASTM D7647	>4	0		
Oil Cleanliness		ISO 4406 (c)	>20/18/15	20/18/14		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	.06	0.4		


### SULLAIR.

# **OIL ANALYSIS REPORT**

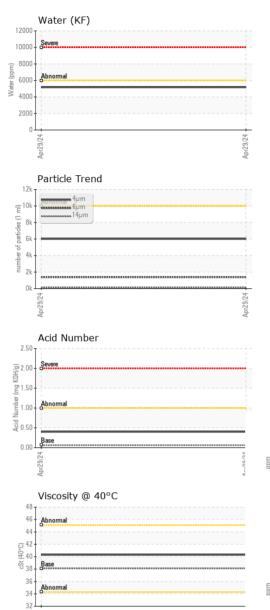



ŚB

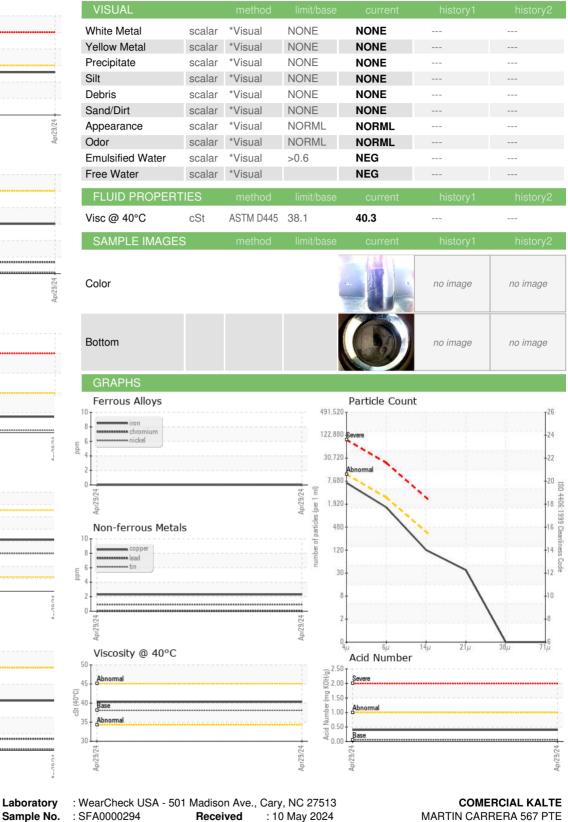

Certificate 12367

Laboratory

Lab Number : 06176141

Unique Number : 11022194

Test Package : PLANT (Additional Tests: FT-IR, KF, pH)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Tested

Diagnosed

: 14 May 2024

: 14 May 2024 - Doug Bogart

Contact/Location: Service Manager - SFA604630

MX 64290

T:

F:

MONTERREY, ZZ

Contact: Service Manager

tampico@kalte.com.mx