




OIL ANALYSIS REPORT

Sample Rating Trend

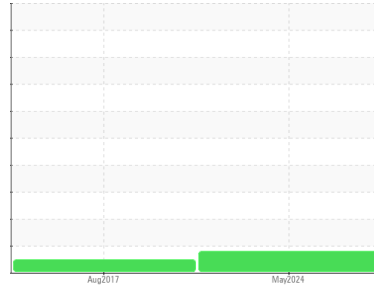

ISO



Machine Id
RECYCLED NH3 OIL
 Component
Refrigeration Compressor
 Fluid
USPI 1009-68 SC (--- LTR)

DIAGNOSIS

Recommendation

This is a baseline read-out on the submitted sample. BOGE

Contamination

There is a high amount of silt (particulates < 6 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		USP0011362	USP04276500	---
Sample Date	Client Info		09 May 2024	03 Aug 2017	---
Machine Age	hrs	Client Info	0	0	---
Oil Age	hrs	Client Info	0	0	---
Oil Changed	Client Info		N/A	N/A	---
Sample Status			ABNORMAL	NORMAL	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	10	4	---
Chromium	ppm	ASTM D5185m >2	0	0	---
Nickel	ppm	ASTM D5185m	0	0	---
Titanium	ppm	ASTM D5185m	0	0	---
Silver	ppm	ASTM D5185m >2	0	0	---
Aluminum	ppm	ASTM D5185m >3	0	<1	---
Lead	ppm	ASTM D5185m >2	0	0	---
Copper	ppm	ASTM D5185m >8	0	0	---
Tin	ppm	ASTM D5185m >4	0	<1	---
Antimony	ppm	ASTM D5185m	---	0	---
Vanadium	ppm	ASTM D5185m	0	0	---
Cadmium	ppm	ASTM D5185m	0	0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	---
Barium	ppm	ASTM D5185m	1	0	---
Molybdenum	ppm	ASTM D5185m	0	0	---
Manganese	ppm	ASTM D5185m	0	0	---
Magnesium	ppm	ASTM D5185m	0	0	---
Calcium	ppm	ASTM D5185m	0	0	---
Phosphorus	ppm	ASTM D5185m	3	0	---
Zinc	ppm	ASTM D5185m	0	0	---
Sulfur	ppm	ASTM D5185m 50	0	6	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	6	2	---
Sodium	ppm	ASTM D5185m	1	<1	---
Potassium	ppm	ASTM D5185m >20	0	0	---
Water	%	ASTM D6304 >0.01	0.001	0.006	---
ppm Water	ppm	ASTM D6304 >100	1	60	---

FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	▲ 23076	884	---
Particles >6µm	ASTM D7647	>2500	1487	481	---
Particles >14µm	ASTM D7647	>320	15	82	---
Particles >21µm	ASTM D7647	>80	3	27	---
Particles >38µm	ASTM D7647	>20	0	4	---
Particles >71µm	ASTM D7647	>4	0	0	---
Oil Cleanliness	ISO 4406 (c)	>20/18/15	▲ 22/18/11	17/16/14	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974 0.005	0.028	0.008	---




OIL ANALYSIS REPORT

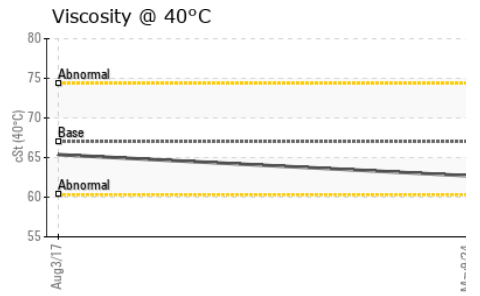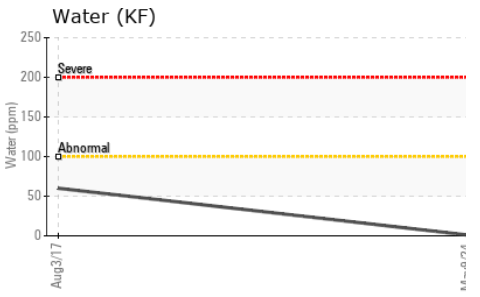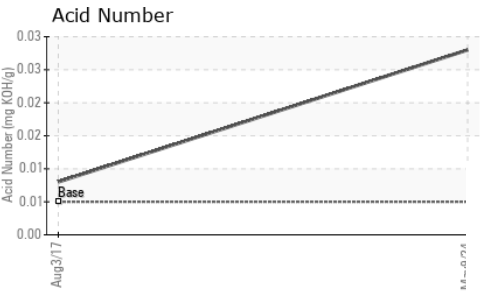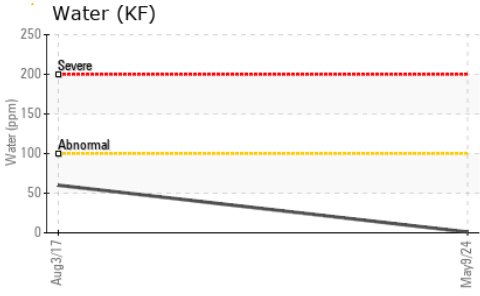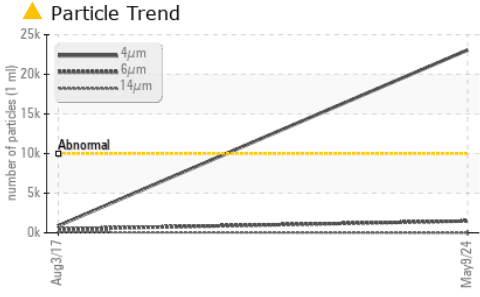






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.01	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 67	62.7	65.37	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

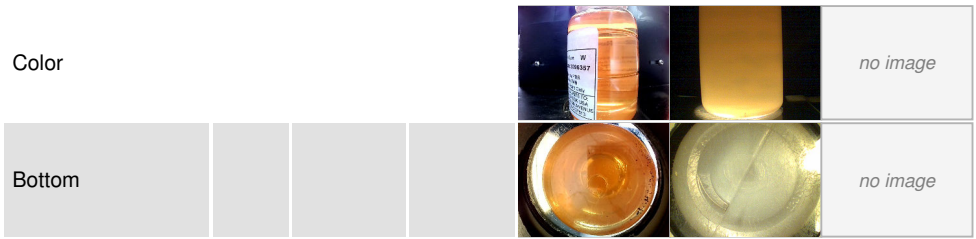

GRAPHS

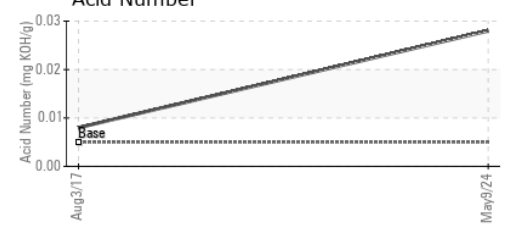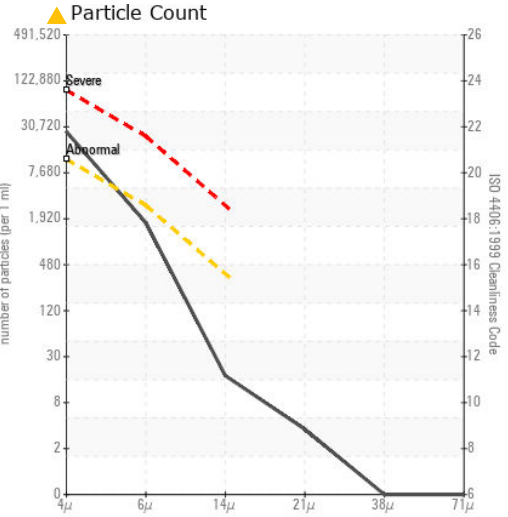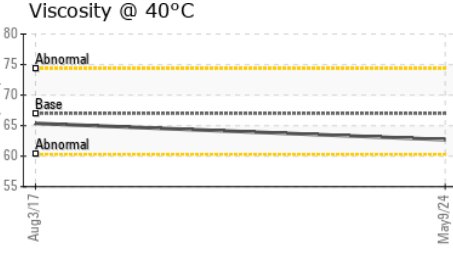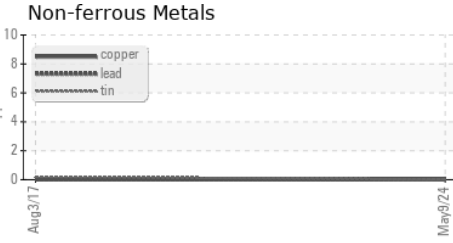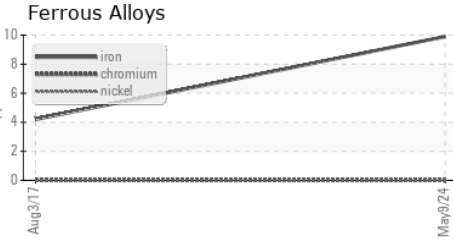

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : USP0011362 **Received** : 10 May 2024
Lab Number : **06176146** **Tested** : 14 May 2024
Unique Number : 11022199 **Diagnosed** : 14 May 2024 - Doug Bogart
Test Package : IND 2

TYSON - DAKOTA CITY SLAUGHTER
 DAKOTA CITY, NE
 US
 Contact:
 doug.bogart@wearcheck.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)