




# OIL ANALYSIS REPORT

Sample Rating Trend

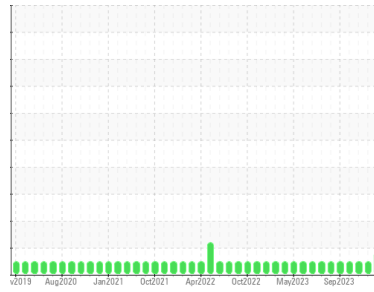

FUEL



Area

**JOHN R OPERLE**

Machine Id

**[JOHN R OPERLE] 007 630998-7**

Component

**Port Genset**

Fluid

**CHEVRON DELO 400 LE 15W40 (--- GAL)**

## DIAGNOSIS

### Recommendation

The oil change at the time of sampling has been noted. Resample at the next service interval to monitor. No other corrective action is recommended at this time.

### Wear

All component wear rates are normal.

### Contamination

Light fuel dilution occurring. No other contaminants were detected in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>MW0066006</b>	MW0061531	MW0061535
Sample Date	Client Info	<b>15 Apr 2024</b>	08 Jan 2024	06 Dec 2023
Machine Age	hrs	<b>3735</b>	36940	36534
Oil Age	hrs	<b>407</b>	406	410
Oil Changed	Client Info	<b>Changed</b>	N/A	N/A
Sample Status		<b>MARGINAL</b>	NORMAL	NORMAL

## CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >0.1	<b>NEG</b>	NEG	NEG
Glycol	WC Method	<b>NEG</b>	NEG	NEG

## WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >50	<b>8</b>	6	7
Chromium	ppm ASTM D5185m >4	<b>&lt;1</b>	<1	<1
Nickel	ppm ASTM D5185m >2	<b>&lt;1</b>	0	<1
Titanium	ppm ASTM D5185m	<b>1</b>	<1	<1
Silver	ppm ASTM D5185m >5	<b>0</b>	0	0
Aluminum	ppm ASTM D5185m >12	<b>4</b>	2	3
Lead	ppm ASTM D5185m >17	<b>&lt;1</b>	0	<1
Copper	ppm ASTM D5185m >70	<b>3</b>	<1	<1
Tin	ppm ASTM D5185m >15	<b>&lt;1</b>	0	<1
Vanadium	ppm ASTM D5185m	<b>&lt;1</b>	<1	0
Cadmium	ppm ASTM D5185m	<b>&lt;1</b>	0	<1

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	<b>416</b>	332	360
Barium	ppm ASTM D5185m	<b>2</b>	0	11
Molybdenum	ppm ASTM D5185m	<b>144</b>	137	134
Manganese	ppm ASTM D5185m	<b>1</b>	1	2
Magnesium	ppm ASTM D5185m	<b>710</b>	701	673
Calcium	ppm ASTM D5185m	<b>1665</b>	1705	1614
Phosphorus	ppm ASTM D5185m 1200	<b>789</b>	742	717
Zinc	ppm ASTM D5185m 1300	<b>892</b>	887	865
Sulfur	ppm ASTM D5185m 3200	<b>2989</b>	2643	2951

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >25	<b>8</b>	7	8
Sodium	ppm ASTM D5185m	<b>0</b>	<1	0
Potassium	ppm ASTM D5185m >20	<b>2</b>	<1	2
Fuel	% ASTM D3524 >4.0	<b>▲ 2.4</b>	<1.0	<1.0

## INFRA-RED





method	limit/base	current	history1	history2
Soot %	% *ASTM D7844	<b>0.1</b>	0.1	0.1
Nitration	Abs/cm *ASTM D7624 >20	<b>7.6</b>	7.4	7.7
Sulfation	Abs/.1mm *ASTM D7415 >30	<b>23.0</b>	23.5	23.4

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Oxidation	Abs/.1mm *ASTM D7414 >25	<b>17.2</b>	17.6	17.8
Base Number (BN)	mg KOH/g ASTM D2896 9.6	<b>8.9</b>	8.8	8.9







# OIL ANALYSIS REPORT

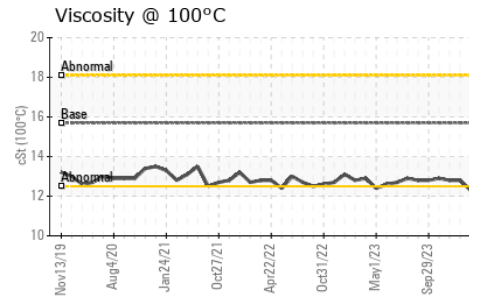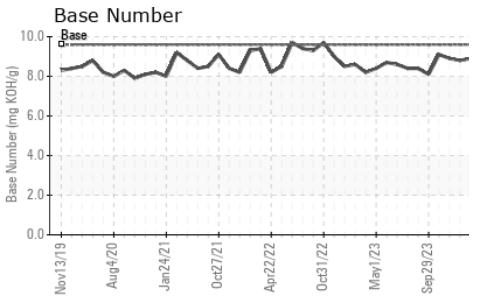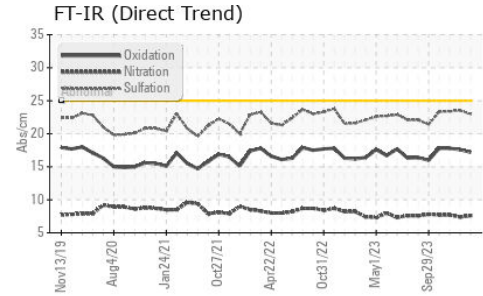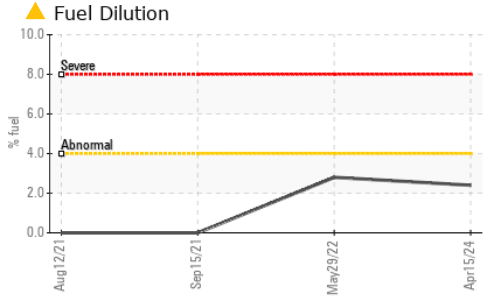

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	15.7	12.3	12.8

## GRAPHS

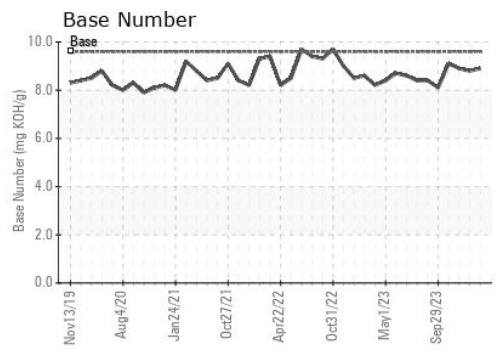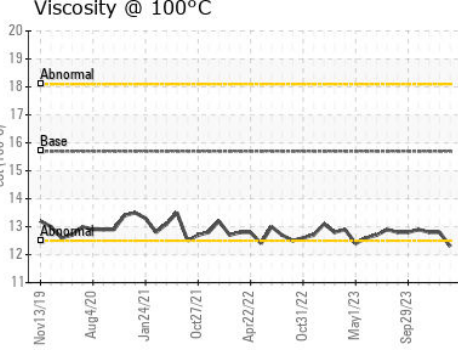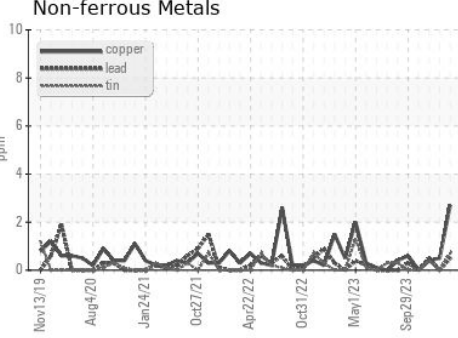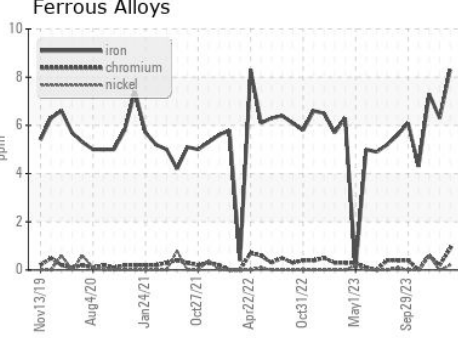

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : MW0066006 **Received** : 10 May 2024  
**Lab Number** : 06176616 **Tested** : 15 May 2024  
**Unique Number** : 11022669 **Diagnosed** : 15 May 2024 - Wes Davis  
**Test Package** : MAR 2 ( Additional Tests: FuelDilution, PercentFuel )

**INGRAM BARGE**  
 900 S 3RD ST  
 PADUCAH, KY  
 US 42003  
 Contact: ALLEN WILLHELM  
 allen.willhelm@ingrambarge.com  
 T: (270)415-4467  
 F: (615)695-3697

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)