




# OIL ANALYSIS REPORT

## Sample Rating Trend

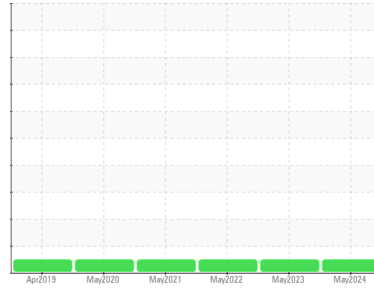

**NORMAL**



Area  
**(EQ2588) W**  
 Machine Id  
**Pembroke BPS (S/N 4624888G)**  
 Component  
**Diesel Engine**  
 Fluid  
**PETRO CANADA DURON UHP 5W40 (16 QTS)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

#### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0934069</b>	WC0810887	WC0696108
Sample Date	Client Info		<b>08 May 2024</b>	18 May 2023	11 May 2022
Machine Age	hrs	Client Info	<b>742</b>	709	680
Oil Age	hrs	Client Info	<b>62</b>	144	0
Oil Changed	Client Info		<b>Not Chngd</b>	Not Chngd	Changed
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

### CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>3.0	<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method	>0.2	<b>NEG</b>	NEG	NEG
Glycol	WC Method		<b>NEG</b>	NEG	NEG

### WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >90	<b>3</b>	<1	2
Chromium	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	<1
Nickel	ppm	ASTM D5185m >2	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >2	<b>48</b>	47	48
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >20	<b>&lt;1</b>	<1	1
Lead	ppm	ASTM D5185m >40	<b>&lt;1</b>	0	<1
Copper	ppm	ASTM D5185m >330	<b>0</b>	0	<1
Tin	ppm	ASTM D5185m >15	<b>0</b>	0	<1
Antimony	ppm	ASTM D5185m	<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Cadmium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0

### ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 65	<b>107</b>	120	119
Barium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 65	<b>24</b>	21	23
Manganese	ppm	ASTM D5185m 0	<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m 1160	<b>775</b>	713	809
Calcium	ppm	ASTM D5185m 820	<b>1243</b>	1212	1304
Phosphorus	ppm	ASTM D5185m 1160	<b>1039</b>	948	1071
Zinc	ppm	ASTM D5185m 1260	<b>1221</b>	1174	1195
Sulfur	ppm	ASTM D5185m 3000	<b>4172</b>	3732	3320

### CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>4</b>	3	3
Sodium	ppm	ASTM D5185m	<b>6</b>	5	6
Potassium	ppm	ASTM D5185m >20	<b>1</b>	0	<1

### INFRA-RED




	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844 >6	<b>0.1</b>	0.1	0.1
Nitration	Abs/cm	*ASTM D7624 >20	<b>7.7</b>	7.4	6.5
Sulfation	Abs/.1mm	*ASTM D7415 >30	<b>17.7</b>	17.7	17.1

### FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	<b>14.7</b>	14.6	13.5
Base Number (BN)	mg KOH/g	ASTM D2896 11.0	<b>7.6</b>	8.3	8.2











# OIL ANALYSIS REPORT

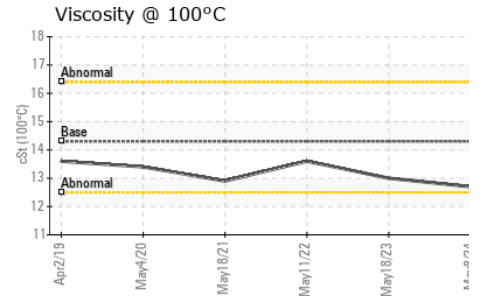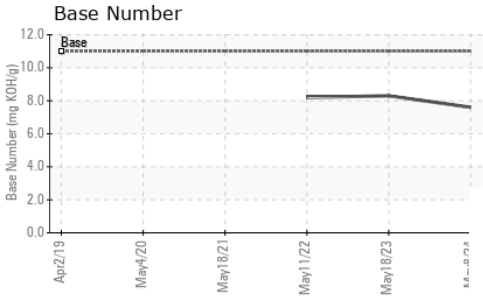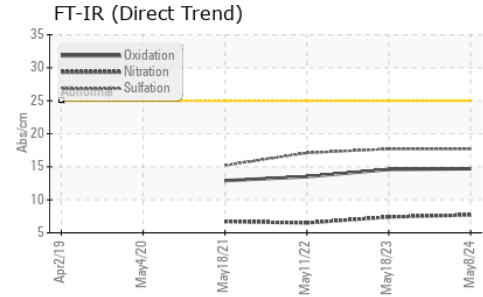

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445	14.3	12.7	13.0	13.6

### GRAPHS

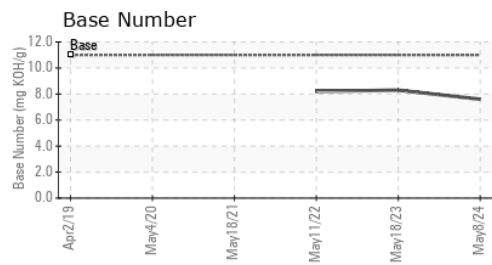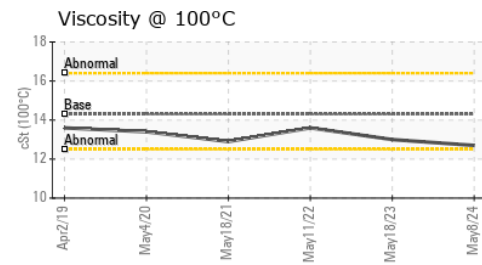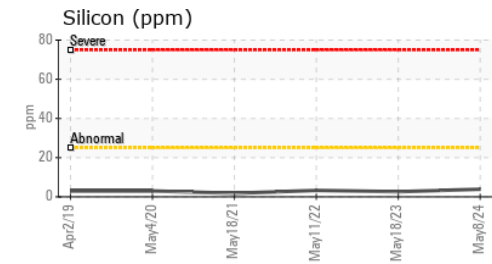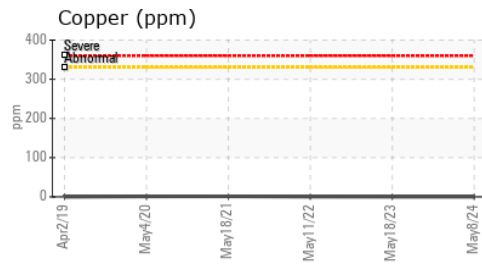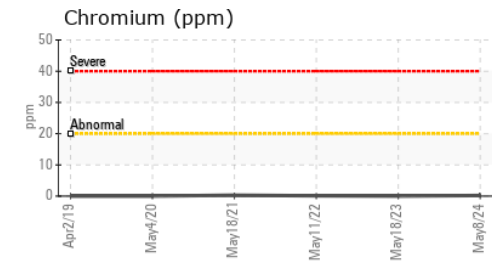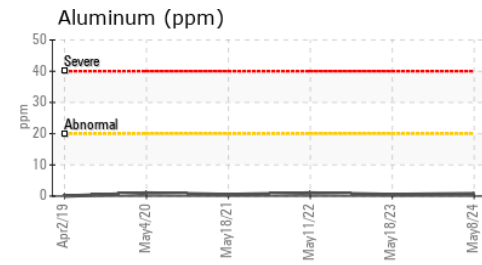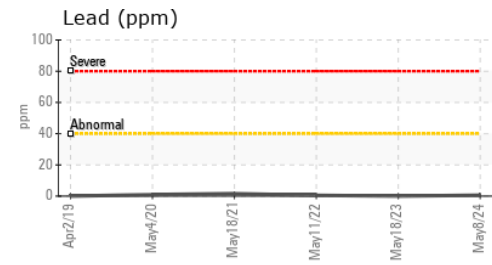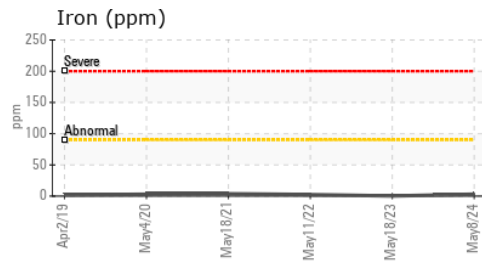

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0934069      **Received** : 13 May 2024  
**Lab Number** : 06176916      **Tested** : 14 May 2024  
**Unique Number** : 11022969      **Diagnosed** : 14 May 2024 - Sean Felton  
**Test Package** : MOB 1 ( Additional Tests: TBN )

**MONROE COUNTY WATER AUTHORITY**  
 4799 DEWEY AVE  
 ROCHESTER, NY  
 US 14612

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact: SCOTT TRAIL  
 scott.trail@mcwa.com  
 T: (585)775-5257  
 F: