




# OIL ANALYSIS REPORT

Sample Rating Trend

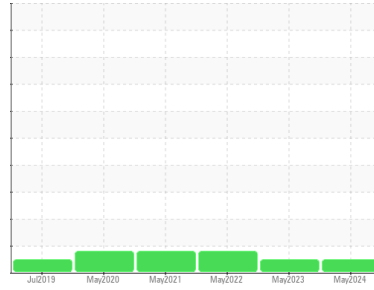

**NORMAL**



Area

(EQ2631) W

Machine Id

Riga BPS (S/N 44748675)

Component

Diesel Engine

Fluid

KENDALL SHP 5W40 Diesel Engine Oil (20 QTS)

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0934068</b>	WC0810886	WC05548116
Sample Date	Client Info		<b>08 May 2024</b>	18 May 2023	17 May 2022
Machine Age	hrs	Client Info	<b>1022</b>	1003	0
Oil Age	hrs	Client Info	<b>1022</b>	27	0
Oil Changed	Client Info		<b>Not Chngd</b>	Not Chngd	N/A
Sample Status			<b>NORMAL</b>	NORMAL	MARGINAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>3.0	<b>&lt;1.0</b>	<1.0	▲ 2.1
Water	WC Method	>0.2	<b>NEG</b>	NEG	NEG
Glycol	WC Method		<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>90	<b>2</b>	1	2
Chromium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>2	<b>2</b>	<1	<1
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	1
Lead	ppm	ASTM D5185m	>40	<b>1</b>	<1	<1
Copper	ppm	ASTM D5185m	>330	<b>2</b>	1	1
Tin	ppm	ASTM D5185m	>15	<b>0</b>	<1	<1
Antimony	ppm	ASTM D5185m		<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		<b>64</b>	66	73
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>52</b>	48	54
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
Magnesium	ppm	ASTM D5185m		<b>986</b>	929	1055
Calcium	ppm	ASTM D5185m		<b>1034</b>	954	1056
Phosphorus	ppm	ASTM D5185m		<b>1084</b>	987	1134
Zinc	ppm	ASTM D5185m	1288	<b>1290</b>	1239	1272
Sulfur	ppm	ASTM D5185m		<b>4028</b>	3694	3249

## CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>25	<b>3</b>	2	3
Sodium	ppm	ASTM D5185m		<b>2</b>	2	<1
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	<1	0

## INFRA-RED




	method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844	>6	<b>0.1</b>	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	>20	<b>7.2</b>	7.8	6.1
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>18.0</b>	17.5	17.5

## FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>16.4</b>	15.9	15.2
Base Number (BN)	mg KOH/g	ASTM D2896	10.2	<b>8.5</b>	9.2	8.9











# OIL ANALYSIS REPORT

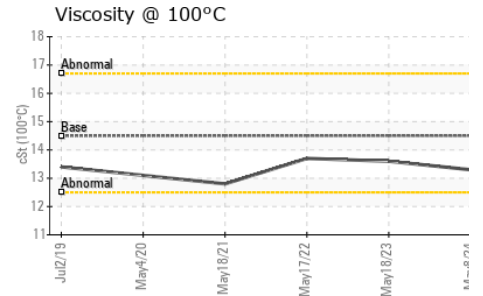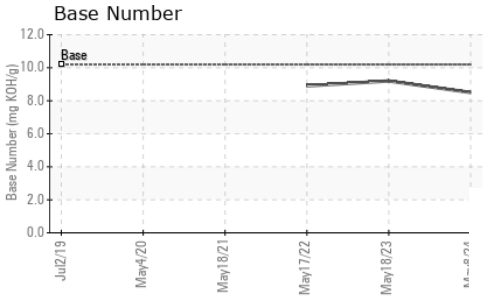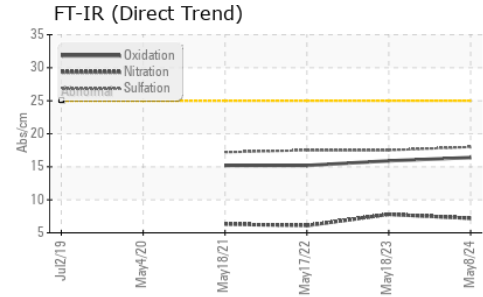

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445	14.5	<b>13.3</b>	13.6	13.7

### GRAPHS

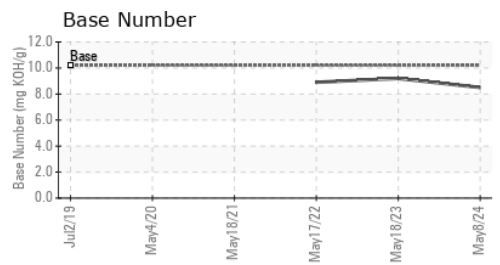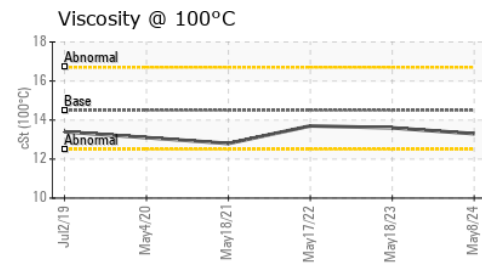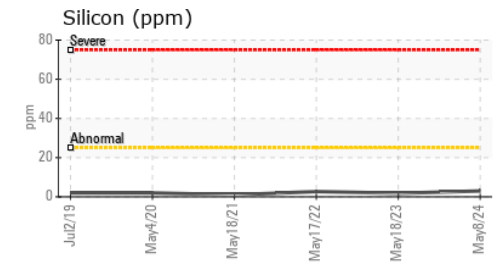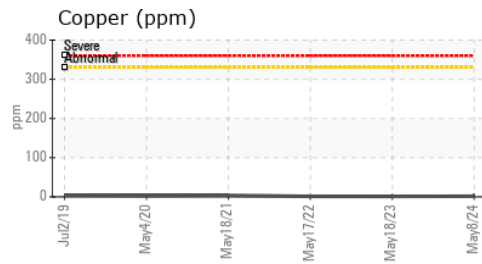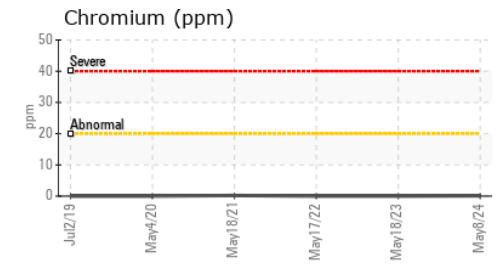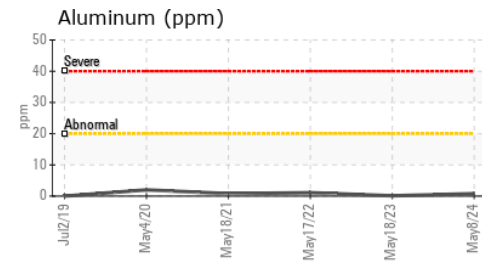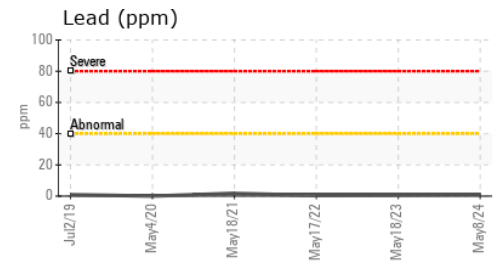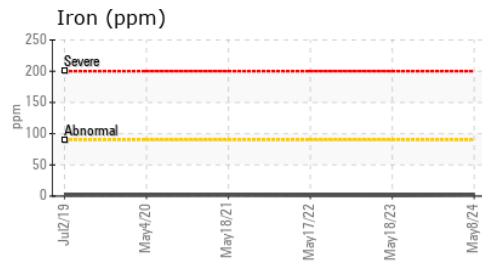

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0934068      **Received** : 13 May 2024  
**Lab Number** : **06176917**      **Tested** : 14 May 2024  
**Unique Number** : 11022970      **Diagnosed** : 14 May 2024 - Sean Felton  
**Test Package** : MOB 1 ( Additional Tests: TBN )

**MONROE COUNTY WATER AUTHORITY**  
 4799 DEWEY AVE  
 ROCHESTER, NY  
 US 14612  
 Contact: SCOTT TRAIL  
 scott.trail@mcwa.com  
 T: (585)775-5257  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)