




# OIL ANALYSIS REPORT

Sample Rating Trend

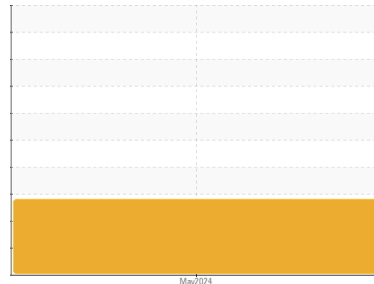

**WATER**



Machine Id

**NOT GIVEN PH0001468 (S/N NO INFO ON SIF/BOTTLE)**

Component

**Hydraulic System**

Fluid

{not provided} (--- GAL)

## DIAGNOSIS

### ▲ Recommendation

We advise that you check for the source of water entry. We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. We advise that you inspect for possible wear. Resample at the next service interval to monitor. We were unable to perform a particle count due to metal particles present in this sample.

### ▲ Wear

Moderate concentration of visible metal present. All component wear rates are normal.

### ▲ Contamination

There is a moderate concentration of water present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>PH0001468</b>	---	---
Sample Date	Client Info		<b>12 May 2024</b>	---	---
Machine Age	hrs	Client Info	<b>0</b>	---	---
Oil Age	hrs	Client Info	<b>0</b>	---	---
Oil Changed	Client Info		<b>N/A</b>	---	---
Sample Status			<b>ABNORMAL</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	<b>0</b>	---	---
Chromium	ppm	ASTM D5185m >20	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m >20	<b>&lt;1</b>	---	---
Titanium	ppm	ASTM D5185m	<b>0</b>	---	---
Silver	ppm	ASTM D5185m	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >20	<b>&lt;1</b>	---	---
Lead	ppm	ASTM D5185m >20	<b>0</b>	---	---
Copper	ppm	ASTM D5185m >20	<b>3</b>	---	---
Tin	ppm	ASTM D5185m >20	<b>1</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	---	---
Barium	ppm	ASTM D5185m	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m	<b>1</b>	---	---
Magnesium	ppm	ASTM D5185m	<b>2</b>	---	---
Calcium	ppm	ASTM D5185m	<b>5</b>	---	---
Phosphorus	ppm	ASTM D5185m	<b>642</b>	---	---
Zinc	ppm	ASTM D5185m	<b>0</b>	---	---
Sulfur	ppm	ASTM D5185m	<b>3904</b>	---	---


## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>&lt;1</b>	---	---
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	---	---
Water	%	ASTM D6304 >0.05	<b>▲ 0.473</b>	---	---
ppm Water	ppm	ASTM D6304 >500	<b>▲ 4730</b>	---	---

## FLUID DEGRADATION


	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.42</b>	---	---

Particle Filter (Magn: 200 x)

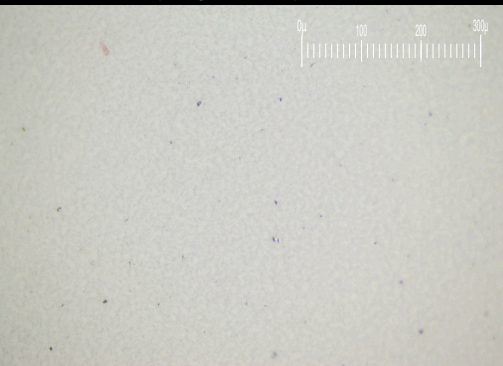



# OIL ANALYSIS REPORT

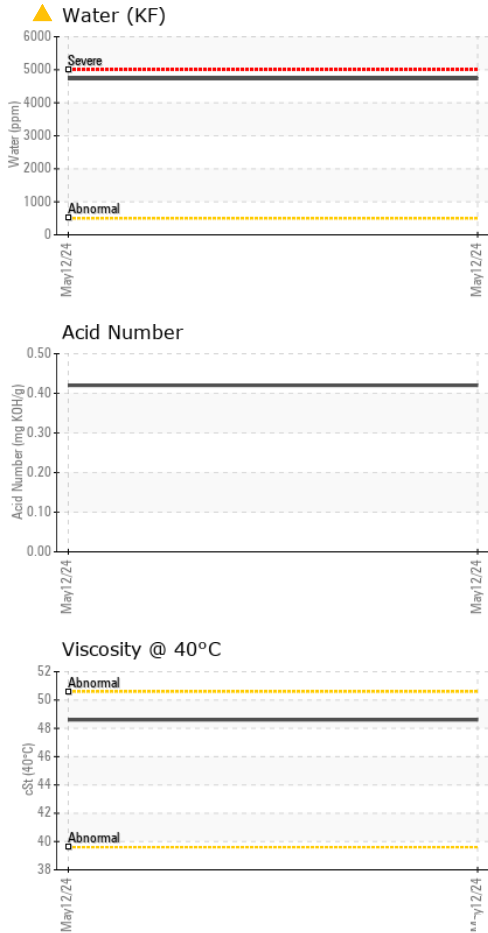



VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	▲ MODER	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	0.2%	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	48.6	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image
PrtFilter				no image	no image

## GRAPHS

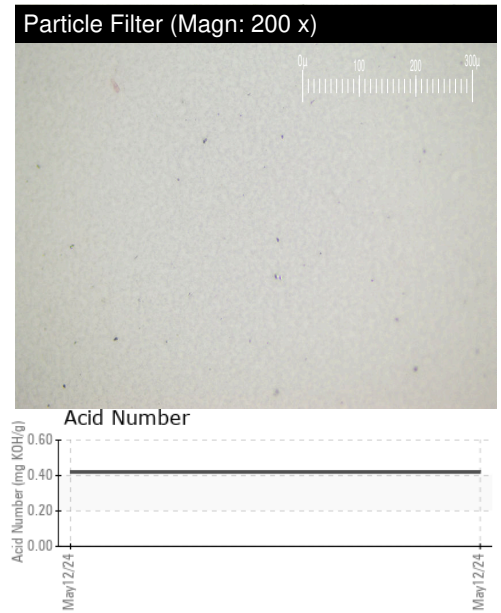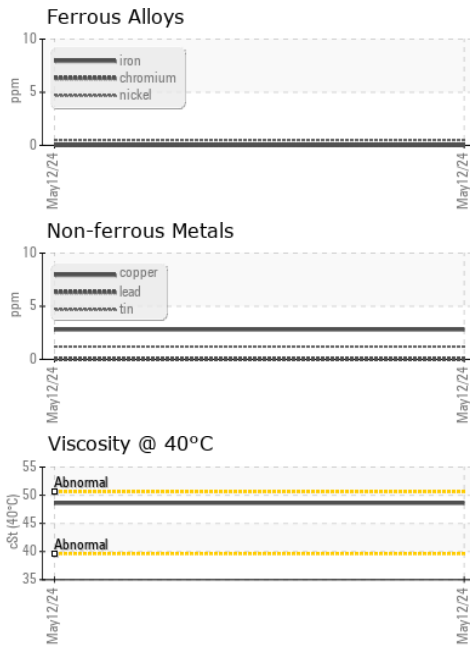

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PH0001468      **Received** : 13 May 2024  
**Lab Number** : 06177093      **Tested** : 16 May 2024  
**Unique Number** : 11023146      **Diagnosed** : 16 May 2024 - Jonathan Hester  
**Test Package** : PLANT ( Additional Tests: KF, PrtFilter )

**HYDRADYNE LLC**  
 15050 FAA BLVD  
 FORT WORTH, TX  
 US 76155  
 Contact: JACK DAVIS  
 jdavis@hydradynellc.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)