

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

8015531 (S/N 1797) Component Compressor

Compressor Fluid KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA015877		
Sample Date		Client Info		21 Feb 2024		
Machine Age	hrs	Client Info		8840		
Oil Age	hrs	Client Info		3000		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	5		
Tin		ASTM D5185m	>50	ວ <1		
Vanadium	ppm	ASTM D5185m	×10	<1		
	ppm					
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	65		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		1		
Magnesium	ppm	ASTM D5185m	100	85		
Calcium	ppm	ASTM D5185m	0	<1		
Phosphorus	ppm	ASTM D5185m	0	0		
Zinc	ppm	ASTM D5185m	0	0		
Sulfur	ppm	ASTM D5185m	23500	21956		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		19		
Potassium	ppm	ASTM D5185m	>20	<1		
Water	%	ASTM D6304	>0.05	0.011		
ppm Water	ppm	ASTM D6304	>500	112		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2570		
Particles >6µm		ASTM D7647	>1300	760		
Particles >14µm		ASTM D7647	>80	70		
Particles >21µm		ASTM D7647	>20	12		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/13		
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.31		



OIL ANALYSIS REPORT

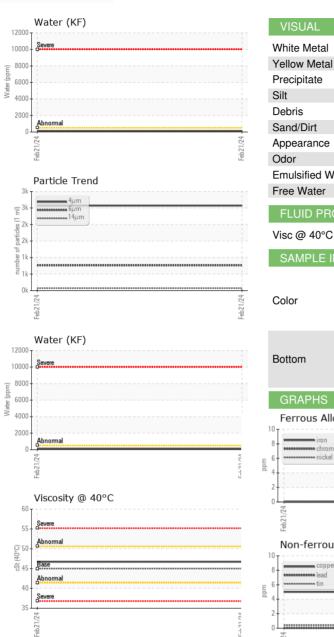

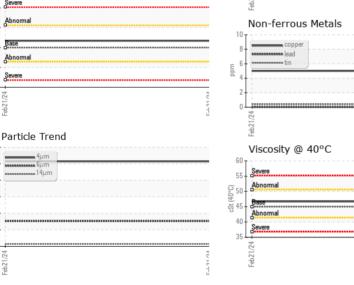

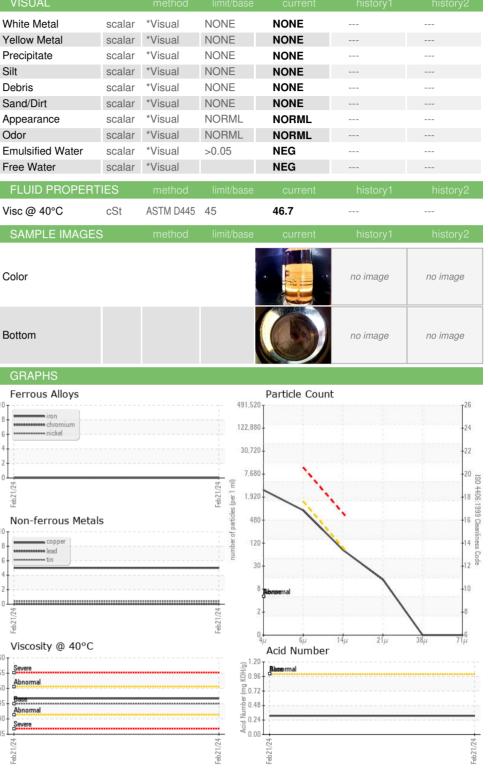



Ē3

50 ZI

te 2k

3 1

0

Feb21

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513 AMS SENSORS OSRAM Sample No. : KCPA015877 Received : 13 May 2024 1100 W IDAHO ST, SUITE 430 Lab Number : 06177130 Tested : 14 May 2024 BOISE, ID Unique Number : 11023183 Diagnosed : 14 May 2024 - Don Baldridge US 83702 Test Package : IND 2 (Additional Tests: KF, PrtCount) Contact: DANIEL MAHAN Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369. daniel.mahan@ams-osram.com * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: AMSBOI [WUSCAR] 06177130 (Generated: 05/14/2024 19:26:10) Rev: 1

Contact/Location: DANIEL MAHAN - AMSBOI

T:

F: