

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

9064442 (S/N 1505)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Sep 2023	May2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
	MATION		IIIIII/Dase		•	HISTOLYZ
Sample Number		Client Info		KC124984	KC05970363	
Sample Date	lawa	Client Info		09 May 2024	29 Sep 2023	
Machine Age	hrs	Client Info		7154	2177	
Oil Age	hrs	Client Info		0	0	
Oil Changed		Client Info		N/A NORMAL	N/A ABNORMAL	
Sample Status						
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	2	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	2	<u> 11</u>	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	5	<1	
Tin	ppm	ASTM D5185m	>10	<1	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		1	0	
Magnesium	ppm	ASTM D5185m	90	14	<1	
Calcium	ppm	ASTM D5185m	2	0	0	
Phosphorus	ppm	ASTM D5185m		4	47	
Zinc	ppm	ASTM D5185m		0	0	
CONTAMINANTS			limit/base			history2
		method		current	history1	
Silicon	ppm	ASTM D5185m	>25	2	<1	
Sodium	ppm	ASTM D5185m		15 _	0	
Potassium	ppm	ASTM D5185m	>20	7	2	
Water	%	ASTM D6304	>0.05	0.016	0.004	
ppm Water	ppm	ASTM D6304	>500	163	42.9	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1709	2449	
Particles >6µm		ASTM D7647	>1300	292	599	
Particles >14μm		ASTM D7647	>80	21	36	
Particles >21µm		ASTM D7647	>20	7	8	
Particles >38μm		ASTM D7647	>4	1	0	
Particles >71μm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/15/12	18/16/12	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2

Acid Number (AN)


mg KOH/g ASTM D8045 0.4

0.186

0.39



OIL ANALYSIS REPORT

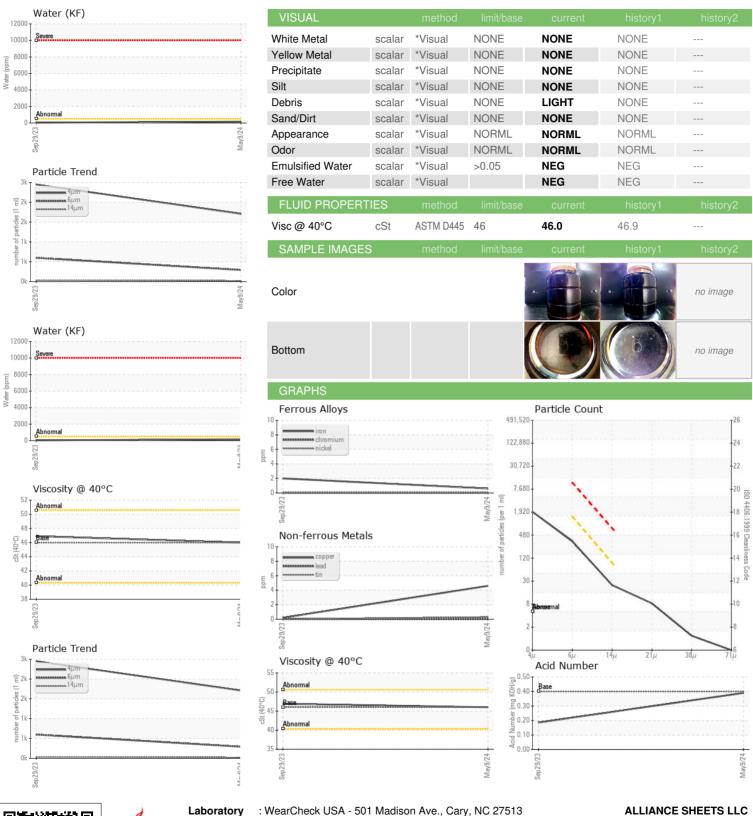





Certificate 12367

Laboratory Sample No. Lab Number

: KC124984 : 06177139 Unique Number : 11023192 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 13 May 2024 **Tested** : 14 May 2024 Diagnosed

: 14 May 2024 - Don Baldridge

1725 COMMERCE DR BRISTOL, IN US 46507

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: ALLBRIKC [WUSCAR] 06177139 (Generated: 05/14/2024 19:36:21) Rev: 1

Contact/Location: Service Manager - ALLBRIKC

T:

F: