

OIL ANALYSIS REPORT

Sample Rating Trend

ISO

Machine Id

8321505 (S/N 1574) Compressor

Fluid KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC122178	KC103108	
Sample Date		Client Info		28 Mar 2024	04 Aug 2023	
Machine Age	hrs	Client Info		4277	2124	
Oil Age	hrs	Client Info		0	2124	
Oil Changed		Client Info		N/A	Changed	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	<1	1	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	8	20	
Tin	ppm	ASTM D5185m	>10	<1	0	
Vanadium	ppm	ASTM D5185m		0	<1	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	21	0	
Molybdenum	ppm	ASTM D5185m	00	0	0	
Manganese	ppm	ASTM D5185m		1	<1	
Magnesium	ppm	ASTM D5185m	90	57	28	
Calcium	ppm	ASTM D5185m		0	0	
Phosphorus	ppm	ASTM D5185m		0	2	
Zinc	ppm	ASTM D5185m		0	14	
				-		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm		>25	1	<1	
Sodium	ppm	ASTM D5185m		16	13	
Potassium	ppm	ASTM D5185m	>20	<1	0	
Water	%	ASTM D6304	>0.05	0.025	0.011	
ppm Water	ppm	ASTM D6304	>500	253	115.7	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		19234	5226	
Particles >6µm		ASTM D7647	>1300	<u> </u>	<u> </u>	
Particles >14µm		ASTM D7647	>80	A 324	1 85	
Particles >21µm		ASTM D7647	>20	<u> </u>	▲ 32	
Particles >38µm		ASTM D7647	>4	1	1	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	A 21/20/16	🔺 20/19/15	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.36	0.27	





Built for a lifetime

OIL ANALYSIS REPORT





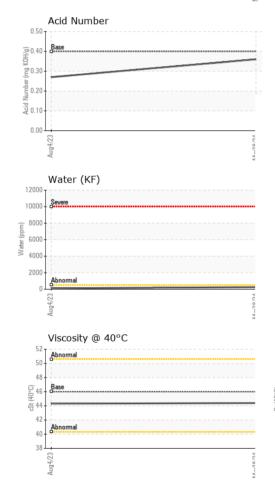

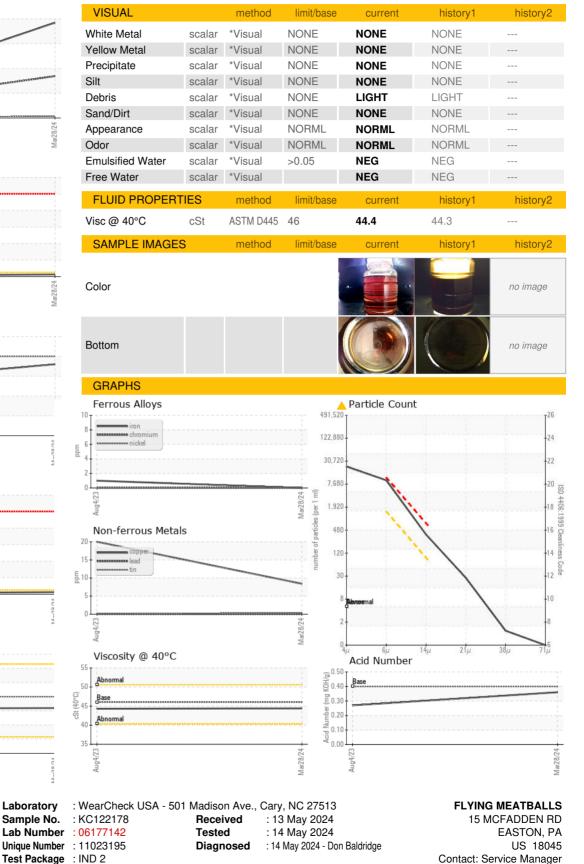

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F:

Certificate 12367

Laboratory

Sample No.

Contact/Location: Service Manager - FLYEAS Page 2 of 2