

# **OIL ANALYSIS REPORT**

Sample Rating Trend



Machine Id

## **KAESER 9199535**

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Apr2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC111508		
Sample Date		Client Info		16 Apr 2024		
Machine Age	hrs	Client Info		1692		
Oil Age	hrs	Client Info		1692		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum		ASTM D5185m	>10	<1		
	ppm			0		
Lead	ppm	ASTM D5185m	>10			
Copper	ppm	ASTM D5185m	>50	5		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	7		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		1		
Magnesium	ppm	ASTM D5185m	90	56		
Calcium	ppm	ASTM D5185m	2	0		
Phosphorus	ppm	ASTM D5185m		2		
Zinc	ppm	ASTM D5185m		0		
CONTAMINANTS			limit/bass	ourront.	historyd	hiotom/2
		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		12		
Potassium	ppm	ASTM D5185m	>20	<1		
Water	%	ASTM D6304	>0.05	0.023		
ppm Water	ppm	ASTM D6304	>500	231		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1989		
Particles >6µm		ASTM D7647	>1300	643		
Particles >14µm		ASTM D7647	>80	41		
Particles >21µm		ASTM D7647	>20	9		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/17/13		
	TION -	( )				history O
FLUID DEGRADA	NOIT	method	limit/base	current	history1	history2


Acid Number (AN)

mg KOH/g ASTM D8045 0.4

0.33



## **OIL ANALYSIS REPORT**

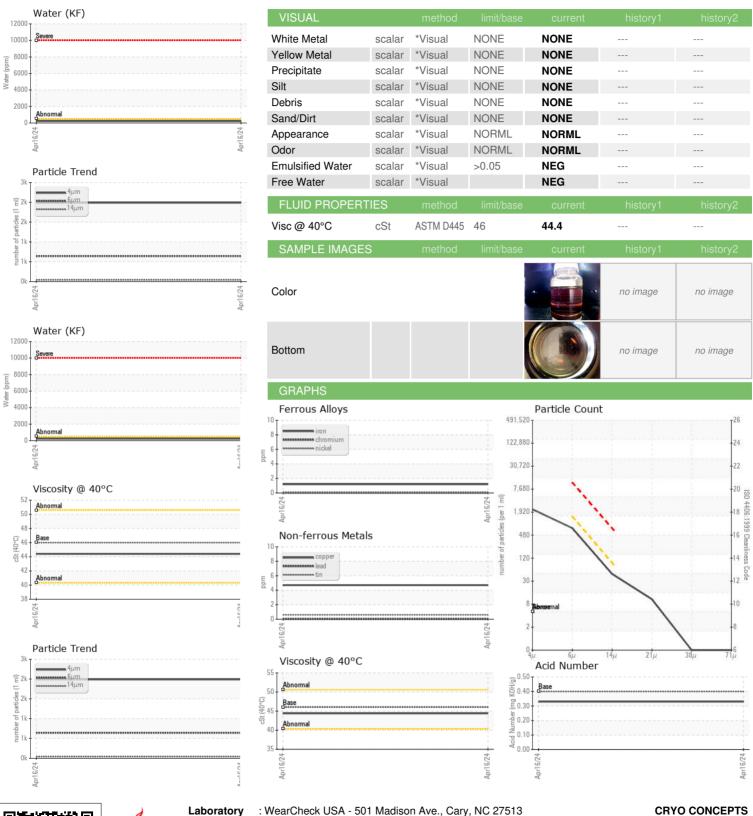



Certificate 12367

Sample No. : KC111508 Lab Number : 06177143 Unique Number : 11023196

Test Package : IND 2

Received : 13 May 2024 **Tested** : 14 May 2024

Diagnosed : 14 May 2024 - Don Baldridge

**CRYO CONCEPTS** 1100 CONROY PL EASTON, PA US 18040 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: