


# **OIL ANALYSIS REPORT**

Sample Rating Trend

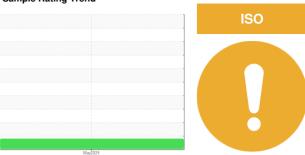

Machine Id

# 9064819 (S/N 1113)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

### Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

## Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				May2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC110508		
Sample Date		Client Info		02 May 2024		
Machine Age	hrs	Client Info		702		
Oil Age	hrs	Client Info		702		
Oil Changed		Client Info		Changed		
Sample Status				ATTENTION		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	6		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		1		
Magnesium	ppm	ASTM D5185m	90	54		
Calcium	ppm	ASTM D5185m	2	0		
Phosphorus	ppm	ASTM D5185m	_	2		
Zinc	ppm	ASTM D5185m		0		
-			11 11 11			
CONTAMINANTS	5	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		13		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304	>0.05	0.024		
ppm Water	ppm	ASTM D6304	>500	248		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		5761		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14µm		ASTM D7647	>80	57		
Particles >21µm		ASTM D7647	>20	6		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<b>20/18/13</b>		
FLUID DEGRADA	ATION _	method	limit/base	current	history1	history2


Acid Number (AN)

mg KOH/g ASTM D8045 0.4

0.37



# **OIL ANALYSIS REPORT**

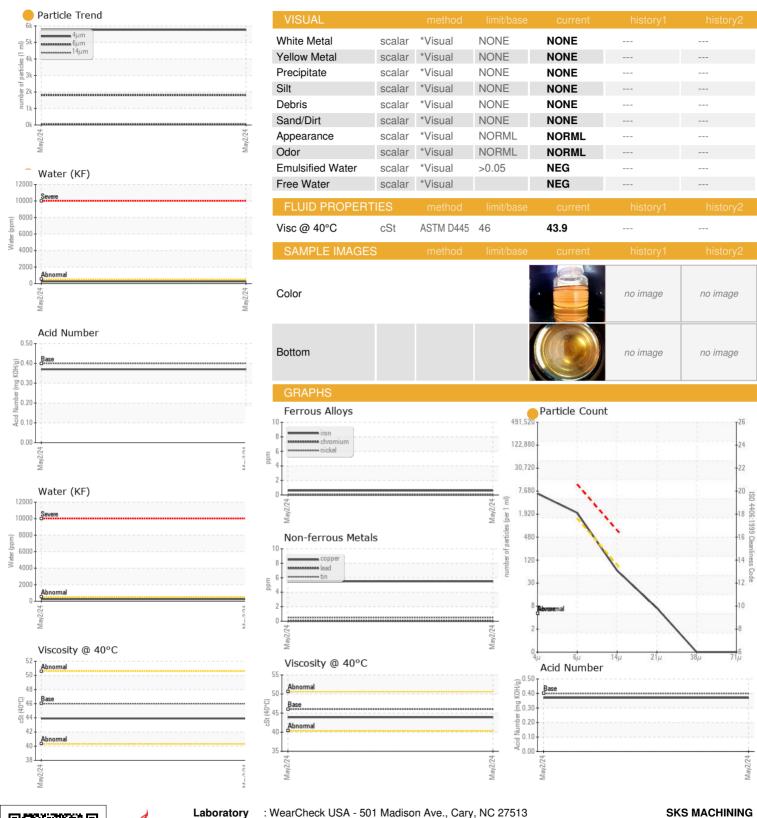



Certificate 12367

Sample No.

Laboratory : KC110508 Lab Number : 06177149 Unique Number : 11023202 Test Package : IND 2

Received : 13 May 2024 **Tested** : 14 May 2024 Diagnosed

: 14 May 2024 - Don Baldridge

134 SPORTSMAN TR STROUDSBURG, PA US 18360

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: