




# OIL ANALYSIS REPORT

Sample Rating Trend

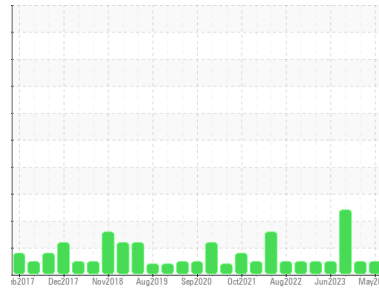

**NORMAL**



Machine Id  
**SULLAIR NORTH SULLAIR (S/N 003-122315)**  
 Component  
**Air Compressor**  
 Fluid  
**USPI AIR 46 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USPM36121</b>	USPM30766	USPM29978
Sample Date	Client Info		<b>12 May 2024</b>	27 Jan 2024	11 Oct 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0
Chromium	ppm	ASTM D5185m	>4	<b>0</b>	0
Nickel	ppm	ASTM D5185m	>4	<b>0</b>	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0
Silver	ppm	ASTM D5185m		<b>0</b>	0
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	0
Lead	ppm	ASTM D5185m	>20	<b>0</b>	0
Copper	ppm	ASTM D5185m	>40	<b>3</b>	0
Tin	ppm	ASTM D5185m	>5	<b>&lt;1</b>	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	0
Barium	ppm	ASTM D5185m	0	<b>0</b>	0
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0
Manganese	ppm	ASTM D5185m		<b>1</b>	<1
Magnesium	ppm	ASTM D5185m	0	<b>0</b>	0
Calcium	ppm	ASTM D5185m	0	<b>0</b>	<1
Phosphorus	ppm	ASTM D5185m	1	<b>1</b>	2
Zinc	ppm	ASTM D5185m	0	<b>0</b>	0
Sulfur	ppm	ASTM D5185m	0	<b>12</b>	0

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1
Sodium	ppm	ASTM D5185m		<b>1</b>	0
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0
Water	%	ASTM D6304	>0.2	<b>0.092</b>	0.001
ppm Water	ppm	ASTM D6304	>2000	<b>925</b>	0

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>528</b>	1524	21277
Particles >6µm	ASTM D7647	>2500	<b>185</b>	589	5363
Particles >14µm	ASTM D7647	>320	<b>45</b>	78	282
Particles >21µm	ASTM D7647	>80	<b>18</b>	25	64
Particles >38µm	ASTM D7647	>20	<b>1</b>	2	7
Particles >71µm	ASTM D7647	>4	<b>0</b>	0	2
Oil Cleanliness	ISO 4406 (c)	>--/18/15	<b>16/15/13</b>	18/16/13	22/20/15

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.05	<b>0.05</b>	0.12




# OIL ANALYSIS REPORT

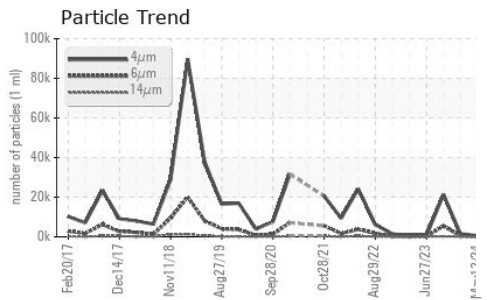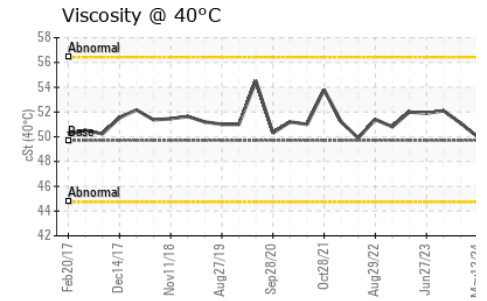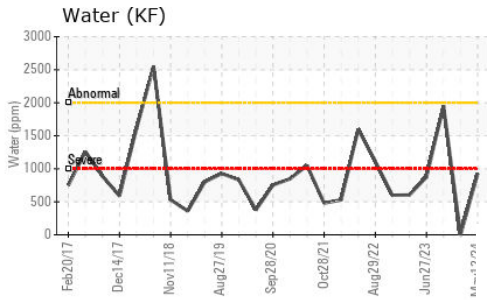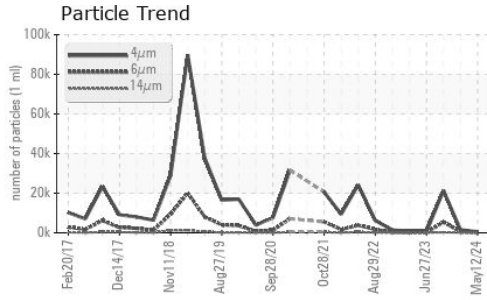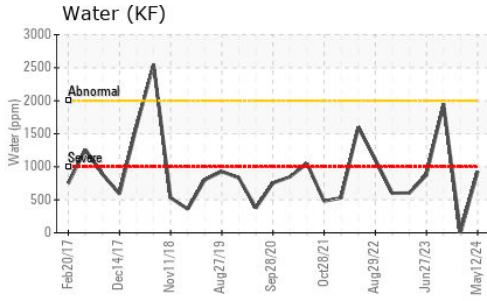






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	0.2%
Free Water	scalar	*Visual		NEG	▲ 1.0

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	49.7	50.0	51.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

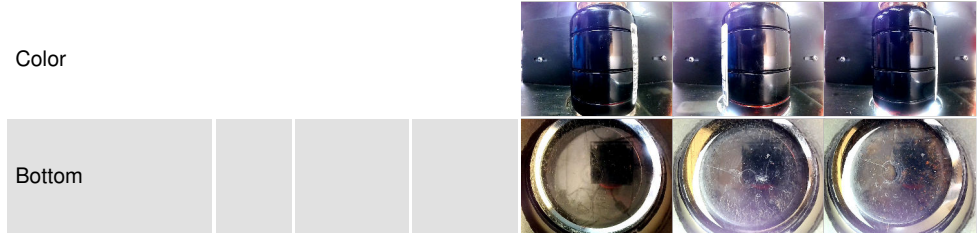

## GRAPHS

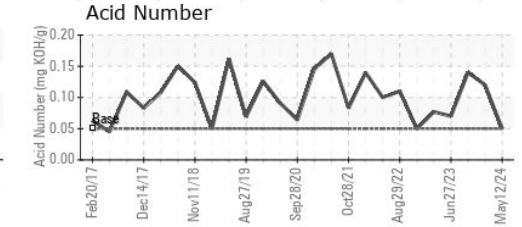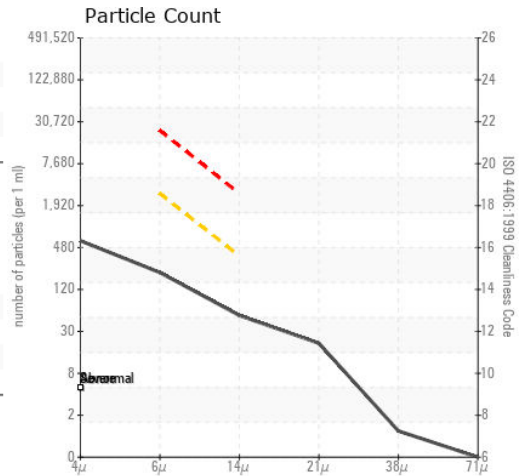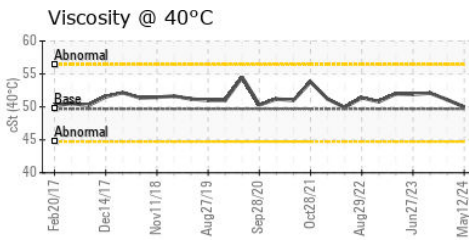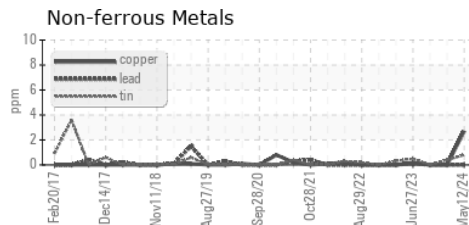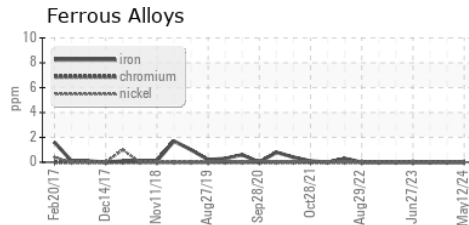

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : USPM36121  
 Lab Number : 06177179  
 Unique Number : 11023232  
 Test Package : IND 2

Received : 13 May 2024  
 Tested : 14 May 2024  
 Diagnosed : 14 May 2024 - Doug Bogart

TYSON-LOGANSPOUR-USP

LOGANSPOUR, IN  
 US  
 Contact: RICK DUVAL

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (402)423-6375  
 F: (402)423-6661