




# OIL ANALYSIS REPORT

Sample Rating Trend

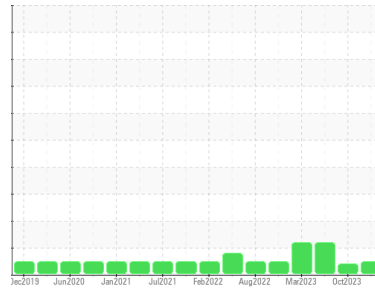

**NORMAL**



Machine Id  
**SULLAIR SULLAIR 3 (S/N 201907190050)**  
 Component  
**Air Compressor**  
 Fluid  
**USPI AIR 46 (20 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>USPM36118</b>	USPM29980	USPM27299
Sample Date	Client Info	<b>12 May 2024</b>	11 Oct 2023	27 Jun 2023
Machine Age	hrs Client Info	<b>0</b>	0	0
Oil Age	hrs Client Info	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	ABNORMAL	ATTENTION

## WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >50	<b>0</b>	0	0
Chromium	ppm ASTM D5185m >4	<b>0</b>	0	0
Nickel	ppm ASTM D5185m >4	<b>0</b>	0	0
Titanium	ppm ASTM D5185m	<b>0</b>	0	<1
Silver	ppm ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm ASTM D5185m >10	<b>0</b>	0	0
Lead	ppm ASTM D5185m >20	<b>0</b>	0	<1
Copper	ppm ASTM D5185m >40	<b>3</b>	<1	<1
Tin	ppm ASTM D5185m >5	<b>&lt;1</b>	0	<1
Vanadium	ppm ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm ASTM D5185m	<b>0</b>	0	<1

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm ASTM D5185m 0	<b>0</b>	0	<1
Molybdenum	ppm ASTM D5185m 0	<b>0</b>	0	<1
Manganese	ppm ASTM D5185m	<b>1</b>	0	<1
Magnesium	ppm ASTM D5185m 0	<b>0</b>	<1	6
Calcium	ppm ASTM D5185m 0	<b>0</b>	0	1
Phosphorus	ppm ASTM D5185m 1	<b>26</b>	26	31
Zinc	ppm ASTM D5185m 0	<b>0</b>	0	4
Sulfur	ppm ASTM D5185m 0	<b>61</b>	10	35

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >25	<b>&lt;1</b>	<1	1
Sodium	ppm ASTM D5185m	<b>3</b>	2	3
Potassium	ppm ASTM D5185m >20	<b>0</b>	2	2
Water	% ASTM D6304 >0.2	<b>0.104</b>	0.135	0.138
ppm Water	ppm ASTM D6304 >2000	<b>1044</b>	1358.6	1388.6

## FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	<b>929</b>	---	1836
Particles >6µm	ASTM D7647 >2500	<b>192</b>	---	636
Particles >14µm	ASTM D7647 >320	<b>17</b>	---	85
Particles >21µm	ASTM D7647 >80	<b>5</b>	---	30
Particles >38µm	ASTM D7647 >20	<b>0</b>	---	1
Particles >71µm	ASTM D7647 >4	<b>0</b>	---	0
Oil Cleanliness	ISO 4406 (c) >--/18/15	<b>17/15/11</b>	---	18/16/14

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045 0.05	<b>1.49</b>	1.61	1.57




# OIL ANALYSIS REPORT

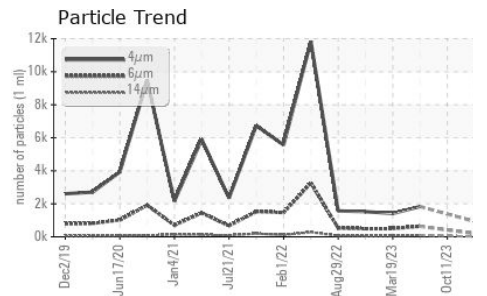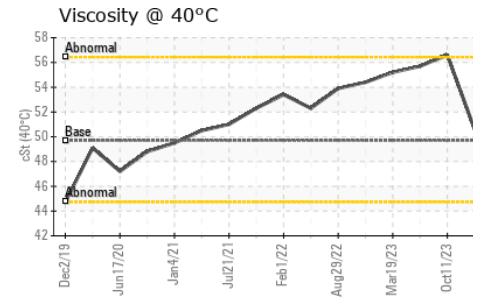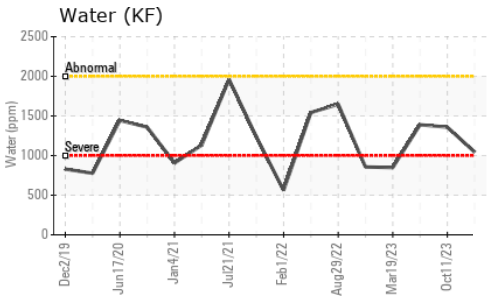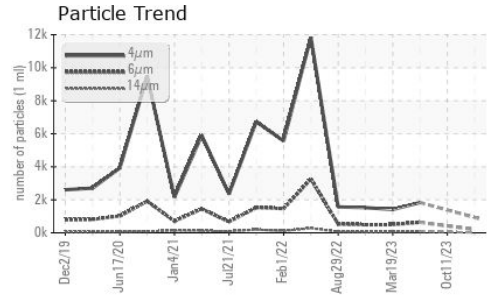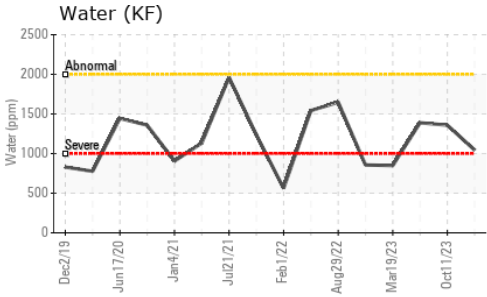






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	49.7	50.6	56.6	55.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

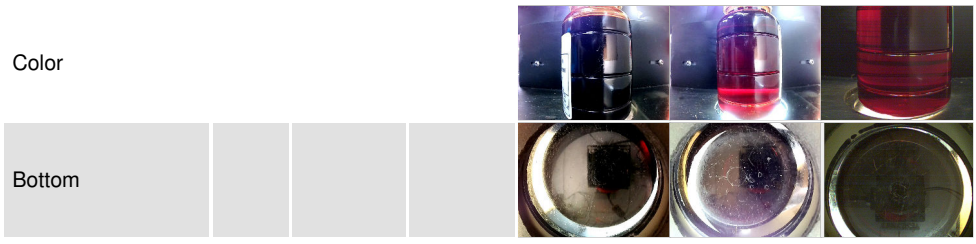

## GRAPHS

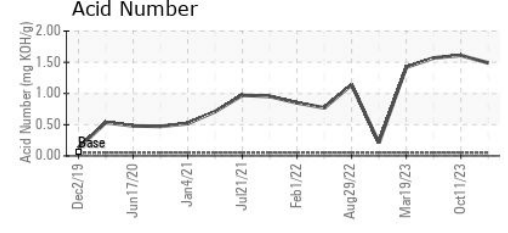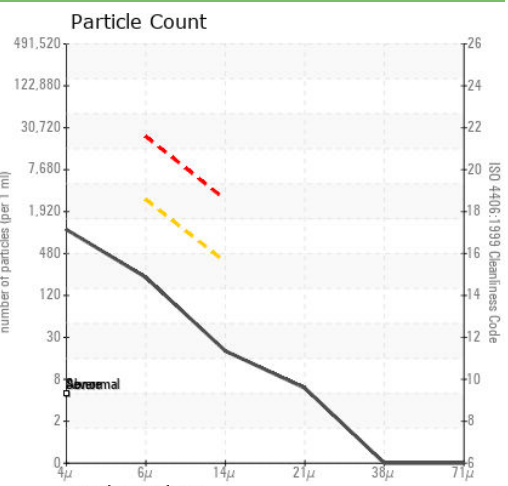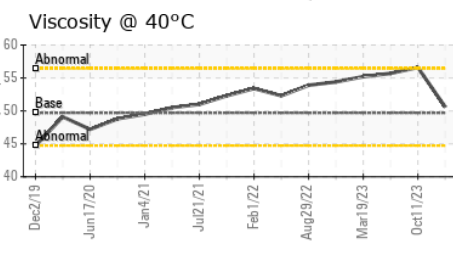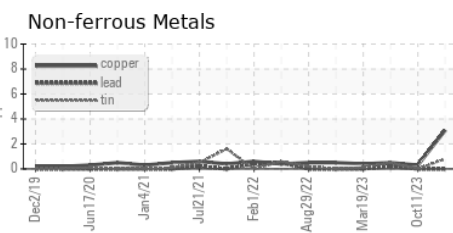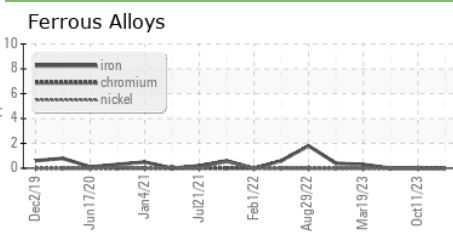

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USPM36118      **Received** : 13 May 2024  
**Lab Number** : 06177183      **Tested** : 14 May 2024  
**Unique Number** : 11023236      **Diagnosed** : 14 May 2024 - Doug Bogart  
**Test Package** : IND 2

**TYSON-LOGANSPOURT-USP**  
  
 LOGANSPOURT, IN  
 US  
 Contact: RICK DUVAL

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (402)423-6375  
 F: (402)423-6661