

OIL ANALYSIS REPORT

Sample Rating Trend







Machine Id
6KP100
Component
Compressor
Fluid
6KP100 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				May2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0011412		
Sample Date		Client Info		10 May 2024		
Machine Age	bro	Client Info		•		
	hrs hrs	Client Info		0		
Oil Age Oil Changed	1115	Client Info		N/A		
Sample Status		Chefit iiiio		NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	<1		
Lead	ppm	ASTM D5185m	>25	0		
Copper	ppm	ASTM D5185m	>50	3		
Tin	ppm	ASTM D5185m	>15	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		1		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		40		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m		132		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		1		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304	>0.1	0.003		
ppm Water	ppm	ASTM D6304	>1000	29		
FLUID CLEANLIN	ESS _	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	448		
Particles >6µm		ASTM D7647	>2500	86		
Particles >14µm		ASTM D7647	>320	12		
Particles >21µm		ASTM D7647	>80	5		
Particles >38µm		ASTM D7647	>20	1		
Particles >71µm		ASTM D7647	>4	1		
Oil Cleanliness		ISO 4406 (c)	>20/18/15	16/14/11		
FLUID DEGRADA	TION_	method	limit/base	current	history1	history2
A stat Nieusele au (ANN	KOII/	40TM D0045		0.15		


Acid Number (AN)

mg KOH/g ASTM D8045

0.15



OIL ANALYSIS REPORT

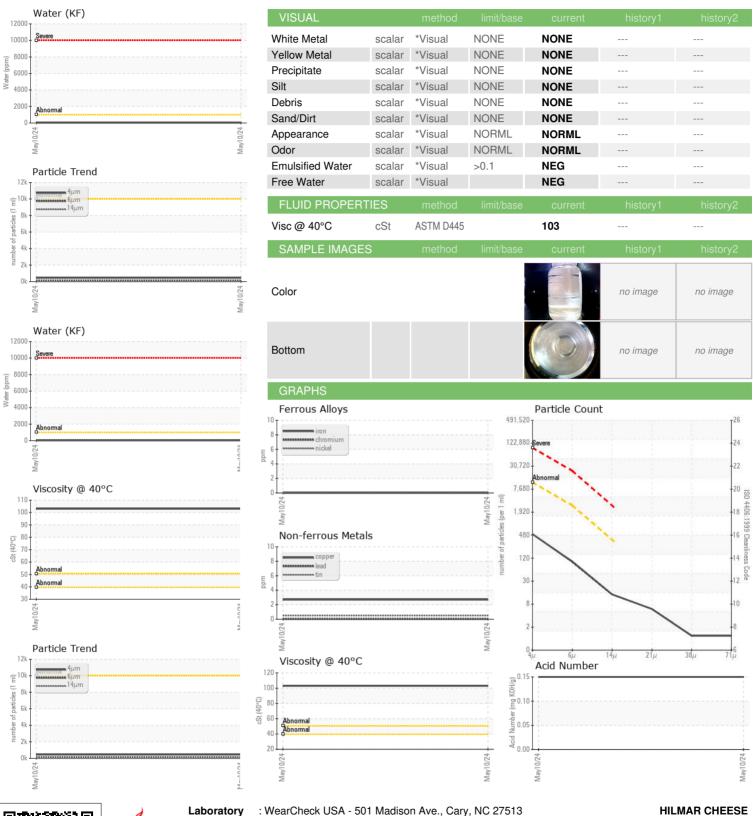



Certificate 12367

Laboratory Sample No. Lab Number : 06177196

Test Package : IND 2

: USP0011412

Received **Tested** Unique Number : 11023249

: 14 May 2024 : 14 May 2024 - Doug Bogart Diagnosed

: 13 May 2024

US Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F:

DALHART, TX