

## **OIL ANALYSIS REPORT**

Sample Rating Trend

**...........** 

### NORMAL

### Machine Id DUNHAM BUSH TYSBBOW HS-9 (S/N X983B)

Component Refrigeration Compressor

USPI ALT-68 SC (--- GAL)

#### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

#### Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


| SAMPLE INFORM    | <b>MATION</b> | method       | limit/base | current     | history1    | history2    |
|------------------|---------------|--------------|------------|-------------|-------------|-------------|
| Sample Number    |               | Client Info  |            | USP0011391  | USP0004213  | USP0000212  |
| Sample Date      |               | Client Info  |            | 12 May 2024 | 14 Dec 2023 | 04 Sep 2023 |
| Machine Age      | hrs           | Client Info  |            | 0           | 0           | 0           |
| Oil Age          | hrs           | Client Info  |            | 0           | 0           | 0           |
| Oil Changed      |               | Client Info  |            | N/A         | N/A         | N/A         |
| Sample Status    |               |              |            | NORMAL      | NORMAL      | NORMAL      |
| WEAR METALS      |               | method       | limit/base | current     | history1    | history2    |
| Iron             | ppm           | ASTM D5185m  | >50        | <1          | 0           | <1          |
| Chromium         | ppm           | ASTM D5185m  | >10        | 0           | 0           | 0           |
| Nickel           | ppm           | ASTM D5185m  |            | 0           | <1          | <1          |
| Titanium         | ppm           | ASTM D5185m  |            | 0           | 0           | 0           |
| Silver           | ppm           | ASTM D5185m  |            | 0           | 0           | 0           |
| Aluminum         | ppm           | ASTM D5185m  | >25        | 0           | 0           | 0           |
| Lead             |               | ASTM D5185m  | >25        | 0           | 0           | 0           |
|                  | ppm           |              |            | 0           |             |             |
| Copper           | ppm           |              | >50        | -           | 0           | 0           |
| Tin              | ppm           | ASTM D5185m  | >15        | <1          | 0           | 0           |
| Vanadium         | ppm           | ASTM D5185m  |            | 0           | 0           | 0           |
| Cadmium          | ppm           | ASTM D5185m  |            | 0           | 0           | 0           |
| ADDITIVES        |               | method       | limit/base | current     | history1    | history2    |
| Boron            | ppm           | ASTM D5185m  |            | 0           | 0           | 0           |
| Barium           | ppm           | ASTM D5185m  |            | 0           | 0           | 0           |
| Molybdenum       | ppm           | ASTM D5185m  |            | 0           | 0           | 0           |
| Manganese        | ppm           | ASTM D5185m  |            | 1           | 0           | 0           |
| Magnesium        | ppm           | ASTM D5185m  |            | 0           | <1          | <1          |
| Calcium          | ppm           | ASTM D5185m  |            | 0           | 0           | <1          |
| Phosphorus       | ppm           | ASTM D5185m  |            | 0           | 1           | 1           |
| Zinc             | ppm           | ASTM D5185m  |            | 0           | 0           | 0           |
| Sulfur           | ppm           | ASTM D5185m  | 50         | 11          | <1          | 11          |
| CONTAMINANTS     |               | method       | limit/base | current     | history1    | history2    |
| Silicon          | ppm           | ASTM D5185m  | >25        | 2           | 2           | 2           |
| Sodium           | ppm           | ASTM D5185m  |            | <1          | <1          | 0           |
| Potassium        | ppm           | ASTM D5185m  | >20        | 0           | 2           | <1          |
| Water            | %             | ASTM D6304   | >0.1       | 0.006       | 0.002       | 0.004       |
| ppm Water        | ppm           | ASTM D6304   | >1000      | 61          | 21          | 42.8        |
| FLUID CLEANLIN   | IESS          | method       | limit/base | current     | history1    | history2    |
| Particles >4µm   |               | ASTM D7647   | >10000     | 5666        | 3372        | 4255        |
| Particles >6µm   |               | ASTM D7647   | >2500      | 882         | 737         | 747         |
| Particles >14µm  |               | ASTM D7647   | >320       | 16          | 19          | 42          |
| Particles >21µm  |               | ASTM D7647   | >80        | 3           | 2           | 14          |
| Particles >38µm  |               | ASTM D7647   | >20        | 0           | 1           | 2           |
| Particles >71µm  |               | ASTM D7647   | >4         | 0           | 0           | 0           |
| Oil Cleanliness  |               | ISO 4406 (c) | >20/18/15  | 20/17/11    | 19/17/11    | 19/17/13    |
| FLUID DEGRADA    |               | method       | limit/base | current     | history1    | history2    |
| Acid Number (AN) | mg KOH/g      | ASTM D8045   | 0.005      | 0.014       | 0.014       | 0.015       |
|                  |               |              |            |             |             |             |


Contact/Location: DWAYNE B - TYSBRO Page 1 of 2





## **OIL ANALYSIS REPORT**









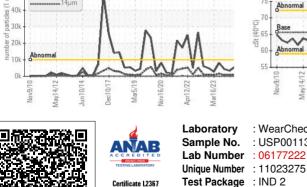

# VISUAL

| VISUAL           |        | method    | limit/base | current | nistory i | nistory2     |
|------------------|--------|-----------|------------|---------|-----------|--------------|
| White Metal      | scalar | *Visual   | NONE       | NONE    | NONE      | NONE         |
| Yellow Metal     | scalar | *Visual   | NONE       | NONE    | NONE      | NONE         |
| Precipitate      | scalar | *Visual   | NONE       | NONE    | NONE      | NONE         |
| Silt             | scalar | *Visual   | NONE       | NONE    | NONE      | NONE         |
| Debris           | scalar | *Visual   | NONE       | NONE    | NONE      | NONE         |
| Sand/Dirt        | scalar | *Visual   | NONE       | NONE    | NONE      | NONE         |
| Appearance       | scalar | *Visual   | NORML      | NORML   | NORML     | NORML        |
| Odor             | scalar | *Visual   | NORML      | NORML   | NORML     | NORML        |
| Emulsified Water | scalar | *Visual   | >0.1       | NEG     | NEG       | NEG          |
| Free Water       | scalar | *Visual   |            | NEG     | NEG       | NEG          |
| FLUID PROPERT    | IES    | method    | limit/base | current | history1  | history2     |
| Visc @ 40°C      | cSt    | ASTM D445 | 65.6       | 64.5    | 64.2      | 64.4         |
| SAMPLE IMAGES    | ;      | method    | limit/base | current | history1  | history2     |
| Color            |        |           |            |         |           | s            |
| Bottom           |        |           |            |         |           | $(\bigcirc)$ |

GRAPHS Particle Count Ferrous Alloys 491 520 122,88 30,72 7,68 20 8 4406 Dec10 Der 1,920 May1 19999 Non-ferrous Metals 480 10 120 30 4/17 pr12/22 lar16/73 lar10/ /av1 Viscosity @ 40°C Acid Number 75 (mg KOH/g) 70 b 0.04 5 0.02 Ab Ba 00.0 Acid 55 Apr12/22 Mar16/23 Mav14/17 Aar5/19 Apr12/22 un10/14 Jec10/1 Aar5/1 /lav14/1 : WearCheck USA - 501 Madison Ave., Cary, NC 27513 **TYSON - BROKEN BOW-USP** : USP0011391 Received : 13 May 2024 PO BOX 220 Lab Number : 06177222 Tested : 14 May 2024

Diagnosed : 14 May 2024 - Doug Bogart

BROKEN BOW, OK US 74728 Contact: DWAYNE B

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (580)584-9191 F:

Report Id: TYSBRO [WUSCAR] 06177222 (Generated: 05/14/2024 21:57:07) Rev: 1

Certificate 12367

Contact/Location: DWAYNE B - TYSBRO