


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id

FRICK TYSROGCNQ 5 (S/N S0885UFMPTOAA03)

Refrigeration Compressor

USPI ALT-68 SC (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


e2013 Ju2014 Jan/2016 Smp2017 Smp2018 Smp2020 Oc2021 Mm2023						
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0011387	USP0005376	USP0003217
Sample Date		Client Info		06 May 2024	23 Jan 2024	09 Oct 2023
Machine Age	hrs	Client Info		54978	48550	46878
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	0	0	0
Chromium	ppm	ASTM D5185m	>2	<1	0	0
Nickel	ppm	ASTM D5185m		0	<1	0
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	0	<1	<1
Lead	ppm	ASTM D5185m	>2	<1	<1	0
Copper	ppm	ASTM D5185m	>8	<1	0	1
Tin	ppm	ASTM D5185m	>4	<1	<1	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		1	0	0
Molybdenum	ppm	ASTM D5185m		<1	0	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m		<1	0	0
Calcium	ppm	ASTM D5185m		0	1	1
Phosphorus	ppm	ASTM D5185m		0	0	<1
Zinc	ppm	ASTM D5185m		2	0	0
Sulfur	ppm	ASTM D5185m	50	0	11	7
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1	<1	<1
Sodium	ppm	ASTM D5185m		0	<1	2
Potassium	ppm	ASTM D5185m	>20	1	2	<1
Water	%	ASTM D6304	>0.01	0.007	0.006	0.007
ppm Water	ppm	ASTM D6304	>100	70	64	76.5
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	1877	6878	699
Particles >6µm		ASTM D7647	>2500	482	1382	176
Particles >14μm		ASTM D7647	>320	26	49	15
Particles >21μm		ASTM D7647	>80	7	14	5
Particles >38μm		ASTM D7647	>20	0	0	1
Particles >71μm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	18/16/12	20/18/13	17/15/11
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.014	0.014	0.013





OIL ANALYSIS REPORT













VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	TIFS	method	limit/base	current	historv1	history2

VISC @ 40°C	CSI	ASTIVI D445	03.0	05.2	64.9	05.1
SAMPLE IMAGES		method	limit/base		history1	history2

Color





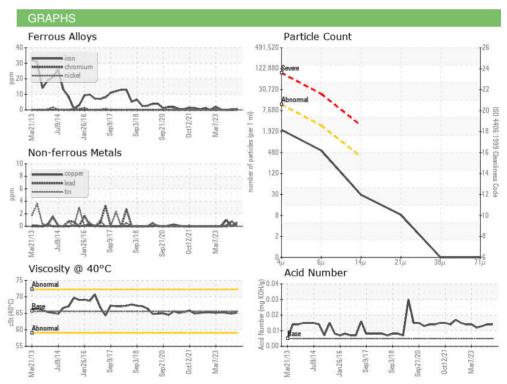





Certificate 12367

Laboratory Sample No.

: USP0011387 Lab Number : 06177244 Unique Number : 11023297

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 13 May 2024 **Tested**

Test Package : IND 2

: 14 May 2024 Diagnosed : 14 May 2024 - Doug Bogart **TYSON CNQ -ROGERS-USP**

ROGERS, AR US

Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: