

OIL ANALYSIS REPORT



ACAS 115 [8331] **CHICAGO PNEUMATIC API122205**

Component Compressor

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06177316	UCH05996815	
Sample Date		Client Info		18 Apr 2024	25 Oct 2023	
Machine Age	hrs	Client Info		16210	15710	
Oil Age	hrs	Client Info		500	1056	
Oil Changed		Client Info		Not Changd	Changed	
Sample Status				NORMAL	ATTENTION	
CONTAMINATIO	V	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG	NEG	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m	>10	<1	0	
Nickel	ppm	ASTM D5185m		0	0	
Titanium	ppm	ASTM D5185m		<1	0	
Silver	ppm	ASTM D5185m		0	0	
Aluminum	ppm	ASTM D5185m	>25	2	0	
Lead	ppm	ASTM D5185m	>25	<1	0	
Copper	ppm	ASTM D5185m	>50	1	0	
Tin	ppm	ASTM D5185m	>15	<1	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		<1	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m		2	0	
Molybdenum	ppm	ASTM D5185m		<1	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m		<1	0	
Calcium	ppm	ASTM D5185m		3	0	
Phosphorus	ppm	ASTM D5185m		295	24	
Zinc	ppm	ASTM D5185m		26	10	
Sulfur	ppm	ASTM D5185m		806	73	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	4 1	
Sodium	ppm	ASTM D5185m		0	0	
Potassium	ppm	ASTM D5185m	>20	2	0	
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.51	0.22	





OIL ANALYSIS REPORT

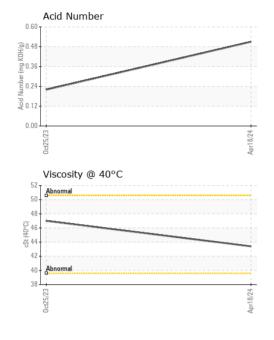
















Laboratory Sample No. Lab Number : 06177316

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : UCH06177316

Unique Number : 11023369

Received : 13 May 2024 **Tested** Diagnosed

: 14 May 2024 : 15 May 2024 - Don Baldridge

ADVANCED COMPRESSED AIR SOLUTIONS (ACAS) 9421 FM 2920 RD BLDG 23 TOMBALL, TX

jim@advancedcompressedair.com

US 77375 Contact: JIM SUAREZ

Test Package : IND 2 Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

T:

F: