




# OIL ANALYSIS REPORT

Sample Rating Trend

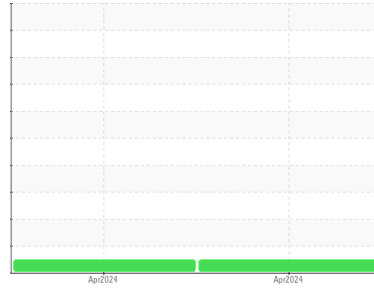

**NORMAL**



Area

**NOT GIVEN [8498]**

Machine Id

**INGERSOLL RAND MOX1001402**

Component

**Compressor**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>UCH06177317</b>	UCH06177313	---
Sample Date	Client Info			<b>24 Apr 2024</b>	23 Apr 2024	---
Machine Age	hrs	Client Info		<b>598</b>	396	---
Oil Age	hrs	Client Info		<b>0</b>	396	---
Oil Changed	Client Info			<b>Not Chngd</b>	Not Chngd	---
Sample Status				<b>NORMAL</b>	NORMAL	---

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.8	<b>NEG</b>	NEG	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	---
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	<1	---
Nickel	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	---
Silver	ppm	ASTM D5185m		<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>25	<b>2</b>	2	---
Lead	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	---
Copper	ppm	ASTM D5185m	>50	<b>&lt;1</b>	<1	---
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	---
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	---


ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	2	<b>0</b>	0	---
Barium	ppm	ASTM D5185m	525	<b>384</b>	413	---
Molybdenum	ppm	ASTM D5185m	10	<b>&lt;1</b>	<1	---
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	---
Magnesium	ppm	ASTM D5185m	5	<b>4</b>	2	---
Calcium	ppm	ASTM D5185m	10	<b>6</b>	4	---
Phosphorus	ppm	ASTM D5185m	250	<b>121</b>	133	---
Zinc	ppm	ASTM D5185m	100	<b>29</b>	33	---
Sulfur	ppm	ASTM D5185m	400	<b>389</b>	364	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	---
Sodium	ppm	ASTM D5185m		<b>21</b>	8	---
Potassium	ppm	ASTM D5185m	>20	<b>4</b>	3	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.29</b>	0.21	---




# OIL ANALYSIS REPORT

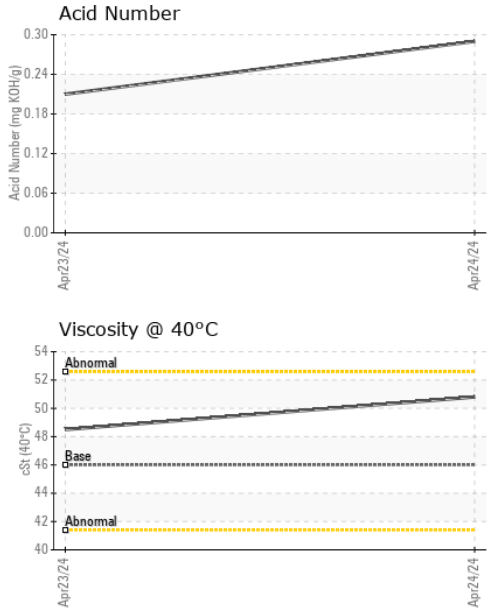





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.8	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	50.8	48.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

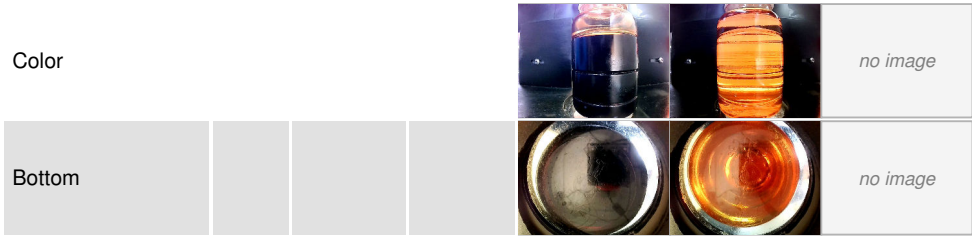

## GRAPHS

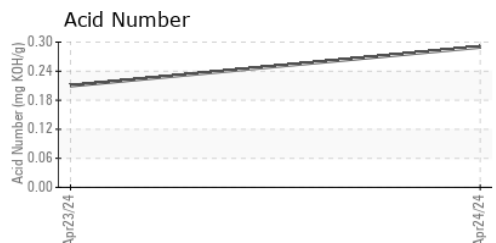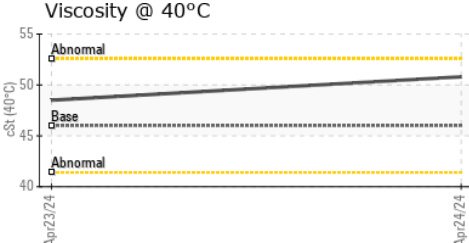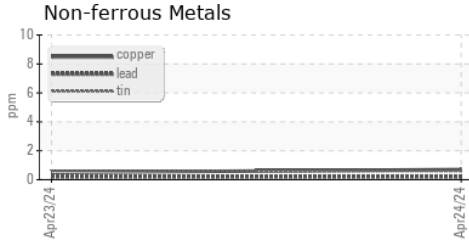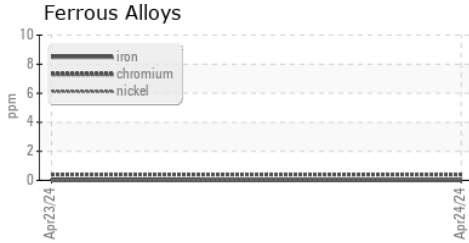

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH06177317      **Received** : 13 May 2024  
**Lab Number** : 06177317      **Tested** : 14 May 2024  
**Unique Number** : 11023370      **Diagnosed** : 15 May 2024 - Don Baldrige  
**Test Package** : IND 2

**ADVANCED COMPRESSED AIR SOLUTIONS (ACAS)**  
 9421 FM 2920 RD BLDG 23  
 TOMBALL, TX 77375  
 Contact: JIM SUAREZ  
 jim@advancedcompressedair.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)