




OIL ANALYSIS REPORT

Sample Rating Trend

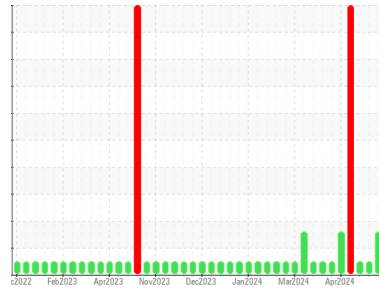

WEAR



Machine Id

LGS00178

Component

Biogas Engine

Fluid

MAHLER Q8 Mahler G8 SAE 40 (141 GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

Bearing and/or bushing wear is indicated. All other component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0880277	WC0880261	WC0880259
Sample Date	Client Info		08 May 2024	01 May 2024	29 Apr 2024
Machine Age	hrs	Client Info	67420	67370	67321
Oil Age	hrs	Client Info	143	93	44
Oil Changed	Client Info		Not Chngd	N/A	N/A
Sample Status			ABNORMAL	NORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Water	WC Method	>0.1	NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>45	18	3	5
Chromium	ppm	ASTM D5185m	>2	1	0	<1
Nickel	ppm	ASTM D5185m	>2	<1	0	<1
Titanium	ppm	ASTM D5185m		<1	0	<1
Silver	ppm	ASTM D5185m	>5	0	0	<1
Aluminum	ppm	ASTM D5185m	>10	3	2	4
Lead	ppm	ASTM D5185m	>5	▲ 11	<1	3
Copper	ppm	ASTM D5185m	>14	▲ 18	6	6
Tin	ppm	ASTM D5185m	>13	4	<1	2
Vanadium	ppm	ASTM D5185m		<1	<1	<1
Cadmium	ppm	ASTM D5185m		<1	0	<1

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		0	0	<1
Barium	ppm	ASTM D5185m		1	0	<1
Molybdenum	ppm	ASTM D5185m		<1	<1	4
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m		7	6	43
Calcium	ppm	ASTM D5185m		2417	2123	2263
Phosphorus	ppm	ASTM D5185m		483	400	486
Zinc	ppm	ASTM D5185m		506	439	513
Sulfur	ppm	ASTM D5185m		4855	4383	4123

CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>200	105	65	40
Sodium	ppm	ASTM D5185m		0	<1	0
Potassium	ppm	ASTM D5185m	>20	2	0	2

INFRA-RED

	method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844		0	0	0
Nitration	Abs/cm	*ASTM D7624	>20	5.3	5.1	4.9
Sulfation	Abs/.1mm	*ASTM D7415	>30	19.7	17.9	16.9


FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	*ASTM D7414	>25	9.5	9.1	9.1
Acid Number (AN)	mg KOH/g	ASTM D8045		1.21	1.11	0.80
Base Number (BN)	mg KOH/g	ASTM D2896	8.0	6.36	7.06	6.78




OIL ANALYSIS REPORT


▲ Non-ferrous Metals

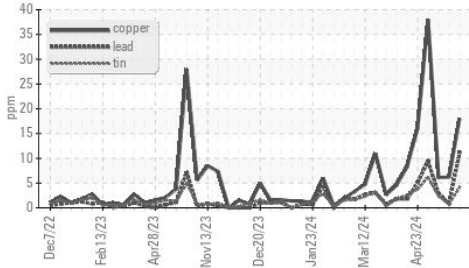


FT-IR (Direct Trend)

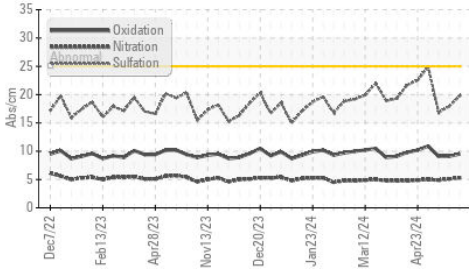


Acid Number

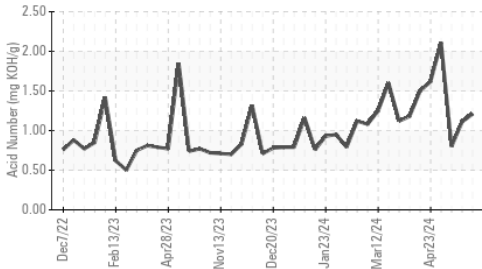

Base Number

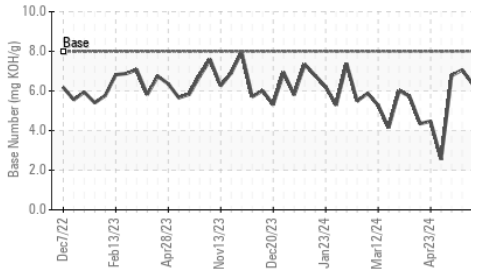









Viscosity @ 100°C

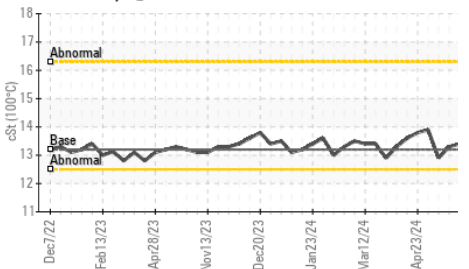

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445	13.2	13.4	13.3	12.9

GRAPHS

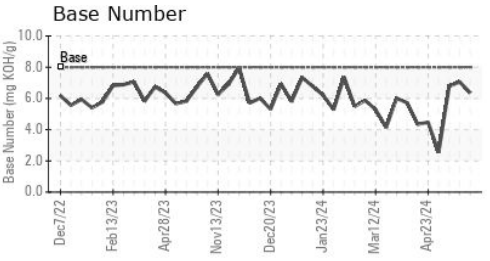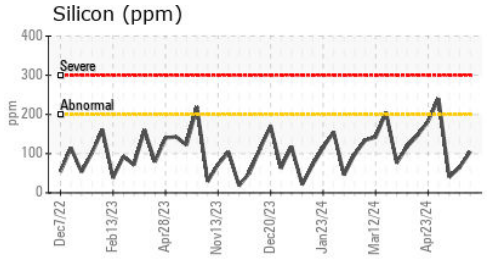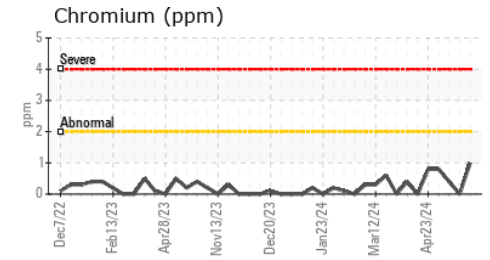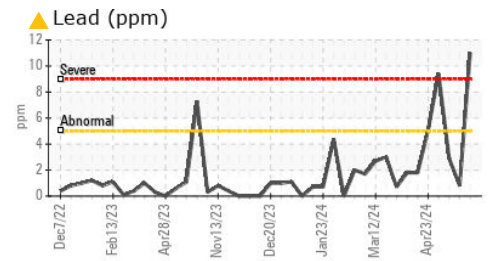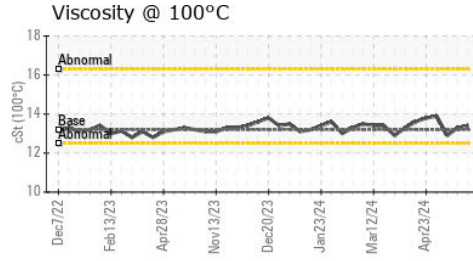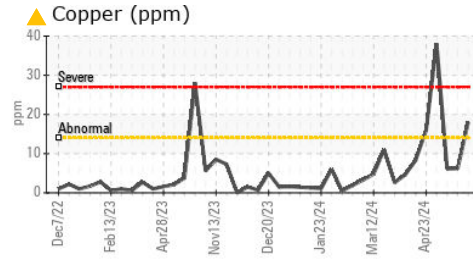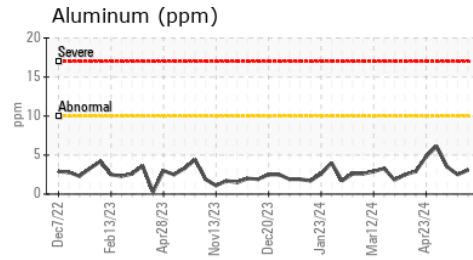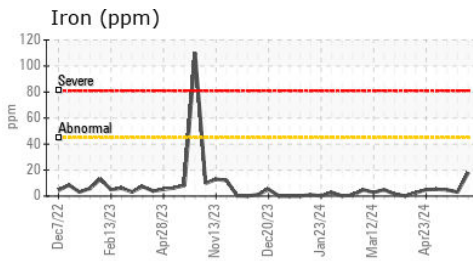

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0880277

Lab Number : **06177368**

Unique Number : 11023421

Test Package : MOB 2

Received : 13 May 2024

Tested : 14 May 2024

Diagnosed : 15 May 2024 - Don Baldrige

BI-COUNTY

3214 DOVER RD

WOODLAWN, TN

US 37191

Contact: KEVIN WEAVER

kevin.weaver@cubedistrictenergy.com

T:

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)