




OIL ANALYSIS REPORT



Machine Id
HANM01BE (S/N 4EK00133)
 Component
Biogas Engine
 Fluid
CHEVRON HDAX 9500 GAS ENGINE OIL 40 (95 GAL)

Sample Rating Trend

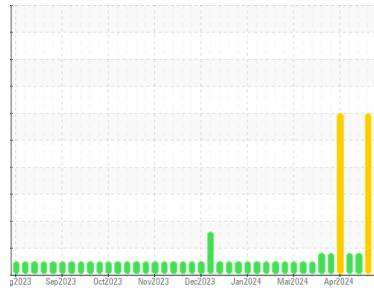

DIAGNOSIS

▲ Recommendation

We advise that you inspect for the source(s) of wear. We recommend an early resample to monitor this condition.

▲ Wear

The tin level is severe.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

| | method | limit/base | current | history1 | history2 |
|---------------|-------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info | | WC0898189 | WC0898185 | WC0898160 |
| Sample Date | Client Info | | 09 May 2024 | 02 May 2024 | 26 Apr 2024 |
| Machine Age | hrs | Client Info | 70812 | 70644 | 70459 |
| Oil Age | hrs | Client Info | 695 | 527 | 342 |
| Oil Changed | Client Info | | Not Chngd | Not Chngd | Not Chngd |
| Sample Status | | | SEVERE | SEVERE | ABNORMAL |

CONTAMINATION

| | method | limit/base | current | history1 | history2 |
|--------|-----------|------------|----------------|----------|----------|
| Fuel | WC Method | >4.0 | <1.0 | <1.0 | <1.0 |
| Water | WC Method | >.11 | NEG | NEG | NEG |
| Glycol | WC Method | | NEG | NEG | NEG |

WEAR METALS

| | method | limit/base | current | history1 | history2 |
|----------|--------|-----------------|--------------|----------|----------|
| Iron | ppm | ASTM D5185m >15 | 3 | 4 | 4 |
| Chromium | ppm | ASTM D5185m >4 | <1 | <1 | <1 |
| Nickel | ppm | ASTM D5185m | <1 | 0 | 0 |
| Titanium | ppm | ASTM D5185m | <1 | <1 | 0 |
| Silver | ppm | ASTM D5185m | 0 | 0 | 0 |
| Aluminum | ppm | ASTM D5185m >6 | 2 | 2 | 2 |
| Lead | ppm | ASTM D5185m >9 | 2 | 1 | 1 |
| Copper | ppm | ASTM D5185m >6 | 2 | 2 | 1 |
| Tin | ppm | ASTM D5185m >4 | ▲ 7 | ▲ 6 | ▲ 5 |
| Vanadium | ppm | ASTM D5185m | <1 | 0 | 0 |
| Cadmium | ppm | ASTM D5185m | <1 | 0 | 0 |

ADDITIVES

| | method | limit/base | current | history1 | history2 |
|------------|--------|-------------|--------------|----------|----------|
| Boron | ppm | ASTM D5185m | 72 | 43 | 23 |
| Barium | ppm | ASTM D5185m | 1 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185m | 6 | 6 | 5 |
| Manganese | ppm | ASTM D5185m | <1 | <1 | <1 |
| Magnesium | ppm | ASTM D5185m | 29 | 25 | 23 |
| Calcium | ppm | ASTM D5185m | 2008 | 1867 | 1834 |
| Phosphorus | ppm | ASTM D5185m | 446 | 384 | 306 |
| Zinc | ppm | ASTM D5185m | 503 | 437 | 380 |
| Sulfur | ppm | ASTM D5185m | 3613 | 3231 | 2778 |

CONTAMINANTS

| | method | limit/base | current | history1 | history2 |
|-----------|--------|------------------|------------|----------|----------|
| Silicon | ppm | ASTM D5185m >181 | 171 | 150 | 130 |
| Sodium | ppm | ASTM D5185m >21 | 0 | 0 | 1 |
| Potassium | ppm | ASTM D5185m >20 | 3 | 2 | 1 |

INFRA-RED

| | method | limit/base | current | history1 | history2 |
|-----------|----------|-------------|-------------|----------|----------|
| Soot % | % | *ASTM D7844 | 0 | 0.1 | 0.1 |
| Nitration | Abs/cm | *ASTM D7624 | 6.7 | 6.8 | 6.5 |
| Sulfation | Abs/.1mm | *ASTM D7415 | 22.0 | 20.8 | 19.1 |


FLUID DEGRADATION

| | method | limit/base | current | history1 | history2 |
|------------------|----------|----------------|-------------|----------|----------|
| Oxidation | Abs/.1mm | *ASTM D7414 | 16.7 | 15.5 | 13.0 |
| Acid Number (AN) | mg KOH/g | ASTM D8045 1.0 | 1.43 | 1.41 | 1.46 |
| Base Number (BN) | mg KOH/g | ASTM D2896 5.4 | 3.70 | 3.79 | 4.12 |




OIL ANALYSIS REPORT


▲ Non-ferrous Metals

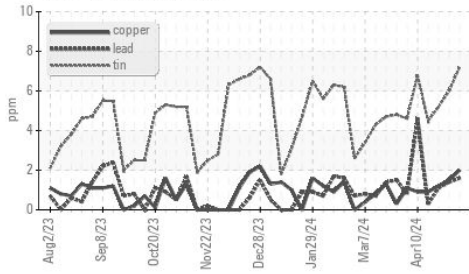


FT-IR (Direct Trend)

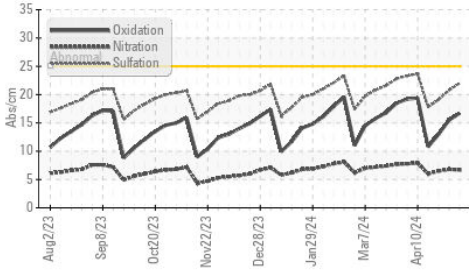


Acid Number

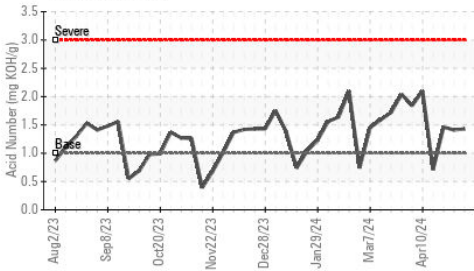

Base Number

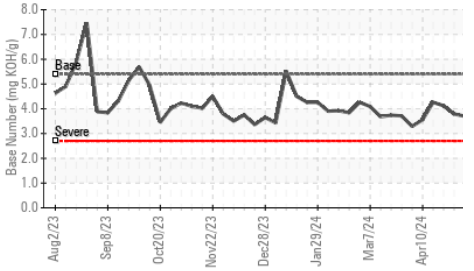


Viscosity @ 100°C

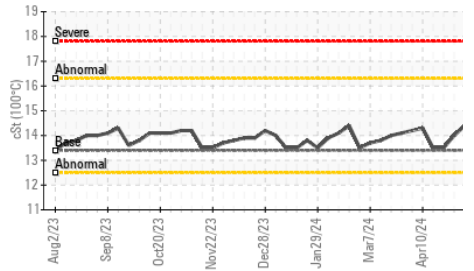

| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | LIGHT | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >.11 | NEG | NEG |
| Free Water | scalar | *Visual | | NEG | NEG |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 100°C | cSt | ASTM D445 | 13.4 | 14.4 | 14.0 |

GRAPHS

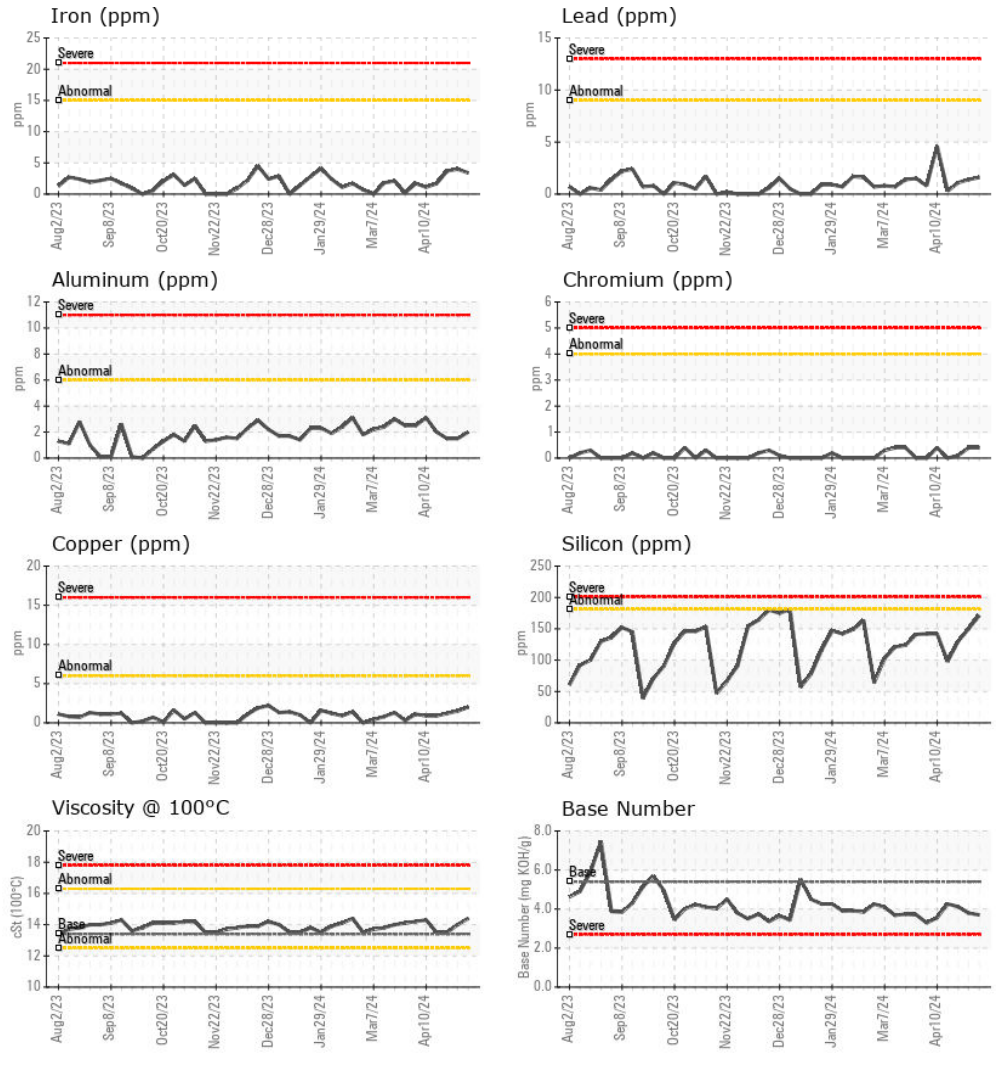

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0898189
Lab Number : 06177373
Unique Number : 11023426
Test Package : MOB 2
Received : 13 May 2024
Tested : 14 May 2024
Diagnosed : 15 May 2024 - Don Baldrige

EDL NA Recips-Hancock County
 HANCOCK COUNTY POWER STATION, 3574 TOWNSHIP ROAD 142
 FINDLAY, OH
 US 45840
 Contact: TIM CUSICK
 tim.cusick@edlenergy.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)