




# OIL ANALYSIS REPORT



Machine Id  
**SJNM03BE**  
 Component  
**Biogas Engine**  
 Fluid  
**CHEVRON HDAX 9500 GAS ENGINE OIL 40 (--- GAL)**

Sample Rating Trend

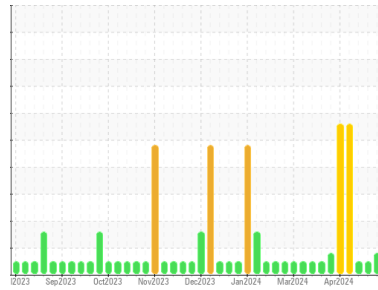

## DIAGNOSIS

- Recommendation**  
No corrective action is recommended at this time. Resample at the next service interval to monitor.
- Wear**  
The tin level is abnormal. All other component wear rates are normal.

**Contamination**  
There is no indication of any contamination in the oil.

**Fluid Condition**  
The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0865727</b>	WC0865743	WC0865694
Sample Date	Client Info		<b>12 May 2024</b>	02 May 2024	26 Apr 2024
Machine Age	hrs	Client Info	<b>0</b>	116445	116347
Oil Age	hrs	Client Info	<b>0</b>	336	238
Oil Changed	Client Info		<b>N/A</b>	Not Changd	Not Changd
Sample Status			<b>ABNORMAL</b>	NORMAL	NORMAL

CONTAMINATION	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method		<b>NEG</b>	NEG	NEG
Glycol	WC Method		<b>NEG</b>	NEG	NEG

WEAR METALS	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>14	<b>2</b>	2	2
Chromium	ppm	ASTM D5185m	>3	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>5	<b>2</b>	2	2
Lead	ppm	ASTM D5185m	>8	<b>3</b>	3	2
Copper	ppm	ASTM D5185m	>5	<b>4</b>	2	2
Tin	ppm	ASTM D5185m	>3	<b>▲ 4</b>	3	2
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1

ADDITIVES	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Barium	ppm	ASTM D5185m		<b>2</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>5</b>	4	4
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>19</b>	18	19
Calcium	ppm	ASTM D5185m		<b>1964</b>	1811	1834
Phosphorus	ppm	ASTM D5185m		<b>351</b>	305	307
Zinc	ppm	ASTM D5185m		<b>385</b>	351	361
Sulfur	ppm	ASTM D5185m		<b>2612</b>	2383	2364

CONTAMINANTS	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>180	<b>179</b>	138	96
Sodium	ppm	ASTM D5185m	>20	<b>0</b>	0	0
Potassium	ppm	ASTM D5185m	>20	<b>3</b>	2	2


INFRA-RED	method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844		<b>0</b>	0	0
Nitration	Abs/cm	*ASTM D7624		<b>6.0</b>	5.7	5.5
Sulfation	Abs/.1mm	*ASTM D7415		<b>17.5</b>	16.5	15.9

FLUID DEGRADATION	method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	*ASTM D7414		<b>10.5</b>	9.5	9.2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	<b>0.59</b>	1.727	0.69
Base Number (BN)	mg KOH/g	ASTM D2896	5.4	<b>4.45</b>	4.84	5.20




# OIL ANALYSIS REPORT


## ▲ Non-ferrous Metals

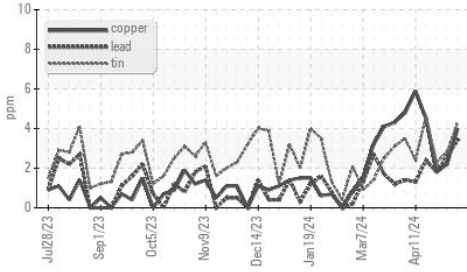


## FT-IR (Direct Trend)

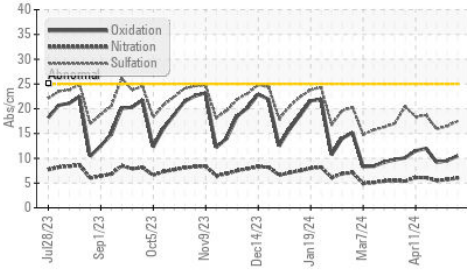


## Acid Number

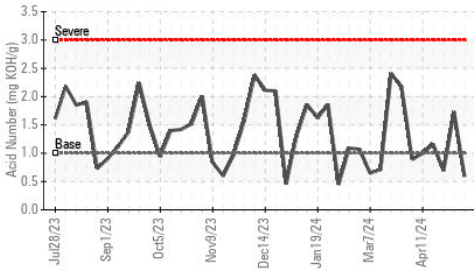

## Base Number

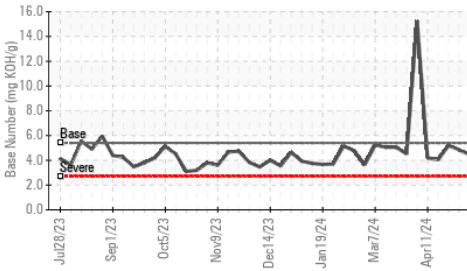

## Viscosity @ 100°C

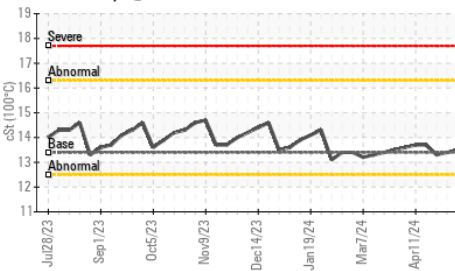


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	NEG	NEG	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.4	13.5	13.4

## GRAPHS


### Iron (ppm)

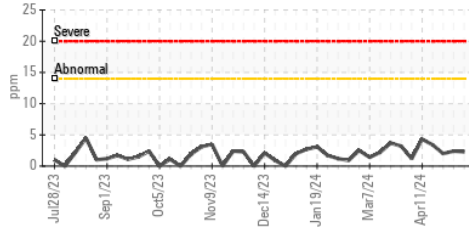


### Lead (ppm)

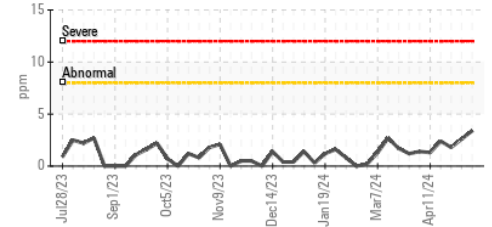


### Aluminum (ppm)

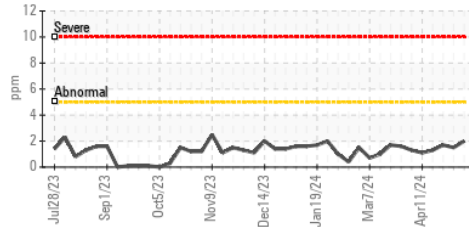


### Chromium (ppm)

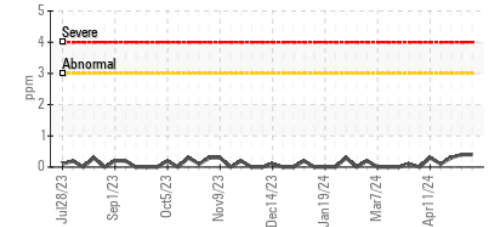


### Copper (ppm)

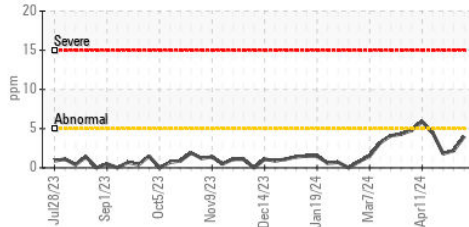


### Silicon (ppm)

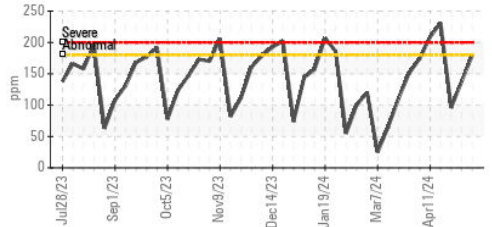

### Viscosity @ 100°C

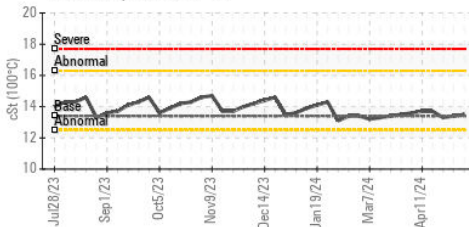

### Base Number

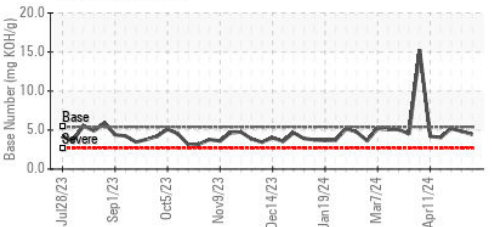

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0865727

Lab Number : 06177379

Unique Number : 11023432

Test Package : MOB 2

Received : 13 May 2024

Tested : 14 May 2024

Diagnosed : 15 May 2024 - Don Baldrige

EDL NA Recips-South Jordan

South Jordan Powerstation, 10473 S. Bacchus Hwy.

South Jordan, UT

US 84095

Contact: Aaron Klein

aaron.klein@edlenergy.com

T:

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)