




OIL ANALYSIS REPORT

Sample Rating Trend

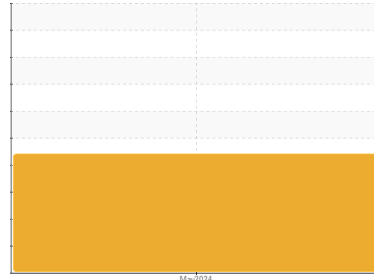

WATER



Machine Id

KAESER 9355230

Component

Compressor

Fluid

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

▲ Wear

The aluminum level is abnormal. All other component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil. There is a light concentration of water present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCP47450	---	---
Sample Date	Client Info			07 May 2024	---	---
Machine Age	hrs	Client Info		3081	---	---
Oil Age	hrs	Client Info		3081	---	---
Oil Changed	Client Info			Not Changed	---	---
Sample Status				ABNORMAL	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	2	---	---
Chromium	ppm	ASTM D5185m	>10	<1	---	---
Nickel	ppm	ASTM D5185m	>3	0	---	---
Titanium	ppm	ASTM D5185m	>3	<1	---	---
Silver	ppm	ASTM D5185m	>2	0	---	---
Aluminum	ppm	ASTM D5185m	>10	▲ 15	---	---
Lead	ppm	ASTM D5185m	>10	<1	---	---
Copper	ppm	ASTM D5185m	>50	2	---	---
Tin	ppm	ASTM D5185m	>10	<1	---	---
Vanadium	ppm	ASTM D5185m		<1	---	---
Cadmium	ppm	ASTM D5185m		<1	---	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	---	---
Barium	ppm	ASTM D5185m	90	1	---	---
Molybdenum	ppm	ASTM D5185m		<1	---	---
Manganese	ppm	ASTM D5185m		0	---	---
Magnesium	ppm	ASTM D5185m	90	<1	---	---
Calcium	ppm	ASTM D5185m	2	5	---	---
Phosphorus	ppm	ASTM D5185m		76	---	---
Zinc	ppm	ASTM D5185m		3	---	---
Sulfur	ppm	ASTM D5185m		330	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	---	---
Sodium	ppm	ASTM D5185m		0	---	---
Potassium	ppm	ASTM D5185m	>20	3	---	---
Water	%	ASTM D6304	>0.05	▲ 0.111	---	---
ppm Water	ppm	ASTM D6304	>500	▲ 1113	---	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		24255	---	---
Particles >6µm		ASTM D7647	>1300	▲ 8921	---	---
Particles >14µm		ASTM D7647	>80	▲ 931	---	---
Particles >21µm		ASTM D7647	>20	▲ 243	---	---
Particles >38µm		ASTM D7647	>4	▲ 12	---	---
Particles >71µm		ASTM D7647	>3	0	---	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 22/20/17	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.093	---	---

OIL ANALYSIS REPORT

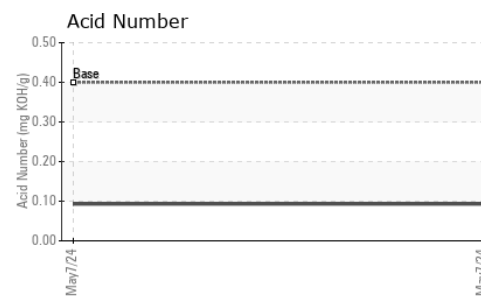
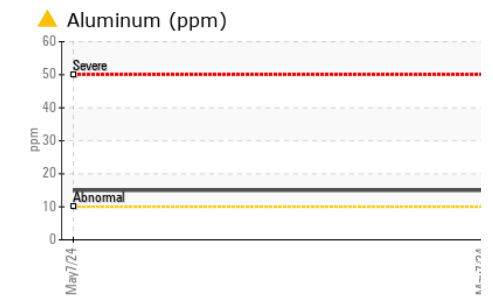
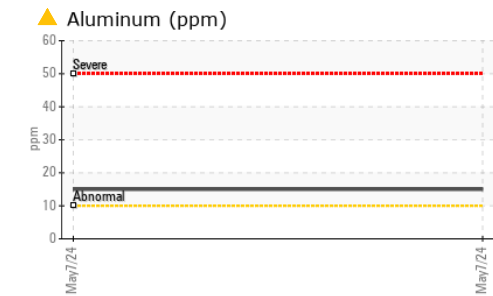
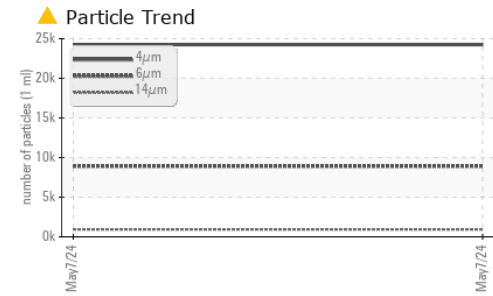
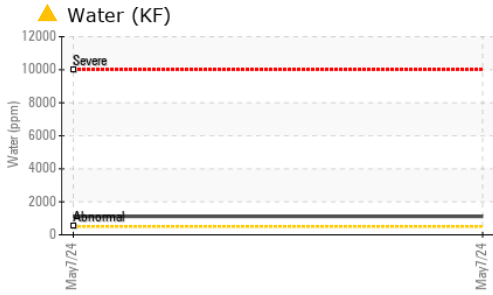


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	46.7	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS

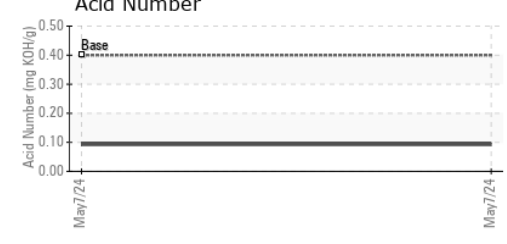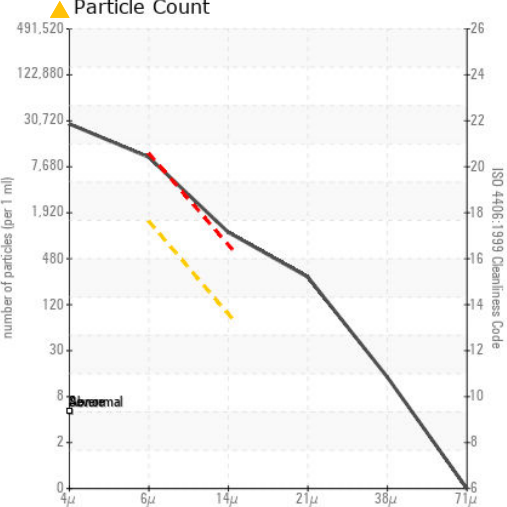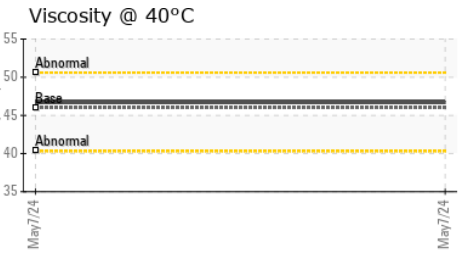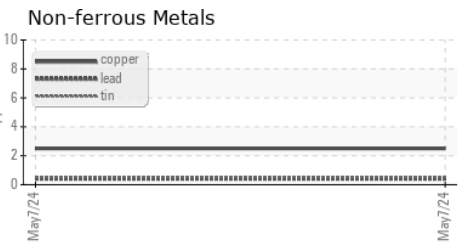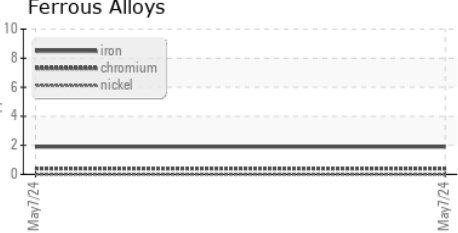

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP47450 **Received** : 13 May 2024
Lab Number : 06177686 **Tested** : 14 May 2024
Unique Number : 11023739 **Diagnosed** : 15 May 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

MENASHA PACKAGING
 2255 BROOKS AVE
 NEENAH, WI
 US 54956
 Contact: Service Manager
 SERVICE@NORTHERNCOMPRESSOR.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)