




OIL ANALYSIS REPORT

Sample Rating Trend

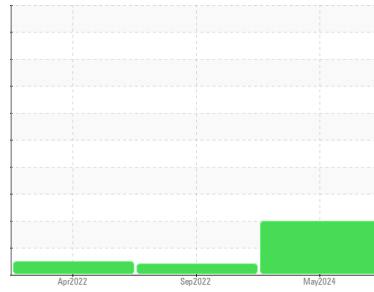

ISO



Machine Id

KAESER 7881773

Component

Compressor

Fluid

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA016781	KCP47273	KCP45514
Sample Date	Client Info			06 May 2024	26 Sep 2022	24 Apr 2022
Machine Age	hrs	Client Info		5003	1900	1251
Oil Age	hrs	Client Info		2118	649	1251
Oil Changed	Client Info			Not Chngd	Not Chngd	Changed
Sample Status				ABNORMAL	ABNORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	4	<1	1
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	2
Aluminum	ppm	ASTM D5185m	>10	2	1	<1
Lead	ppm	ASTM D5185m	>10	<1	1	0
Copper	ppm	ASTM D5185m	>50	8	8	4
Tin	ppm	ASTM D5185m	>10	<1	0	<1
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	<1
Barium	ppm	ASTM D5185m	90	72	91	68
Molybdenum	ppm	ASTM D5185m	0	<1	0	0
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m	100	73	98	81
Calcium	ppm	ASTM D5185m	0	7	6	4
Phosphorus	ppm	ASTM D5185m	0	9	44	4
Zinc	ppm	ASTM D5185m	0	11	20	3
Sulfur	ppm	ASTM D5185m	23500	25048	25463	15654

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	9	<1
Sodium	ppm	ASTM D5185m		29	13	19
Potassium	ppm	ASTM D5185m	>20	10	4	4
Water	%	ASTM D6304	>0.05	0.028	0.035	0.021
ppm Water	ppm	ASTM D6304	>500	286	354.6	219.5

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		303380	---	748
Particles >6µm		ASTM D7647	>1300	▲ 122058	---	173
Particles >14µm		ASTM D7647	>80	▲ 3759	---	15
Particles >21µm		ASTM D7647	>20	▲ 591	---	3
Particles >38µm		ASTM D7647	>4	▲ 12	---	0
Particles >71µm		ASTM D7647	>3	0	---	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 25/24/19	---	17/15/11

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.37	0.37	0.31


OIL ANALYSIS REPORT

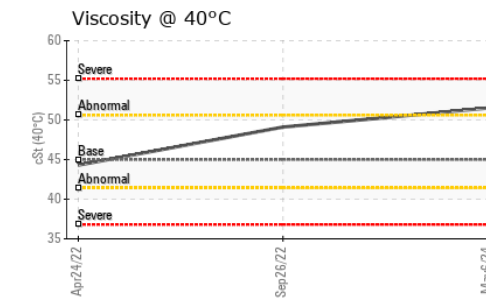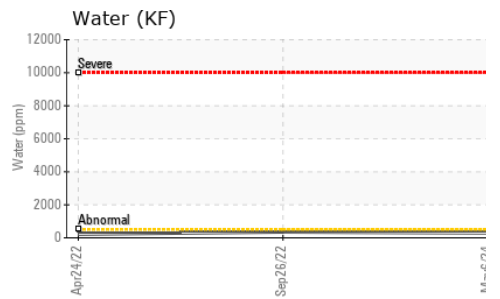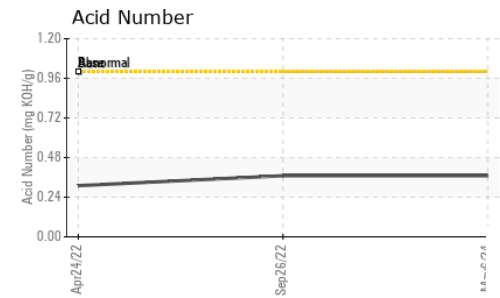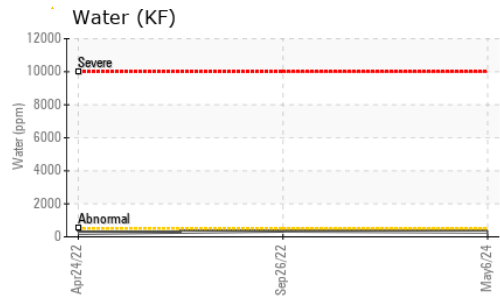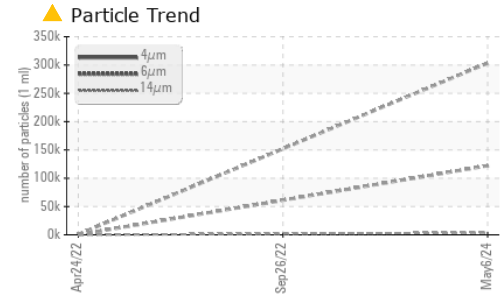






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	51.5	49.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

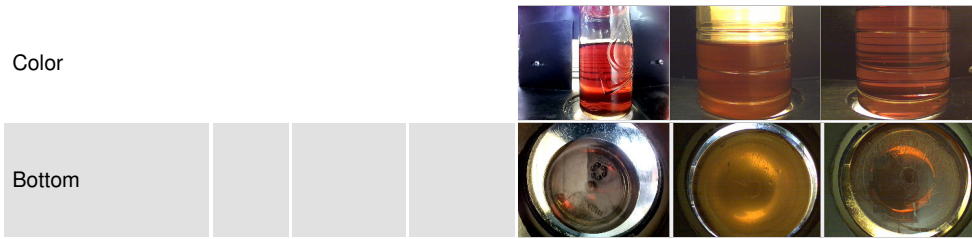

GRAPHS

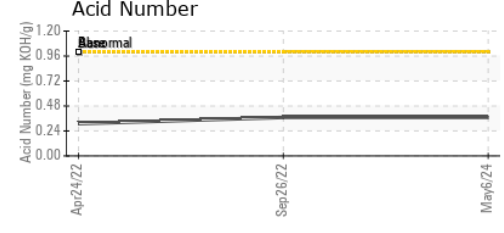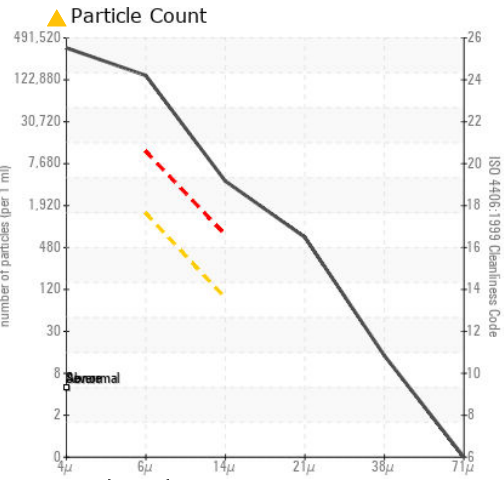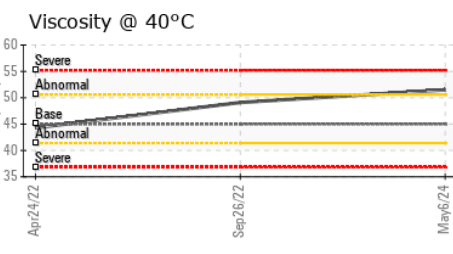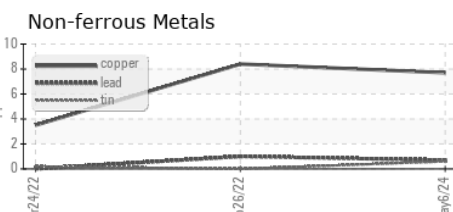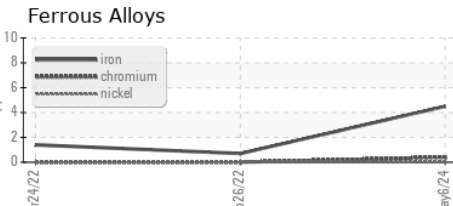

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA016781 **Received** : 13 May 2024
Lab Number : 06177712 **Tested** : 14 May 2024
Unique Number : 11023765 **Diagnosed** : 15 May 2024 - Angela Borella
Test Package : IND 2 (Additional Tests: KF, PrtCount)

AMAZON OKC2
 8991 S PORTLAND AVE
 OKLAHOMA CITY, OK
 US 73159
 Contact: JOSH UOLS
 joshuols@amazon.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)