KAESER COMPRESSORS
Built for a lifetime.

OIL ANALYSIS REPORT

Sample Rating Trend

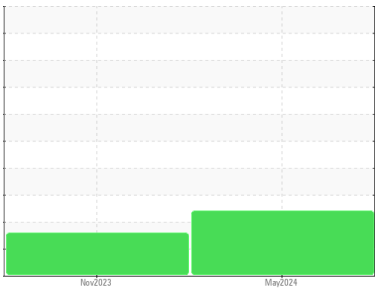

WATER

Machine Id
KAESER 8029680
Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation
We were unable to perform a particle count on this sample. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

Wear
All component wear rates are normal.

Contamination
There is a light concentration of water present in the oil.

Fluid Condition
The AN level is acceptable for this fluid.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**KCPA016456**	KCPA009413	---
Sample Date		Client Info		**10 May 2024**	21 Nov 2023	---
Machine Age	hrs	Client Info		**3683**	3267	---
Oil Age	hrs	Client Info		**0**	0	---
Oil Changed		Client Info		**Not Changd**	N/A	---
Sample Status				**ABNORMAL**	ABNORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	**<1**	0	---
Chromium	ppm	ASTM D5185m	>10	**<1**	0	---
Nickel	ppm	ASTM D5185m	>3	**0**	0	---
Titanium	ppm	ASTM D5185m	>3	**<1**	0	---
Silver	ppm	ASTM D5185m	>2	**0**	0	---
Aluminum	ppm	ASTM D5185m	>10	**2**	0	---
Lead	ppm	ASTM D5185m	>10	**<1**	0	---
Copper	ppm	ASTM D5185m	>50	**9**	9	---
Tin	ppm	ASTM D5185m	>10	**<1**	0	---
Vanadium	ppm	ASTM D5185m		**<1**	0	---
Cadmium	ppm	ASTM D5185m		**<1**	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	**0**	0	---
Barium	ppm	ASTM D5185m	90	**4**	0	---
Molybdenum	ppm	ASTM D5185m	0	**<1**	0	---
Manganese	ppm	ASTM D5185m		**<1**	<1	---
Magnesium	ppm	ASTM D5185m	100	**23**	28	---
Calcium	ppm	ASTM D5185m	0	**4**	7	---
Phosphorus	ppm	ASTM D5185m	0	**10**	4	---
Zinc	ppm	ASTM D5185m	0	**32**	13	---
Sulfur	ppm	ASTM D5185m	23500	**23123**	18795	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	**<1**	0	---
Sodium	ppm	ASTM D5185m		**7**	5	---
Potassium	ppm	ASTM D5185m	>20	**3**	1	---
Water	%	ASTM D6304	>0.05	▲ **0.204**	▲ 0.305	---
ppm Water	ppm	ASTM D6304	>500	▲ **2040**	▲ 3050	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	**0.31**	0.33	---

KAESER COMPRESSORS
Built for a lifetime.

OIL ANALYSIS REPORT

Water (KF)

Acid Number

Viscosity @ 40°C

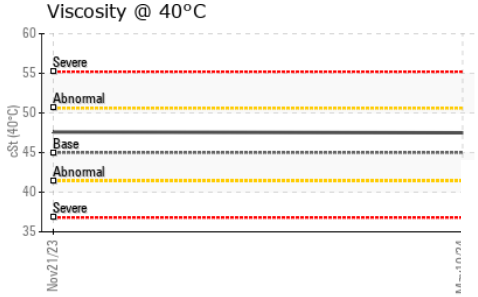

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	MODER	---
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	---
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	---
Silt	scalar	*Visual	NONE	**NONE**	NONE	---
Debris	scalar	*Visual	NONE	**NONE**	NONE	---
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	---
Appearance	scalar	*Visual	NORML	● **HAZY**	NORML	---
Odor	scalar	*Visual	NORML	**NORML**	NORML	---
Emulsified Water	scalar	*Visual	>0.05	▲ **0.2%**	▲ 0.2%	---
Free Water	scalar	*Visual		**NEG**	NEG	---

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	**47.5**	47.6	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					*no image*
Bottom					*no image*

GRAPHS

Ferrous Alloys

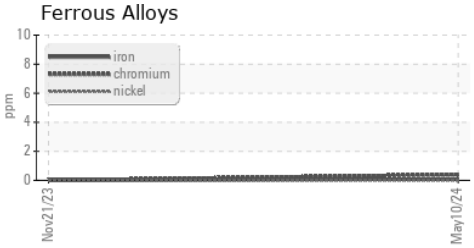

Non-ferrous Metals

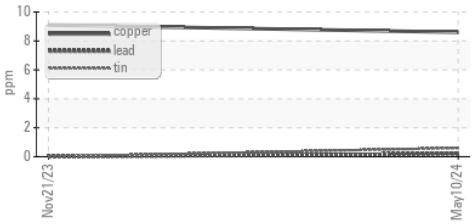

Viscosity @ 40°C

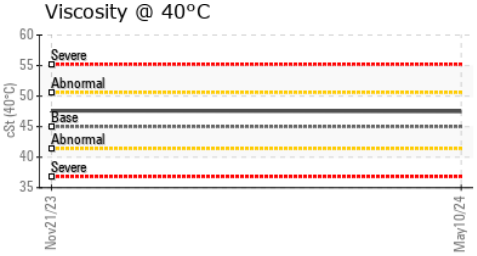

Acid Number

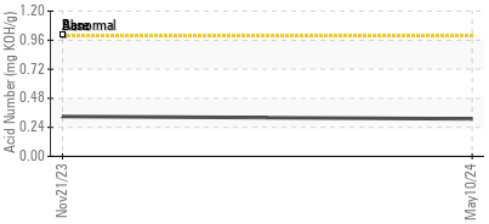

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA016456 **Received** : 13 May 2024
Lab Number : 06177713 **Tested** : 15 May 2024
Unique Number : 11023766 **Diagnosed** : 15 May 2024 - Angela Borella
Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

SHERWIN WILLIAMS
17303 GREEN MOUNTAIN RD
SAN ANTONIO, TX
US 78247
Contact: Service Manager
T:
F: